

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY PJ CHK'D NRH
DATE 05/03/12 DATE 07/31/12
REPLACES REV 00 REQ NO. 27127
DWG NO. R240-91-107


TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT TIME-CURRENT CHARACTERISTIC CURVES:
5.5KV X-LIMITER FULL RANGE FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1992)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

CATALOG NUMBERS:

55FXXX-I
55FXXX-II

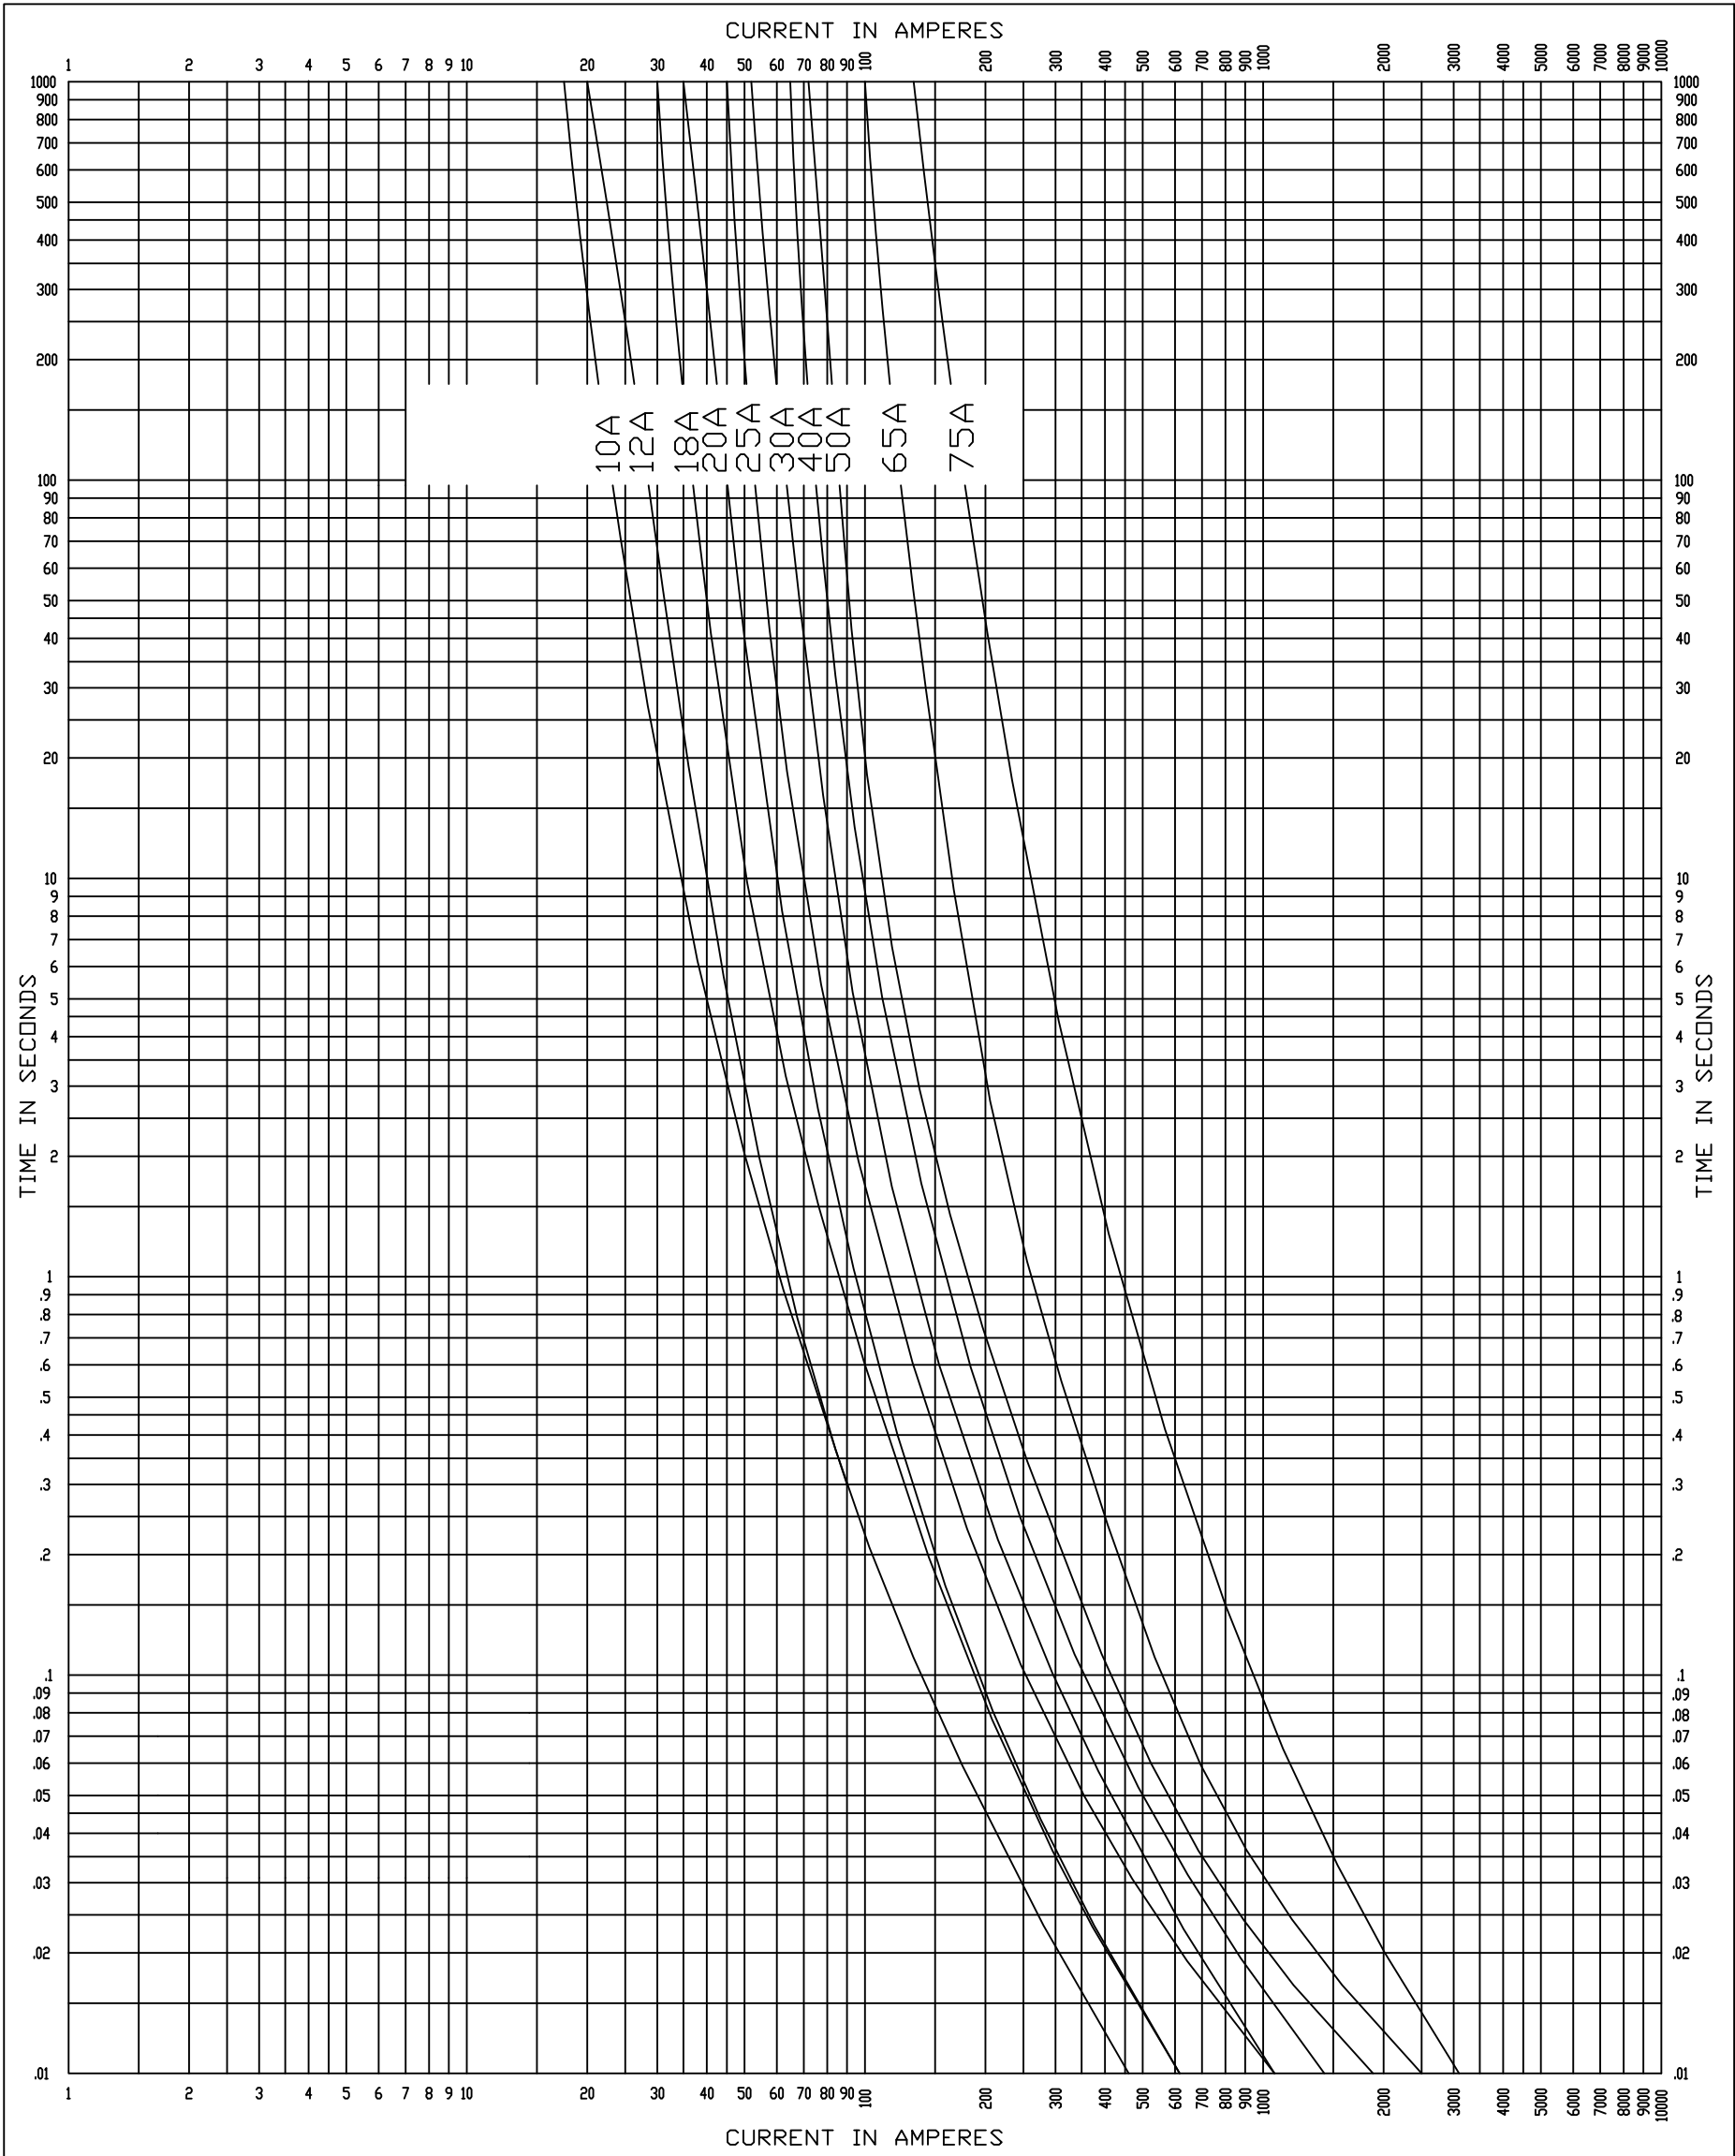

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY PJ CHK'D NRH
DATE 05/03/12 DATE 07/31/12
REPLACES REV 00 REQ NO. 27127
DWG NO. R240-91-107

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES:
5.5kV X-LIMITER FULL RANGE FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1992)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

CATALOG NUMBERS:

55FXXX-I
55FXXX-II