

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT  
8.3/13.2KV and 17.2/23KV ELF-LR FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)


MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-47  
Page 1 of 2

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY ALJ [CHKD] ALJ  
DATE 7-12-05 DATE 7-12-05  
REPLACES 3/03 [REV 02] REQ NO. 23003  
DWG NO. 42 39746 B 00

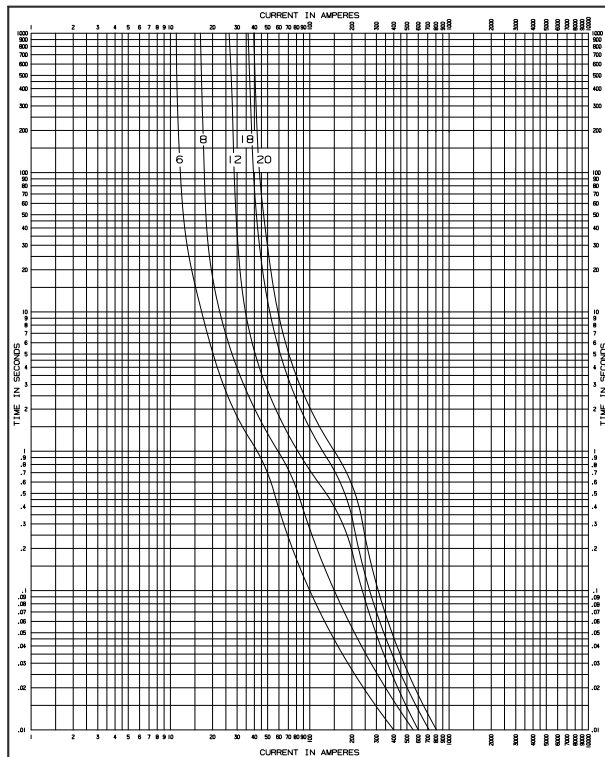

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR  
8.3/13.2KV and 17.2/23KV ELF-LR FUSE

Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-47  
Page 2 of 2

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY ALJ [CHKD] ALJ  
DATE 7-12-05 DATE 7-12-05  
REPLACES 3/03 [REV 02] REQ NO. 23003  
DWG NO. 42 39746 B 00