


		TIME-CURRENT CHARACTERISTIC CURVES	
COOPER POWER SYSTEMS DIVISION COMPONENTS & PROJECTS EQUIPMENT		MAXIMUM CLEAR 8.3, 15.5, 23.0 KV X-LIMITER "DW" FUSE	
DRAWN BY SES (CHK'D)	DATE 8/15/95	Tests made at RATED Volts ac at LOW pt. at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981	
REPLACES 9/93 (REV 0.1) REC NO. 16032	DWG NO. TCC308C	MAXIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE MINUS THIS DRAWING WAS PRODUCED ON A CAD SYSTEM. ANY MANUAL REVISION WILL VOID IT.	

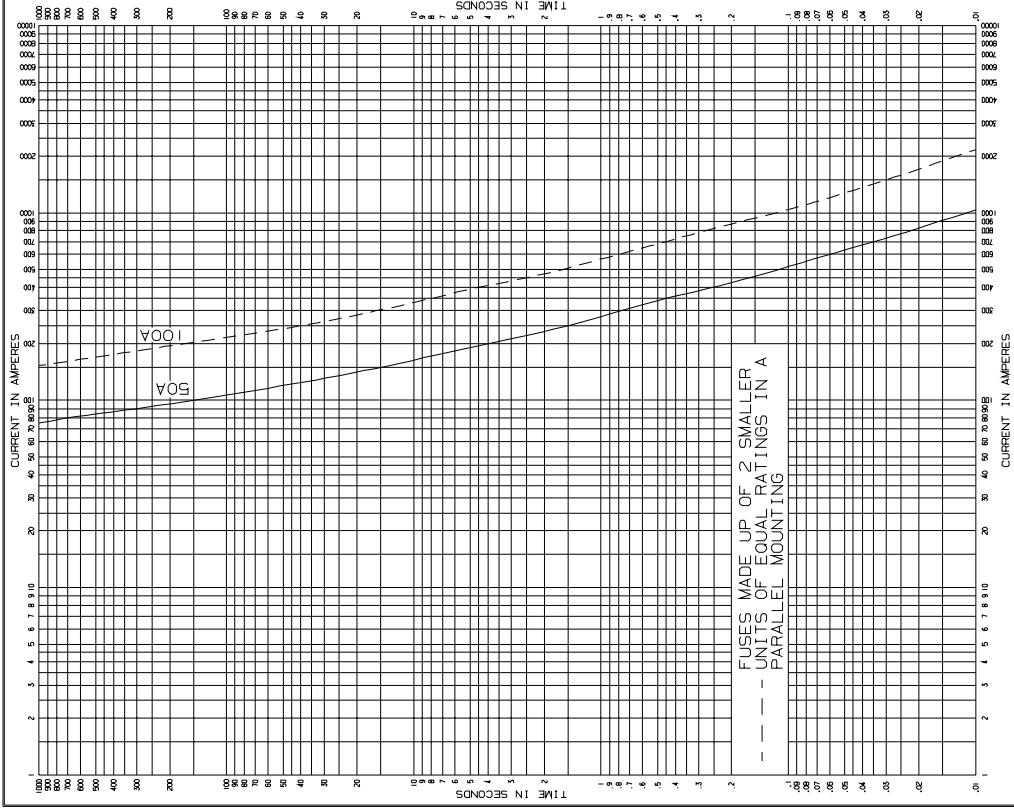

<p>COOPER POWER SYSTEMS DIVISION COMPONENTS & PROJECTS GROUP</p>		<p>TIME-CURRENT CHARACTERISTIC CURVES</p>
<p>DRAWN BY: SES (CHK'D)</p>	<p>MINIMUM MELT 8.3, 15.5, 23.0 KV X-LIMITER "DM" FUSE</p>	
<p>DATE: 8/15/95</p>	<p>Tests made at RATED Volts ac at LOW pt. at 25°C with no initial load Standards used as basis for data: ANSI C37.47-1981</p>	
<p>REPLACES: 9/93 (REV 0.1) REC NO. 16032</p>	<p>MINIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE PLUS</p>	
<p>DWG NO.: TCC308M</p>	<p>THIS DRAWING WAS PRODUCED ON A CAD SYSTEM. ANY MANUAL REVISION WILL VOID IT.</p>	