
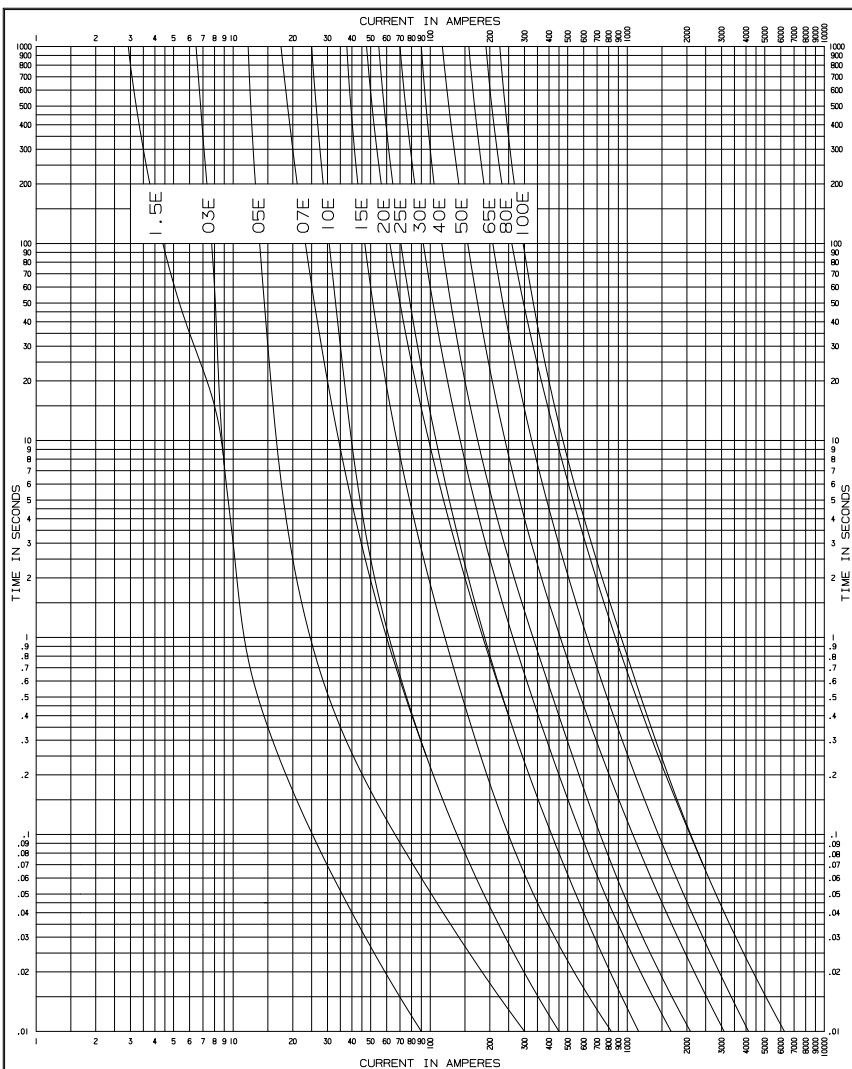



|  |          |  |  |
|--|----------|--|--|
| <br>COOPER POWER SYSTEMS DIVISION<br>COMPONENTS & PROTECTIVE EQUIPMENT |          | TIME-CURRENT CHARACTERISTIC CURVES   |  |
|  |          | MINIMUM MELT TIME-CURRENT CHARACTERISTIC CURVES<br>8.3, 15.5 & 23 kV X-LIMITER FULL RANGE "E" RATED FUSE |  |
| DRAWN BY   | RJC      | CHK'D  |  |
| DATE   | 1-17-96  | DATE   |  |
| REPLACES   | 11/87    | REV  | 01   |
| REQ. NO.   |          |  |  |
| DWG NO.  | TCC200 M |  |  |
|  |          |  | Tests made at RATED Volts ac at LOW pf at 25°C with no initial load          |
|  |          |  | Standards used as basis for data: ANSI C37.47-1981                           |
|  |          |  | MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS                     |
|  |          |  | THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT. |



|  |          |   |    |
|--|----------|---|----|
| <br>COOPER POWER SYSTEMS DIVISION<br>COMPONENTS & PROTECTIVE EQUIPMENT |          | TIME-CURRENT CHARACTERISTIC CURVES  |    |
|  |          | MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES<br>8.3, 15.5 & 23 kV X-LIMITER FULL RANGE "E" RATED FUSE |    |
| DRAWN BY   | RJC      | CHK'D   |    |
| DATE   | 1-17-96  | DATE  |    |
| REPLACES   | 11/87    | REV   | 01 |
| REQ. NO.   |          |   |    |
| DWG NO.  | TCC200 C |   |    |

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.