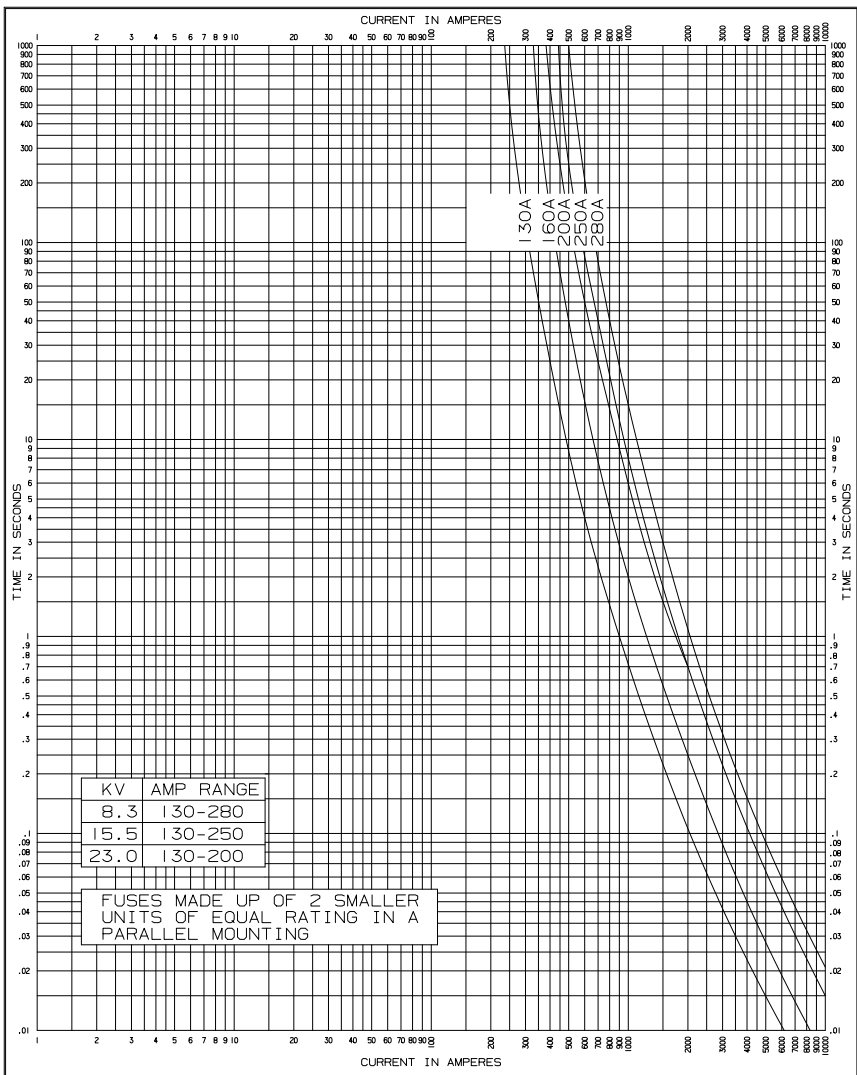

 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES	
DRAWN BY RJC		MINIMUM MELT TIME-CURRENT CHARACTERISITC CURVES 8.3, 15.5 & 23kv X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE	
DATE 1-15-96		Tests made at RATED Volts ac at LOW pf at 25°C with no initial load	
REPLACES 5/88 REV 01 REQ. NO.		Standards used as basis for data: ANSI C37.47-1981	
DWG NO. TCC304 M		MINIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE PLUS	
		THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	



 COOPER POWER SYSTEMS DIVISION COMPONENTS & PROTECTIVE EQUIPMENT		TIME-CURRENT CHARACTERISTIC CURVES MAXIMUM CLEAR TIME-CURRENT CHARACTERISTIC CURVES 8.3, 15.5 & 23kV X-LIMITER FULL RANGE PARALLEL MOUNTED FUSE	
		Tests made at RATED Volts ac at LOW pf at 25°C with no initial load	
DRAWN BY RJC	CHK'D	Standards used as basis for data: ANSI C37.47-1981	
DATE 1-15-96	DATE	MAXIMUM TEST POINTS PLOTTED 50 VARIATIONS SHOULD BE MINUS	
REPLACES 5/88 REV 01	REQ. NO.		
DWG NO. TCC304 C	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.		