


COOPER Power Systems <small>COMPONENTS AND PROTECTIVE EQUIPMENT</small>		TIME-CURRENT CHARACTERISTIC CURVES	
		MINIMUM MELT 8.3KV AND 15.5KV K-LIMITER BACK-UP FUSE	
DRAWN BY	ALJ	CHK'D	Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
DATE	02/22/00	DATE	Standards used as basis for data: ANSI C37.47-1981 (R1992)
REPLACES	/	REV	01
REQ. NO.	19616	MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS	
DWG NO.	CT TCC701M 00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.	

Reference Data
R240-91-113
Page 1 of 2

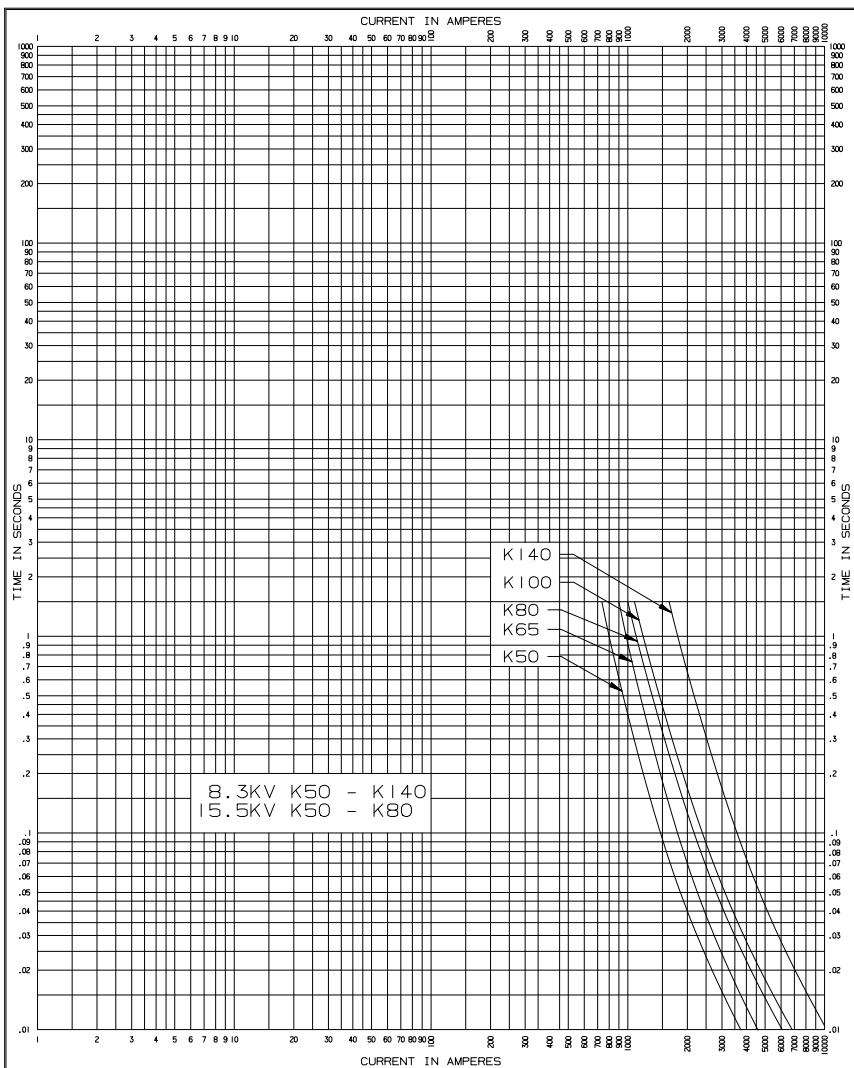

COOPER Power Systems <small>COMPONENTS AND PROTECTIVE EQUIPMENT</small>		TIME-CURRENT CHARACTERISTIC CURVES	
		MAXIMUM CLEAR 8.3KV AND 15.5KV K-LIMITER BACK-UP FUSE	
DRAWN BY	ALJ	CHK'D	Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
DATE	02/22/00	DATE	Standards used as basis for data: ANSI C37.47-1981 (R1992)
REPLACES	/	REV	01
REQ. NO.	19616	MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS	
DWG NO.	CT TCC701	C	00
			THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.