

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 8.3 AND 15,5KV ELS6
FULL RANGE OIL IMMERSIBLE FUSE 3.0 DIA.

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)


MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-86
Page 1 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY WJK CHKD
DATE 6-15-99 DATE
REPLACES 06/92/REV 01 REG NO. 18907
DWG NO. 42 39053 B 00

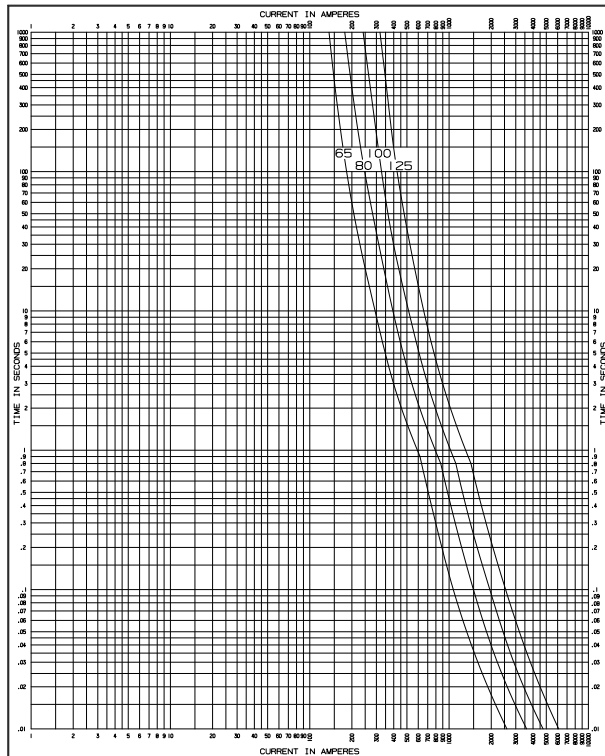

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 8.3 AND 15,5KV ELS6
FULL RANGE OIL IMMERSIBLE FUSE 3.0 DIA.

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-86
Page 2 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY WJK CHKD
DATE 6-15-99 DATE
REPLACES 06/92/REV 01 REG NO. 18907
DWG NO. 42 39053 B 00