

TIME-CURRENT CHARACTERISTIC CURVES

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT


MINIMUM MELT 8.3KV ELS
FULL RANGE OIL IMMERSIBLE FUSE

DATE 6-03-99 DATE
REPLACES 01/92/REV 01 REG NO. 18907
DWG NO. 42 38284 B 00

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

80 AMP - 2 - 40 AMP FUSES IN PARALLEL

Reference Data
R240-91-75
Page 1 of 2

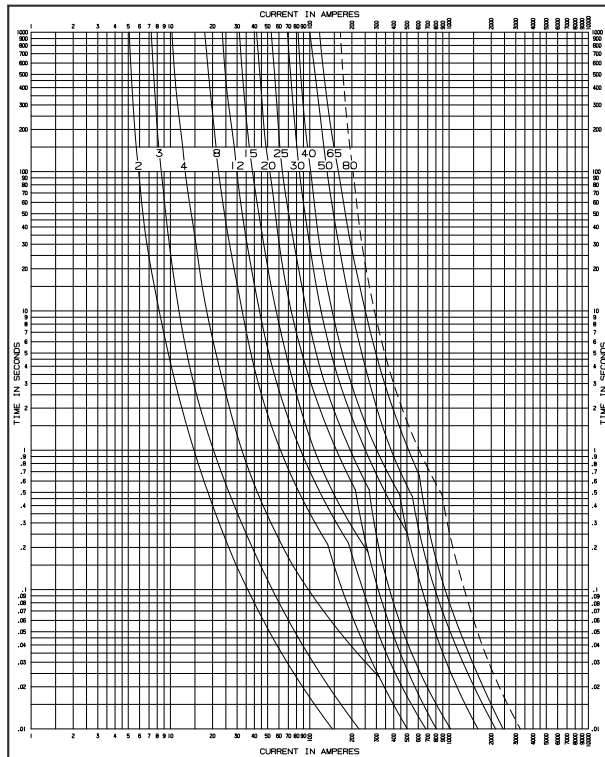

TIME-CURRENT CHARACTERISTIC CURVES

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

MAXIMUM CLEAR 8.3KV ELS
FULL RANGE OIL IMMERSIBLE FUSE

DATE 6-03-99 DATE
REPLACES 01/92/REV 01 REG NO. 18907
DWG NO. 42 38284 B 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

80 AMP - 2 - 40 AMP FUSES IN PARALLEL

Reference Data
R240-91-75
Page 2 of 2