

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 9.5kV MINI-MID RANGE AMULTI-COIL ELSF
BACKUP TYPE OIL IMMERSIBLE CURRENT LIMITING FUSE

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)


MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

DRAWN BY AL-J [GWD] (GTB) DATE 02/19/03
REPLACES 1/00 REV 03 REG NO. 21537

DWG NO. 42 39595 B 00

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-71
Page 1 of 2

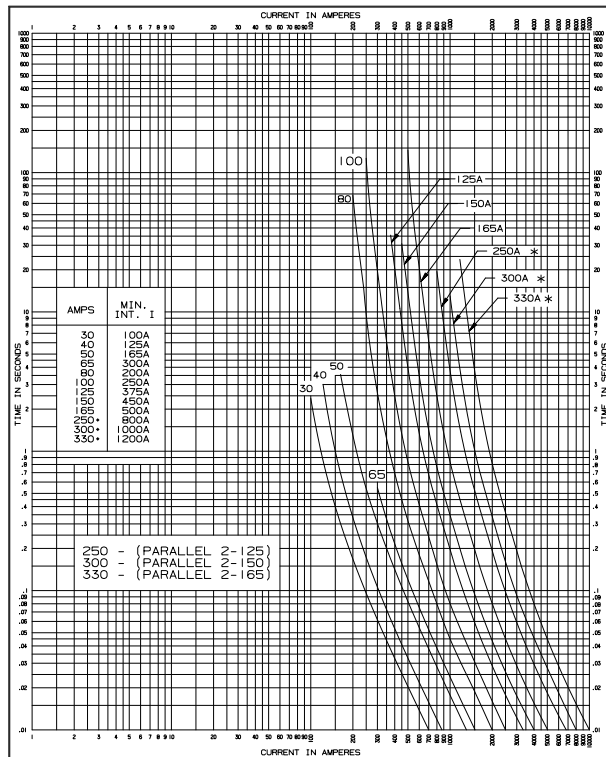

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 9.5kV MINI-MID RANGE AMULTI-COIL ELSF
BACKUP TYPE OIL IMMERSIBLE CURRENT LIMITING FUSE

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

DRAWN BY AL-J [GWD] (GTB) DATE 02/19/03
REPLACES 1/00 REV 03 REG NO. 21537

DWG NO. 42 39595 B 00

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-71
Page 2 of 2