

COOPER POWER SYSTEMS DIVISION  
COMPONENTS & PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT 8.3kV MINI-ELSP


BACKUP TYPE OIL IMMERSIBLE CURRENT LIMITING FUSE

DRAWN BY: EKS  
DATE: 07-16-97  
REPLACES: 08/91/REV 03  
DWG NO.: 42 3861 | B | 00

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-60  
Page 1 of 2

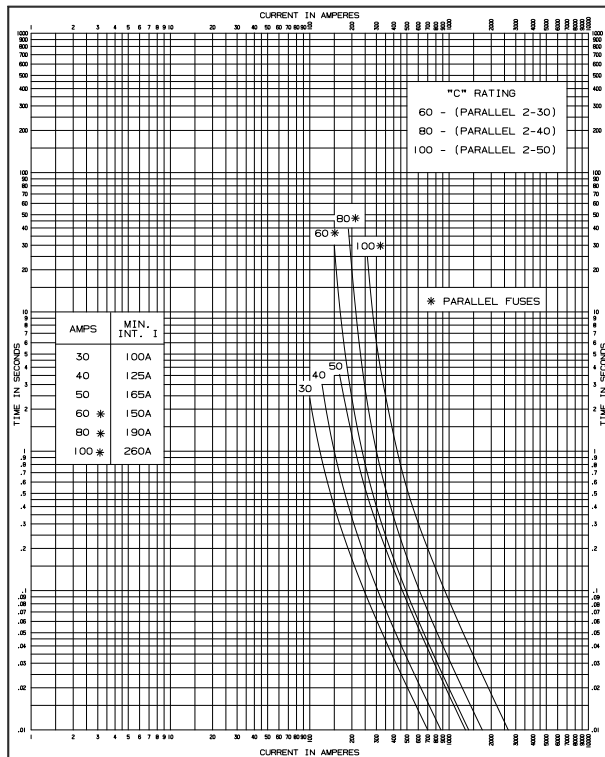

COOPER POWER SYSTEMS DIVISION  
COMPONENTS & PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR 8.3kV MINI-ELSP

BACKUP TYPE OIL IMMERSIBLE CURRENT LIMITING FUSE

DRAWN BY: EKS  
DATE: 07-16-97  
REPLACES: 08/91/REV 03  
DWG NO.: 42 3861 | B | 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-60  
Page 2 of 2