

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT


TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT CURRENT (FAULT) SENSING CARTRIDGE FUSE
718C & 719C FUSE LINKS, IN TRANSFORMER OIL

DRAWN BY JFR [CKW] DATE 12-19-00
REPLACES 01/85 [REV 00] REG. NO. 19892
DWG. NO. 42 3965 | B | 00

Tests made at LOW Volts ac at UNITY pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-52
Page 1 of 2

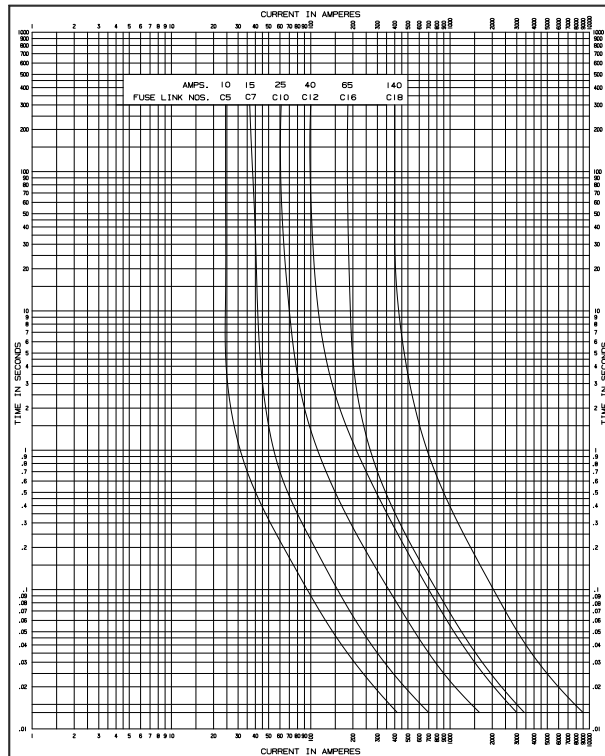

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR CURRENT (FAULT) SENSING CARTRIDGE FUSE
718C & 719C FUSE LINKS, IN TRANSFORMER OIL

DRAWN BY JFR [CKW] DATE 12-19-00
REPLACES 01/85 [REV 00] REG. NO. 19892
DWG. NO. 42 3965 | B | 00

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1982)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-52
Page 2 of 2