

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**

MINIMUM MELT GARTRIDGE DUAL (OVERHEAD) SENSING  
722C, 723C, 628C, 629C FUSE LINKS, IN TRANSFORMER OIL

Tests made at LOW Volts ac at UNITY pf at 25°C with no initial load


Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [CKW]  
DATE 12-21-00  
REPLACES 01/85 [REV 00] REG. NO. 19892  
DWG NO. 42 39652 B | 00

Reference Data  
R240-91-55  
Page 1 of 2

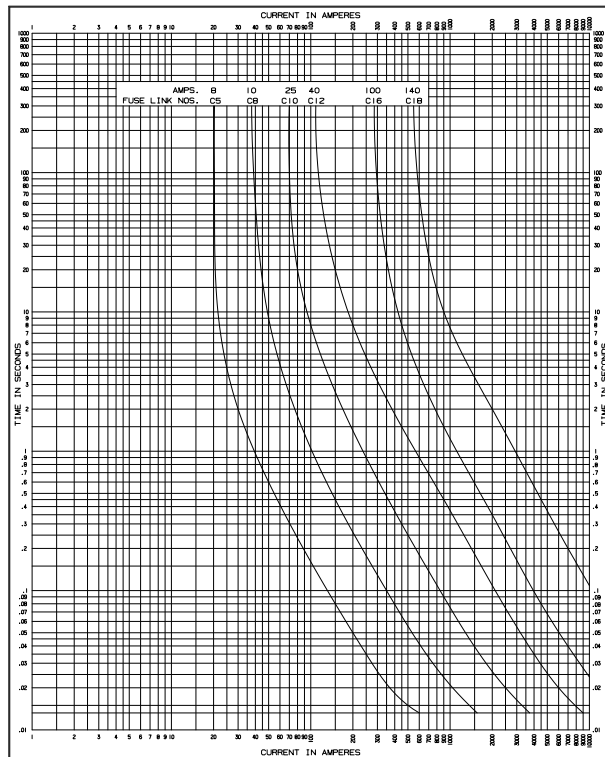

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**

MAXIMUM CLEAR GARTRIDGE DUAL (OVERHEAD) SENSING  
722C, 723C, 628C, 629C FUSE LINKS, IN TRANSFORMER OIL

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [CKW]  
DATE 12-21-00  
REPLACES 01/85 [REV 00] REG. NO. 19892  
DWG NO. 42 39652 B | 00

Reference Data  
R240-91-55  
Page 2 of 2