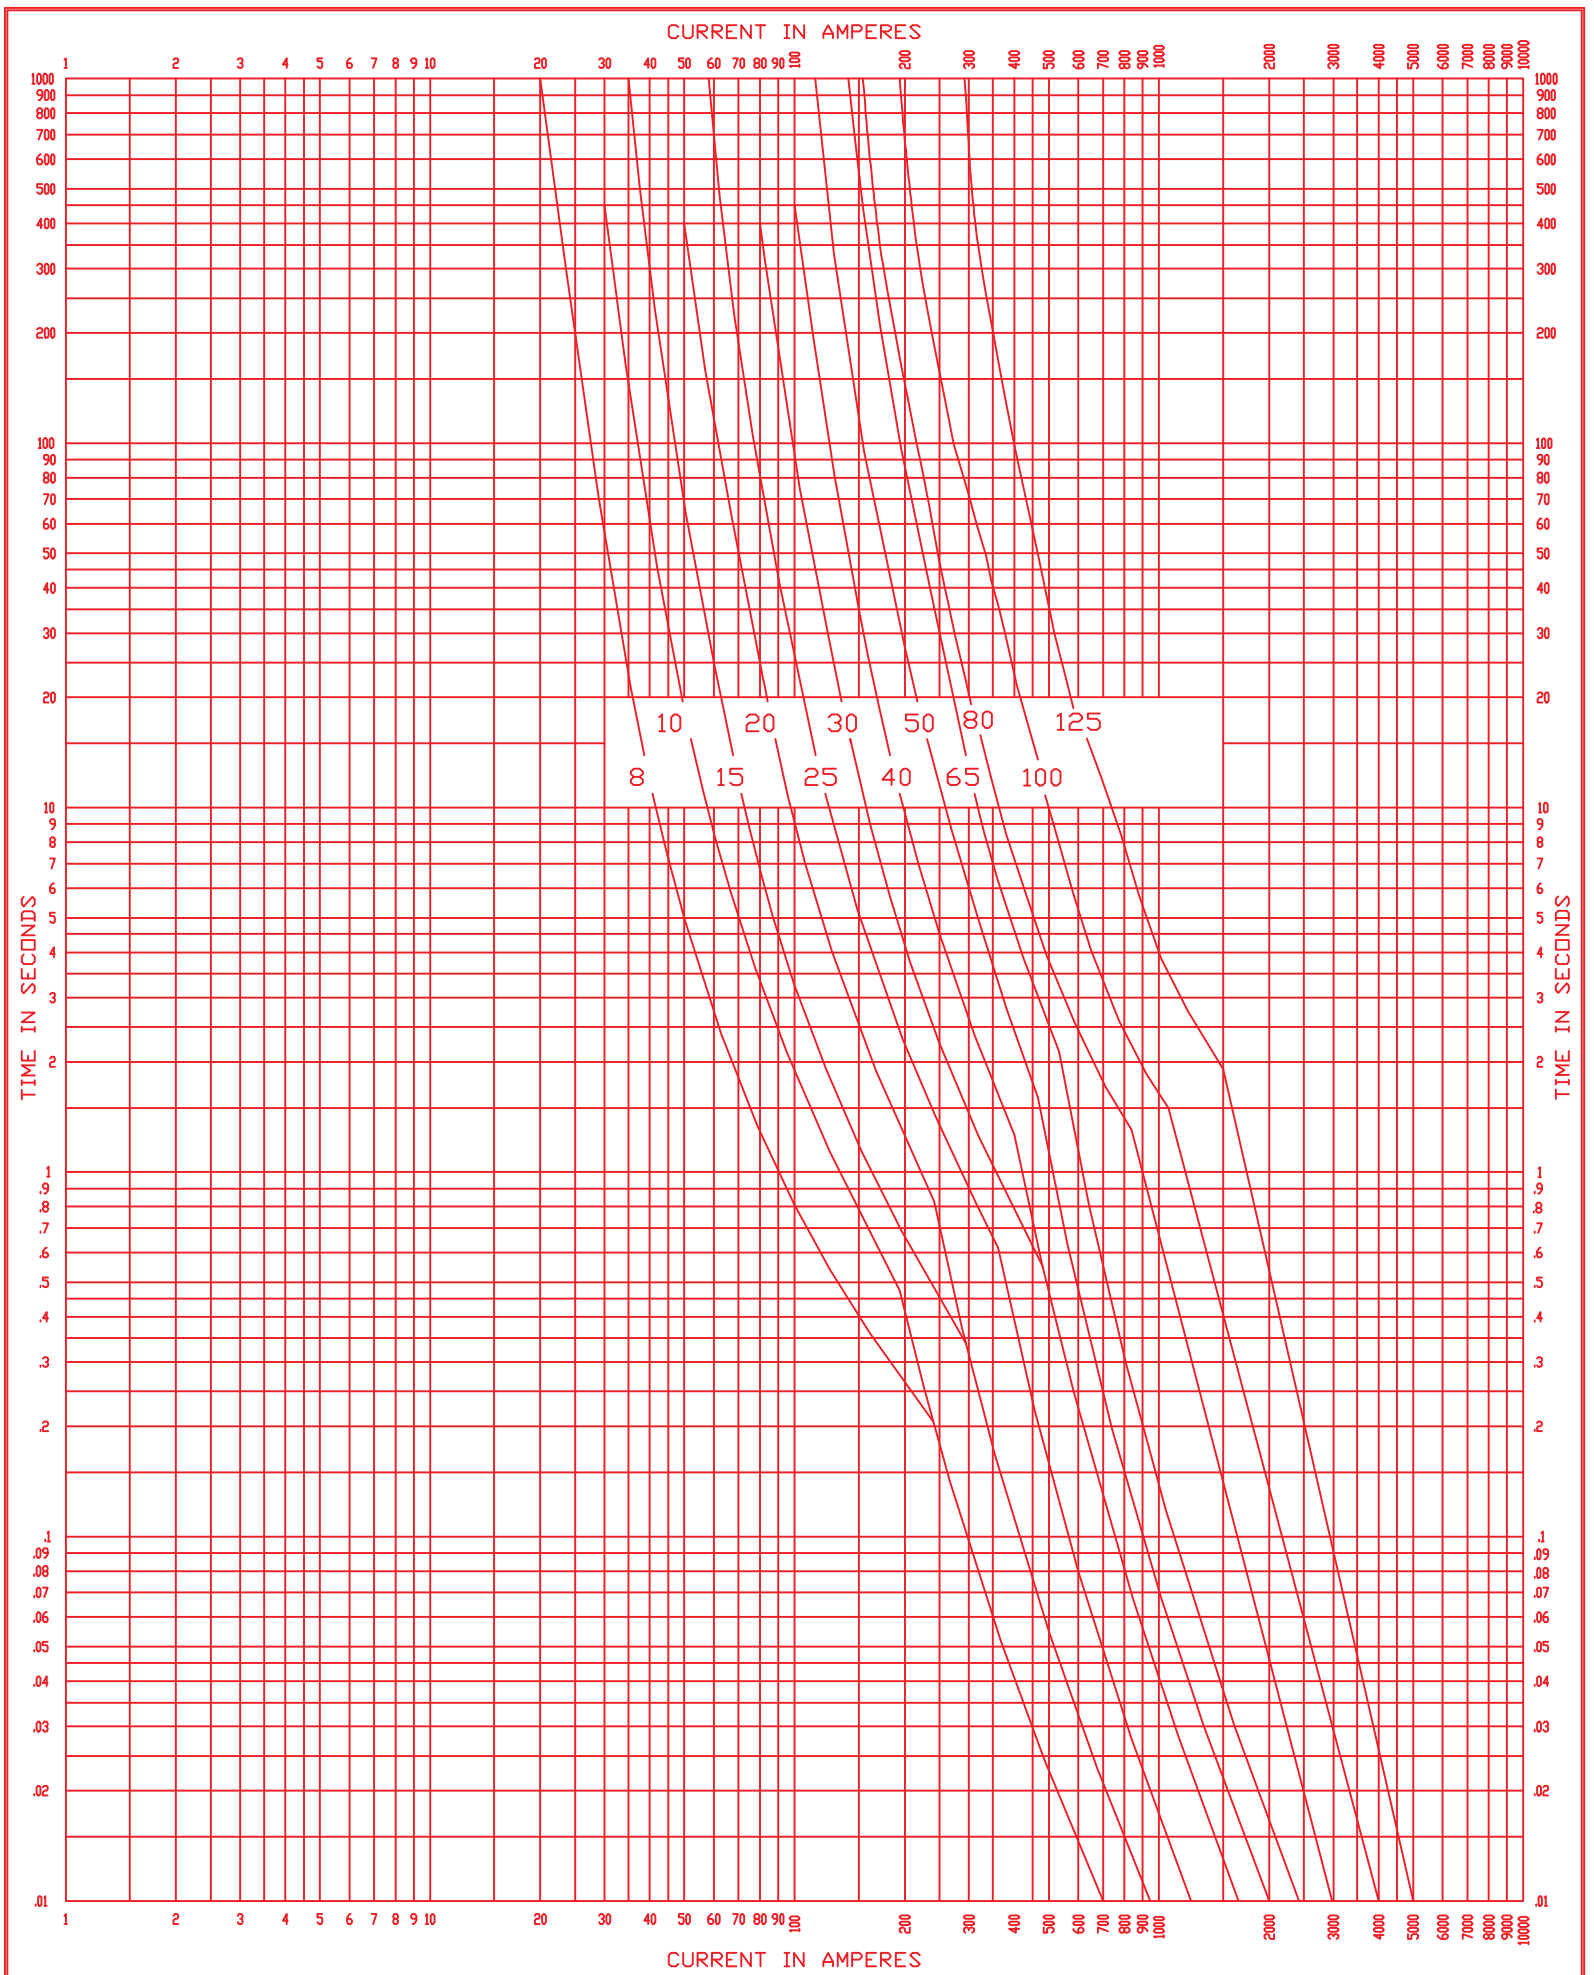

 <p>COOPER Power Systems COMPONENTS AND PROTECTIVE EQUIPMENT</p>				TIME-CURRENT CHARACTERISTIC CURVES	
				MINIMUM MELT TCC ON THE 15.5 & 17.2kV EDISON MODULAR FUSE (EMF)	
DRAWN BY JLR		CHK'D NRH		Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load	
DATE 08/05/08		DATE 08/14/08		Standards used as basis for data: ANSI C37.47-1981 (R1992)	
REPLACES --		REV 03		REQ NO. 24503	
				MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS	
DWG NO.	42	01312	N	00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.
FUSE RATINGS: 15.5KV (8 THRU 125 AMPS) 17.2KV (8 THRU 100 AMPS)					
					Reference Data R240-91-162 Page 1 of 2



 COMPONENTS AND PROTECTIVE EQUIPMENT				TIME-CURRENT CHARACTERISTIC CURVES TOTAL CLEARING TCC ON THE 15.5 & 17.2kV EDISON MODULAR FUSE (EMF)	
				Tests made at RATED Volts ac at LOW pf at 25°C with no initial load	
DRAWN BY JLR		CHK'D NRH		Standards used as basis for data: ANSI C37.47-1981 (R1992)	
DATE 08/05/08		DATE 08/14/08		MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS	
REPLACES --		REV 03		REQ NO. 24503	
DWG NO.	42	01312	N	00	THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.
FUSE RATINGS: 15.5KV (8 THRU 125 AMPS) 17.2KV (8 THRU 100 AMPS)					
					Reference Data R240-91-162 Page 2 of 2