

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT  
EEI-NEMA TYPE EK-TIN


Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [C]KW  
DATE 8-16-00  
REPLACES 02/70 [REV] 00 [REG] NO. 19892  
DWG NO. 42 39638 B 00

Reference Data  
R240-91-5  
Page 1 of 2

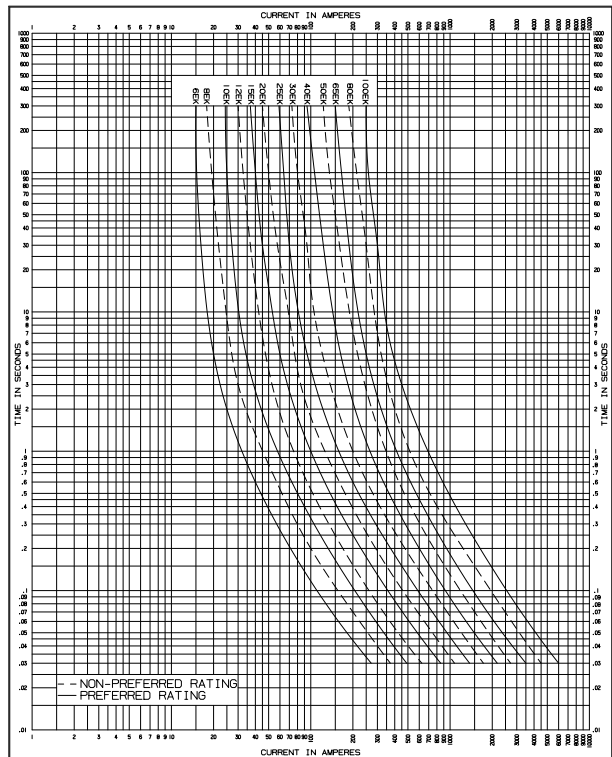

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEARING  
EEI-NEMA TYPE EK-TIN

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1981 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [C]KW  
DATE 8-16-00  
REPLACES 02/70 [REV] 00 [REG] NO. 19892  
DWG NO. 42 39638 B 00

Reference Data  
R240-91-5  
Page 2 of 2