

MINIMUM MELT TIME CURRENT CHARACTERISTIC CURVES

38KV, ELSP FUSES

TESTS MADE AT LOW VOLTS AC AT HIGH PF AT 25°C WITH NO INITIAL LOAD

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

**Cooper Power Systems**  
by **EATON**

DRAWN BY DDM	DWG DATE 8/20/14
REQ 28592	REV DATE 8/20/14 DDM
APPROVAL JRB 9/2/14	


Eaton's Cooper Power Systems Confidential

DOC NO. R240-91-170	REV 00
------------------------	-----------

CAT NO.

CBUC38XXD100

SHEET 1 OF 2

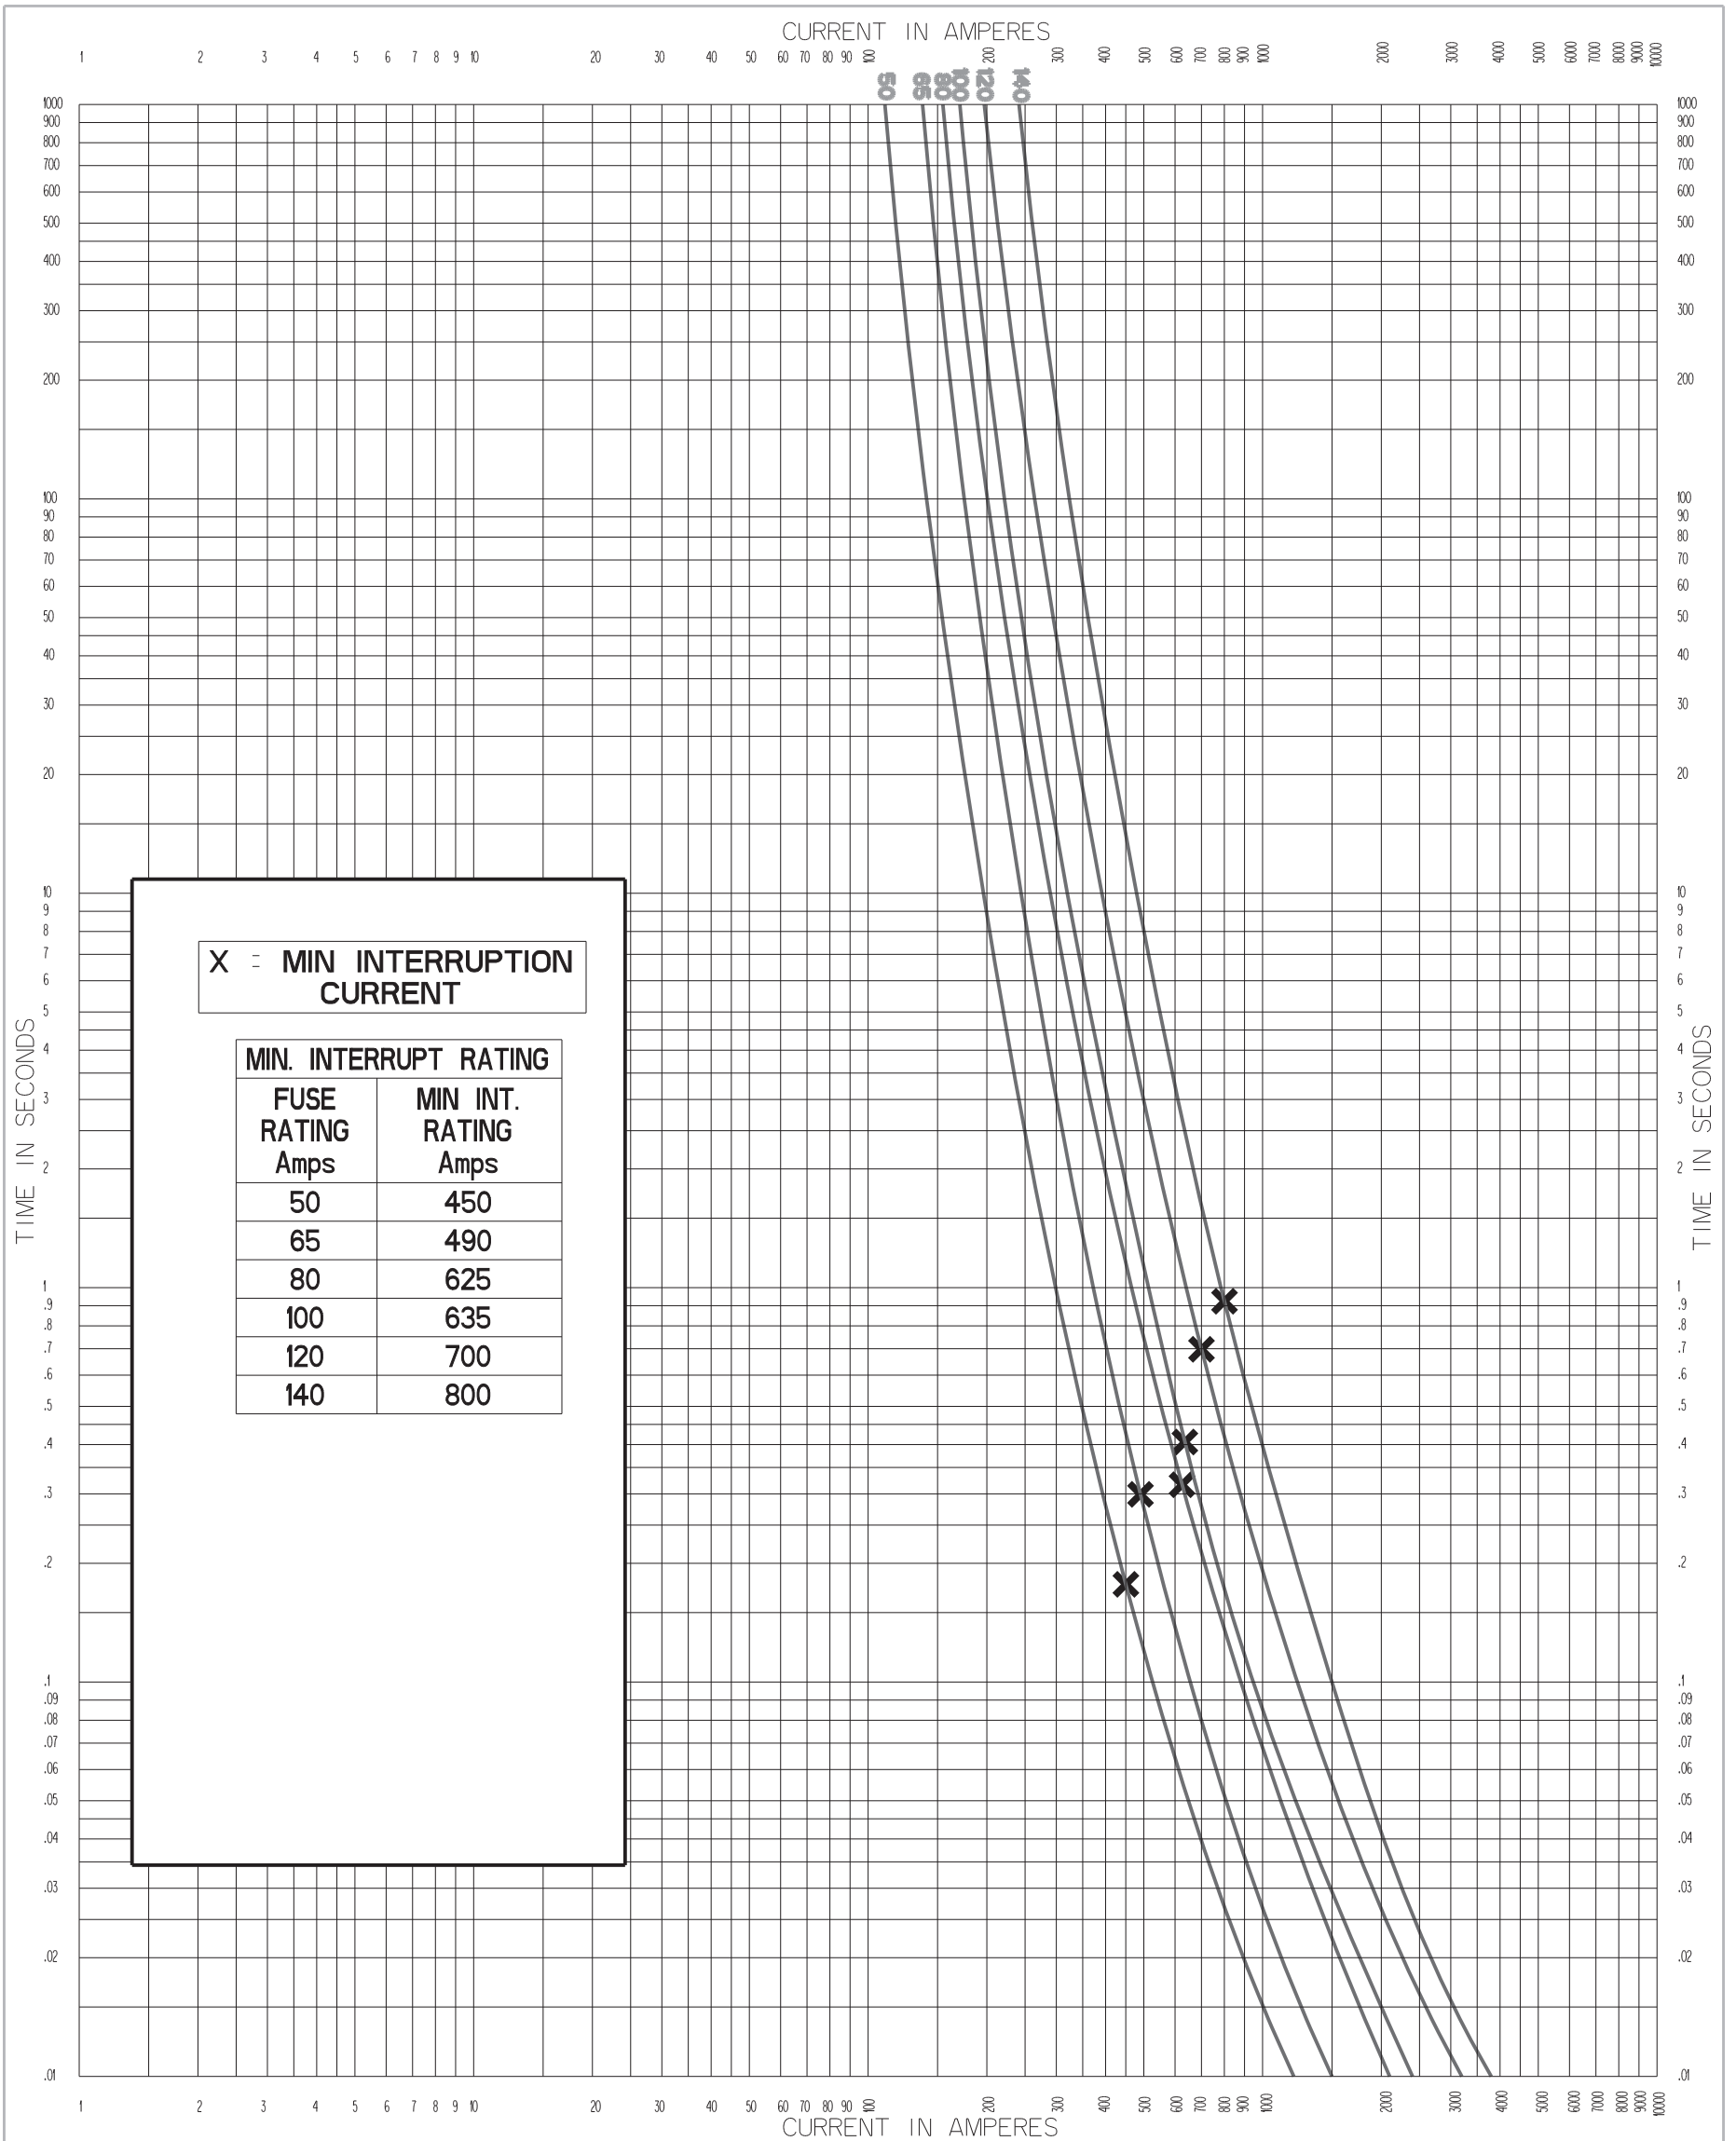

MAXIMUM CLEAR TIME CURRENT CHARACTERISTIC CURVES

38KV, ELSP FUSES

TESTS MADE AT RATED VOLTS AC AT LOW PF AT 25°C WITH NO INITIAL LOAD

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

**Cooper Power Systems**  
by **EATON**

DRAWN BY DDM	DWG DATE 8/20/14
REQ 28592	REV DATE 8/20/14 DDM
APPROVAL JRB 9/2/14	

Eaton's Cooper Power Systems Confidential

DOC NO. R240-91-170	REV 00
------------------------	-----------

CAT NO.

CBUC38XXD100