

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY **DS** CHECKED _____
DATE **3-2-00** DATE _____
REPLACES **B/93** REV **01** REG NO. **19586**

DWG NO. **42 39108 B 00**

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
TYPE FLBR AND FL23R EXPULSION FUSES


Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-58
Page 1 of 2

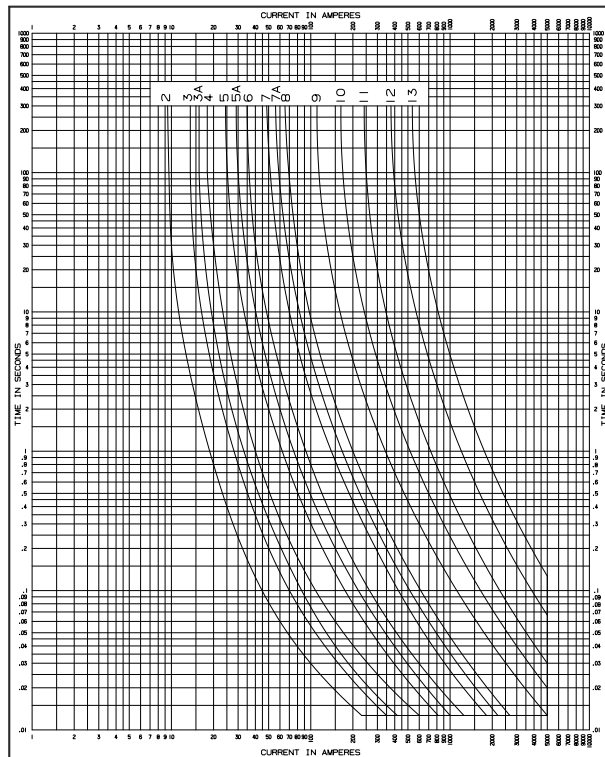

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY **DS** CHECKED _____
DATE **3-2-00** DATE _____
REPLACES **B/93** REV **01** REG NO. **19586**

DWG NO. **42 39108 B 00**

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
TYPE FLBR AND FL23R EXPULSION FUSES

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-58
Page 2 of 2