

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
FOR TYPE EEI-NEMA TYPE K-TIN


Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-1
Page 1 of 2

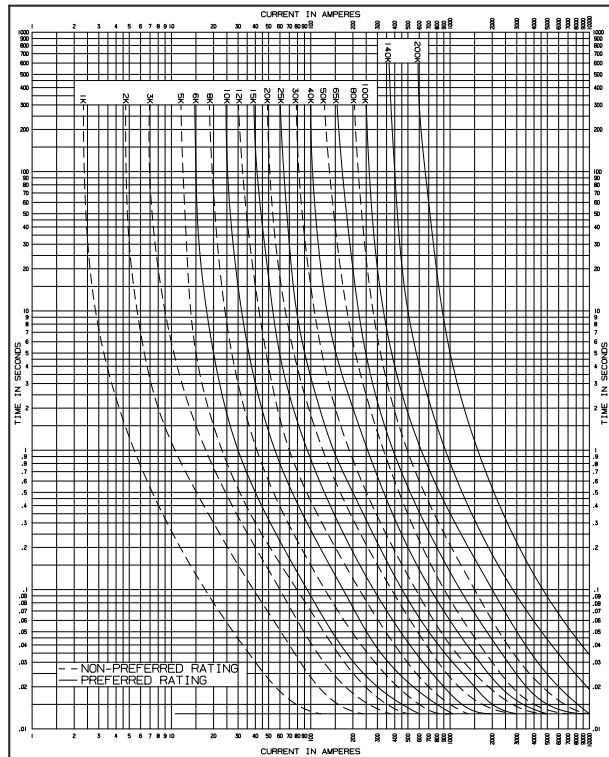

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
FOR TYPE EEI-NEMA TYPE K-TIN

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-1
Page 2 of 2

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CWD]
DATE 7-11-00 DATE
REPLACES 04/85 [REV 00] REG NO. 19892
DWG NO. 42 39634 B 00

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY JFR [CWD]
DATE 7-11-00 DATE
REPLACES 04/85 [REV 00] REG NO. 19892
DWG NO. 42 39634 B 00