

MELTING TIME-CURRENT CHARACTERISTIC CURVES


For KEARNEY TYPE 124092 DUAL ELEMENT Fuse Links. In TRANSFORMER OIL

BASIS FOR DATA Standards. Dated _____

1. Tests made at _____ Volts a-c at _____ p-f., starting at 25C with no initial load.

2. Curves are plotted to MINIMUM Test points so variations should be PLUS

No. 124092A
Date 4-10-75

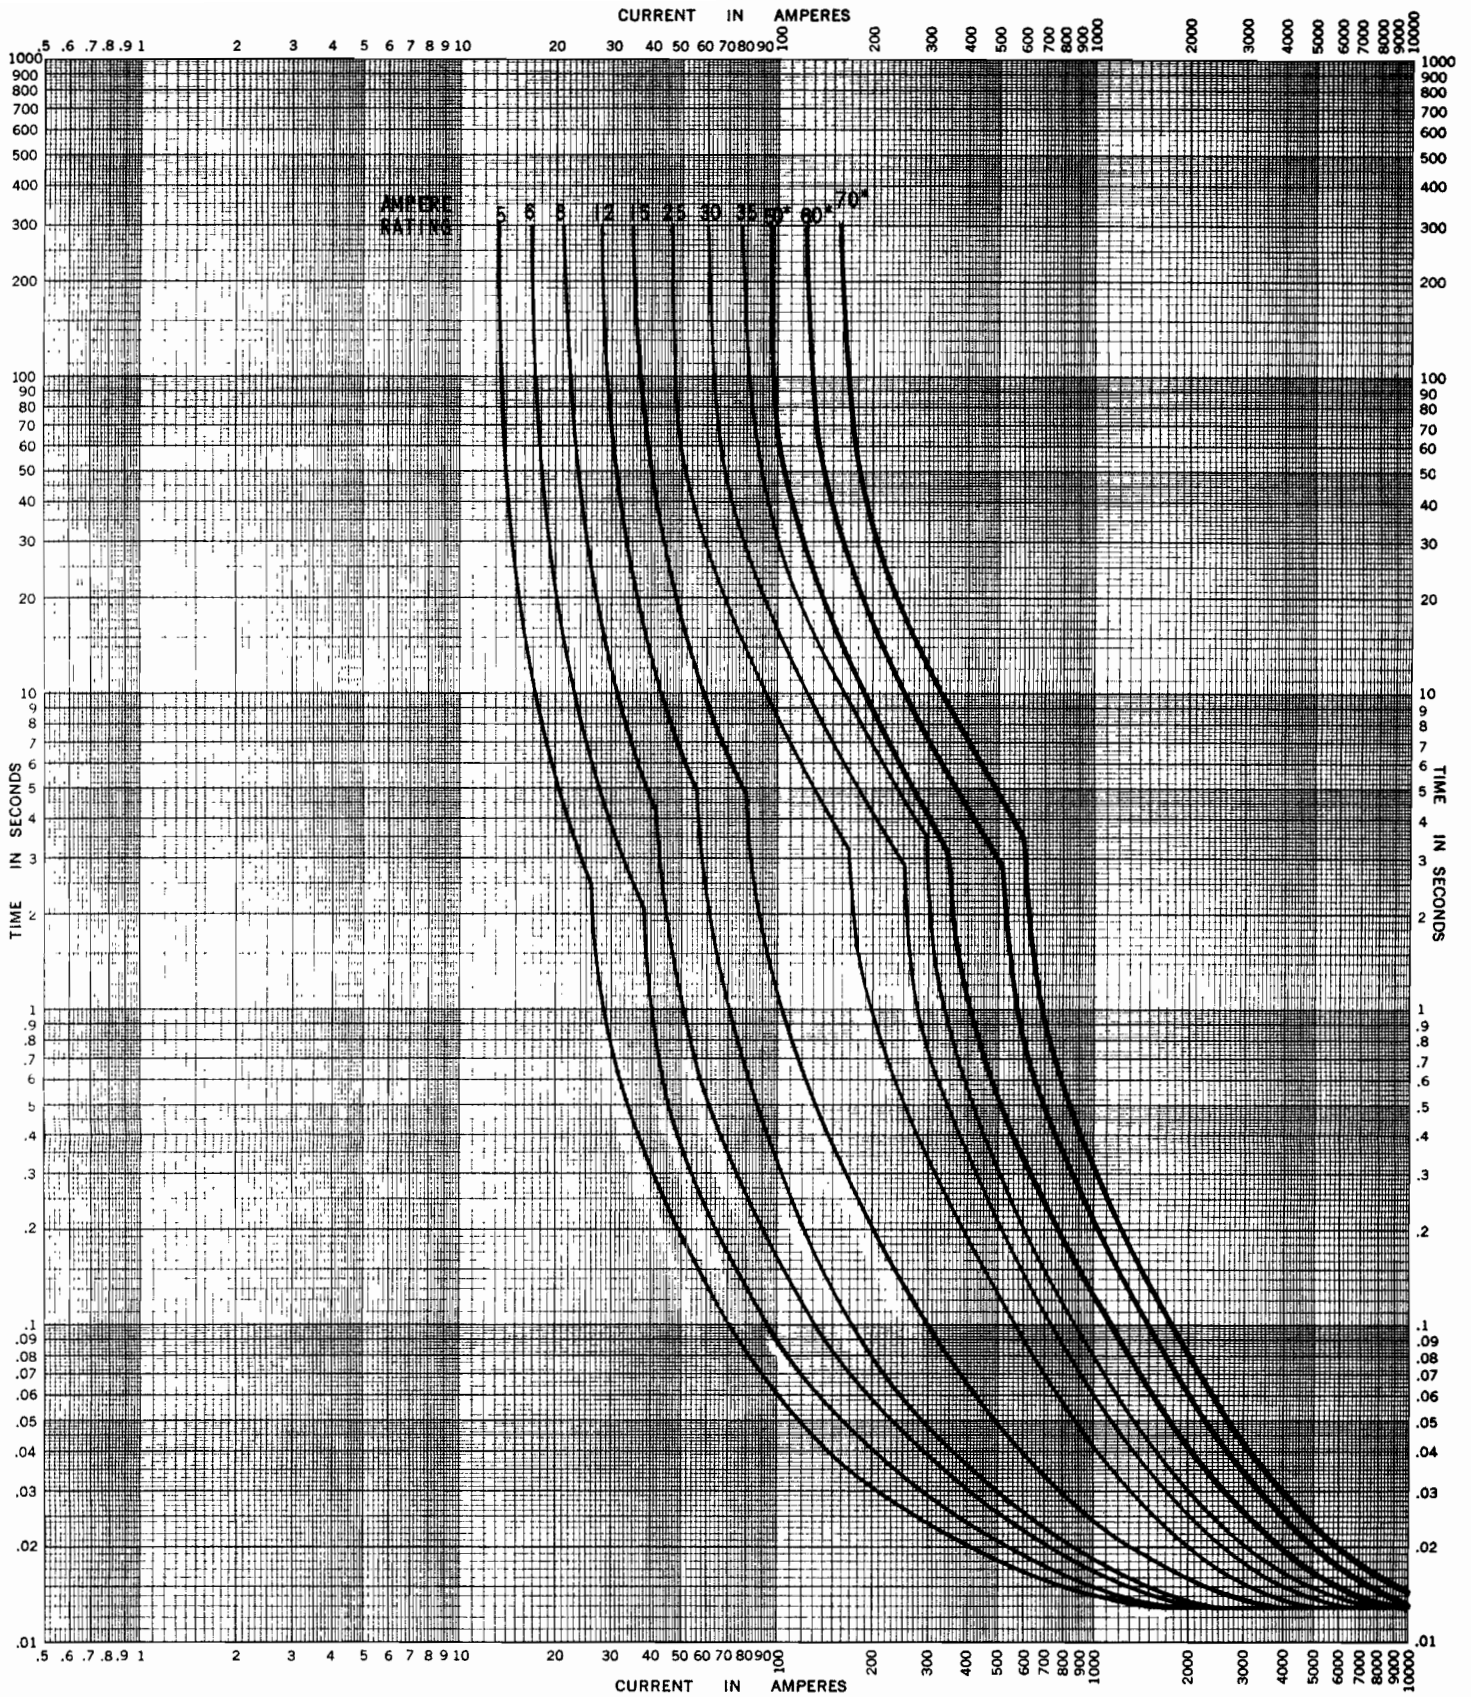

TOTAL CLEARING TIME-CURRENT CHARACTERISTIC CURVES

For KEARNEY TYPE 124092 DUAL ELEMENT Fuse Links In TRANSFORMER OIL

BASIS FOR DATA Standards _____ Dated _____

1. Tests made at _____ Volts a-c at _____ p-f., starting at 25C with no initial load

2. Curves are plotted to MAXIMUM Test points so variations should be MINUS

No. 124092B
Date 4-10-75