

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**  
MINIMUM TRIP CURVES FOR 3PH MAGNEX


DRAWN BY DG [CHKD] JAW  
DATE 05-27-03 DATE 05-27-03  
REPLACES 04/03/REV 02/REQ NO. 21742

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)  
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

DWG NO. 42 39753 B 00

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-302  
Page 1 of 2

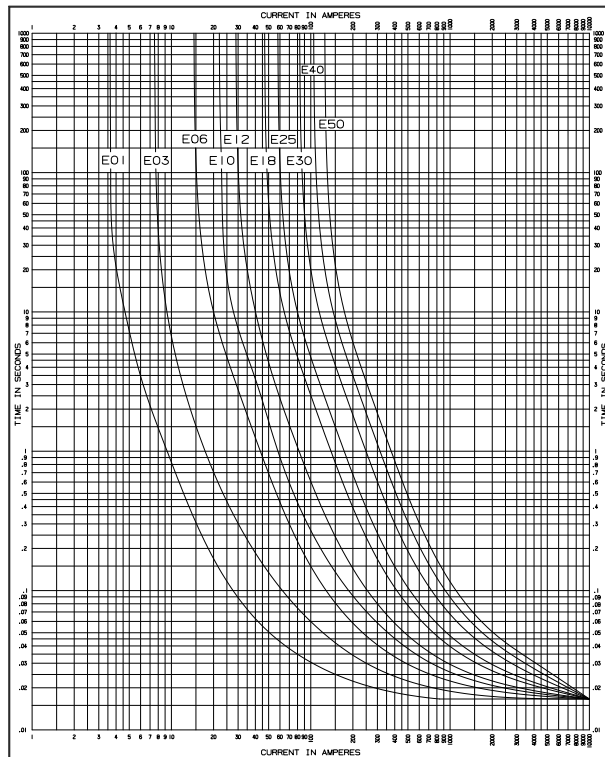

**COOPER** Power Systems  
COMPONENTS AND PROTECTIVE EQUIPMENT

**TIME-CURRENT CHARACTERISTIC CURVES**  
MAXIMUM CLEAR CURVES FOR 3PH MAGNEX

DRAWN BY DG [CHKD] JAW  
DATE 05-27-03 DATE 05-27-03  
REPLACES 04/03/REV 02/REQ NO. 21742

Tests made at HIGH Volts ac at LOW pf at 25°C with no initial load  
Standards used as basis for data: ANSI C37.47-1991 (R1992)  
MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

DWG NO. 42 39753 B 00

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data  
R240-91-302  
Page 2 of 2