

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
TYPE S


Tests made at 240 Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [CHKD] DATE 11-3-00
REPLACES 09/79 [REV 00] REG NO. 19892
DWG NO. 42 39644 B 00

Reference Data
R240-91-15
Page 1 of 2

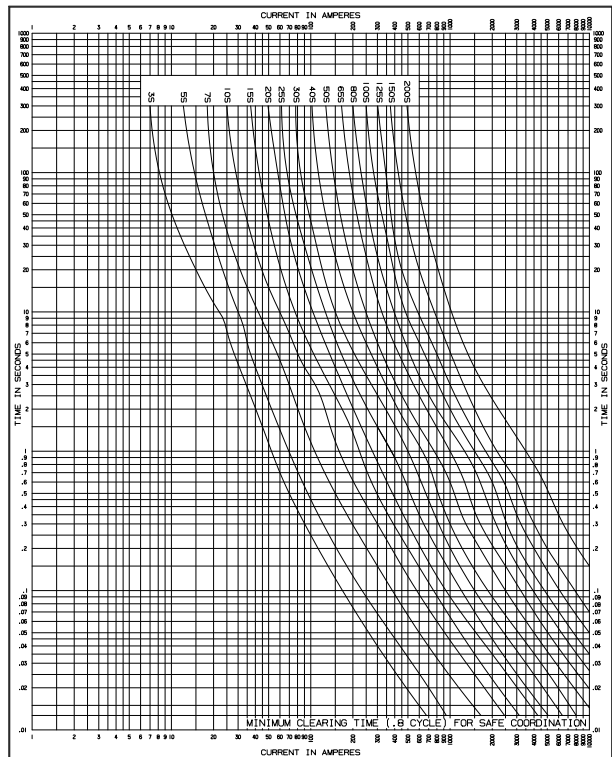

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM CLEAR
TYPE S

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

DRAWN BY JFR [CHKD] DATE 11-3-00
REPLACES 09/79 [REV 00] REG NO. 19892
DWG NO. 42 39644 B 00

Reference Data
R240-91-15
Page 2 of 2