

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MINIMUM MELT
EEI-NEMA TYPE T-TIN

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load


Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-2
Page 1 of 2

DRAWN BY JFR [CWD]
DATE 7-27-00
REPLACES 04/85 [REV 00] REG. NO. 19892
DWG NO. 42 39635 B 00

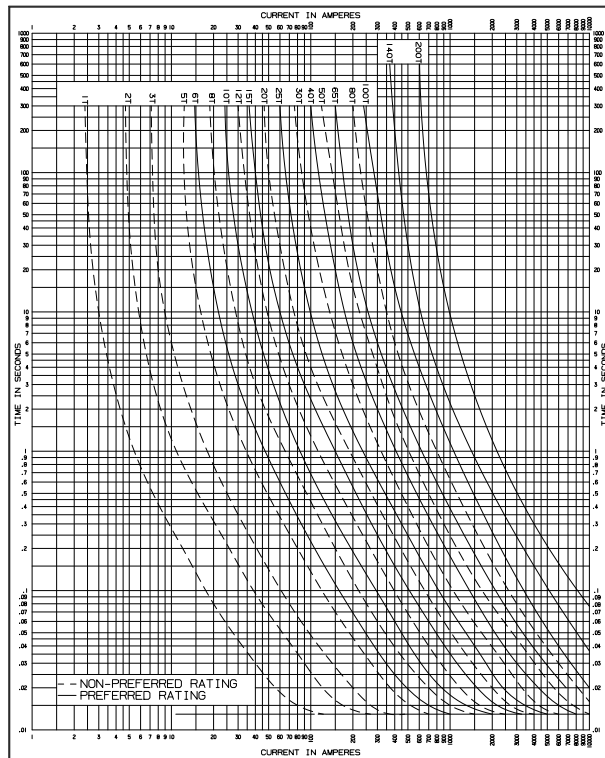

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
EEI-NEMA TYPE T-TIN

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1991 (R1992)

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

Reference Data
R240-91-2
Page 2 of 2

DRAWN BY JFR [CWD]
DATE 7-27-00
REPLACES 04/85 [REV 00] REG. NO. 19892
DWG NO. 42 39635 B 00