


COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

TIME-CURRENT CHARACTERISTIC CURVES
MINIMUM MELT
15 AND 27KV TANDEM
ELF™ DROPOUT FUSES

DRAWN BY ALJ CHK'D JAW
DATE 06/25/10 DATE 10/03/12
REPLACES 4239525B00 REV 00 REQ NO. 25987
DWG NO. R240-91-46

Tests made at LOW Volts ac at HIGH pf at 25°C with no initial load
Standards used as basis for data: ANSI C37.47-1981 (R1992)
MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS
THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

CATALOG NUMBERS:
T4B25**
T4C25**
T9C25**

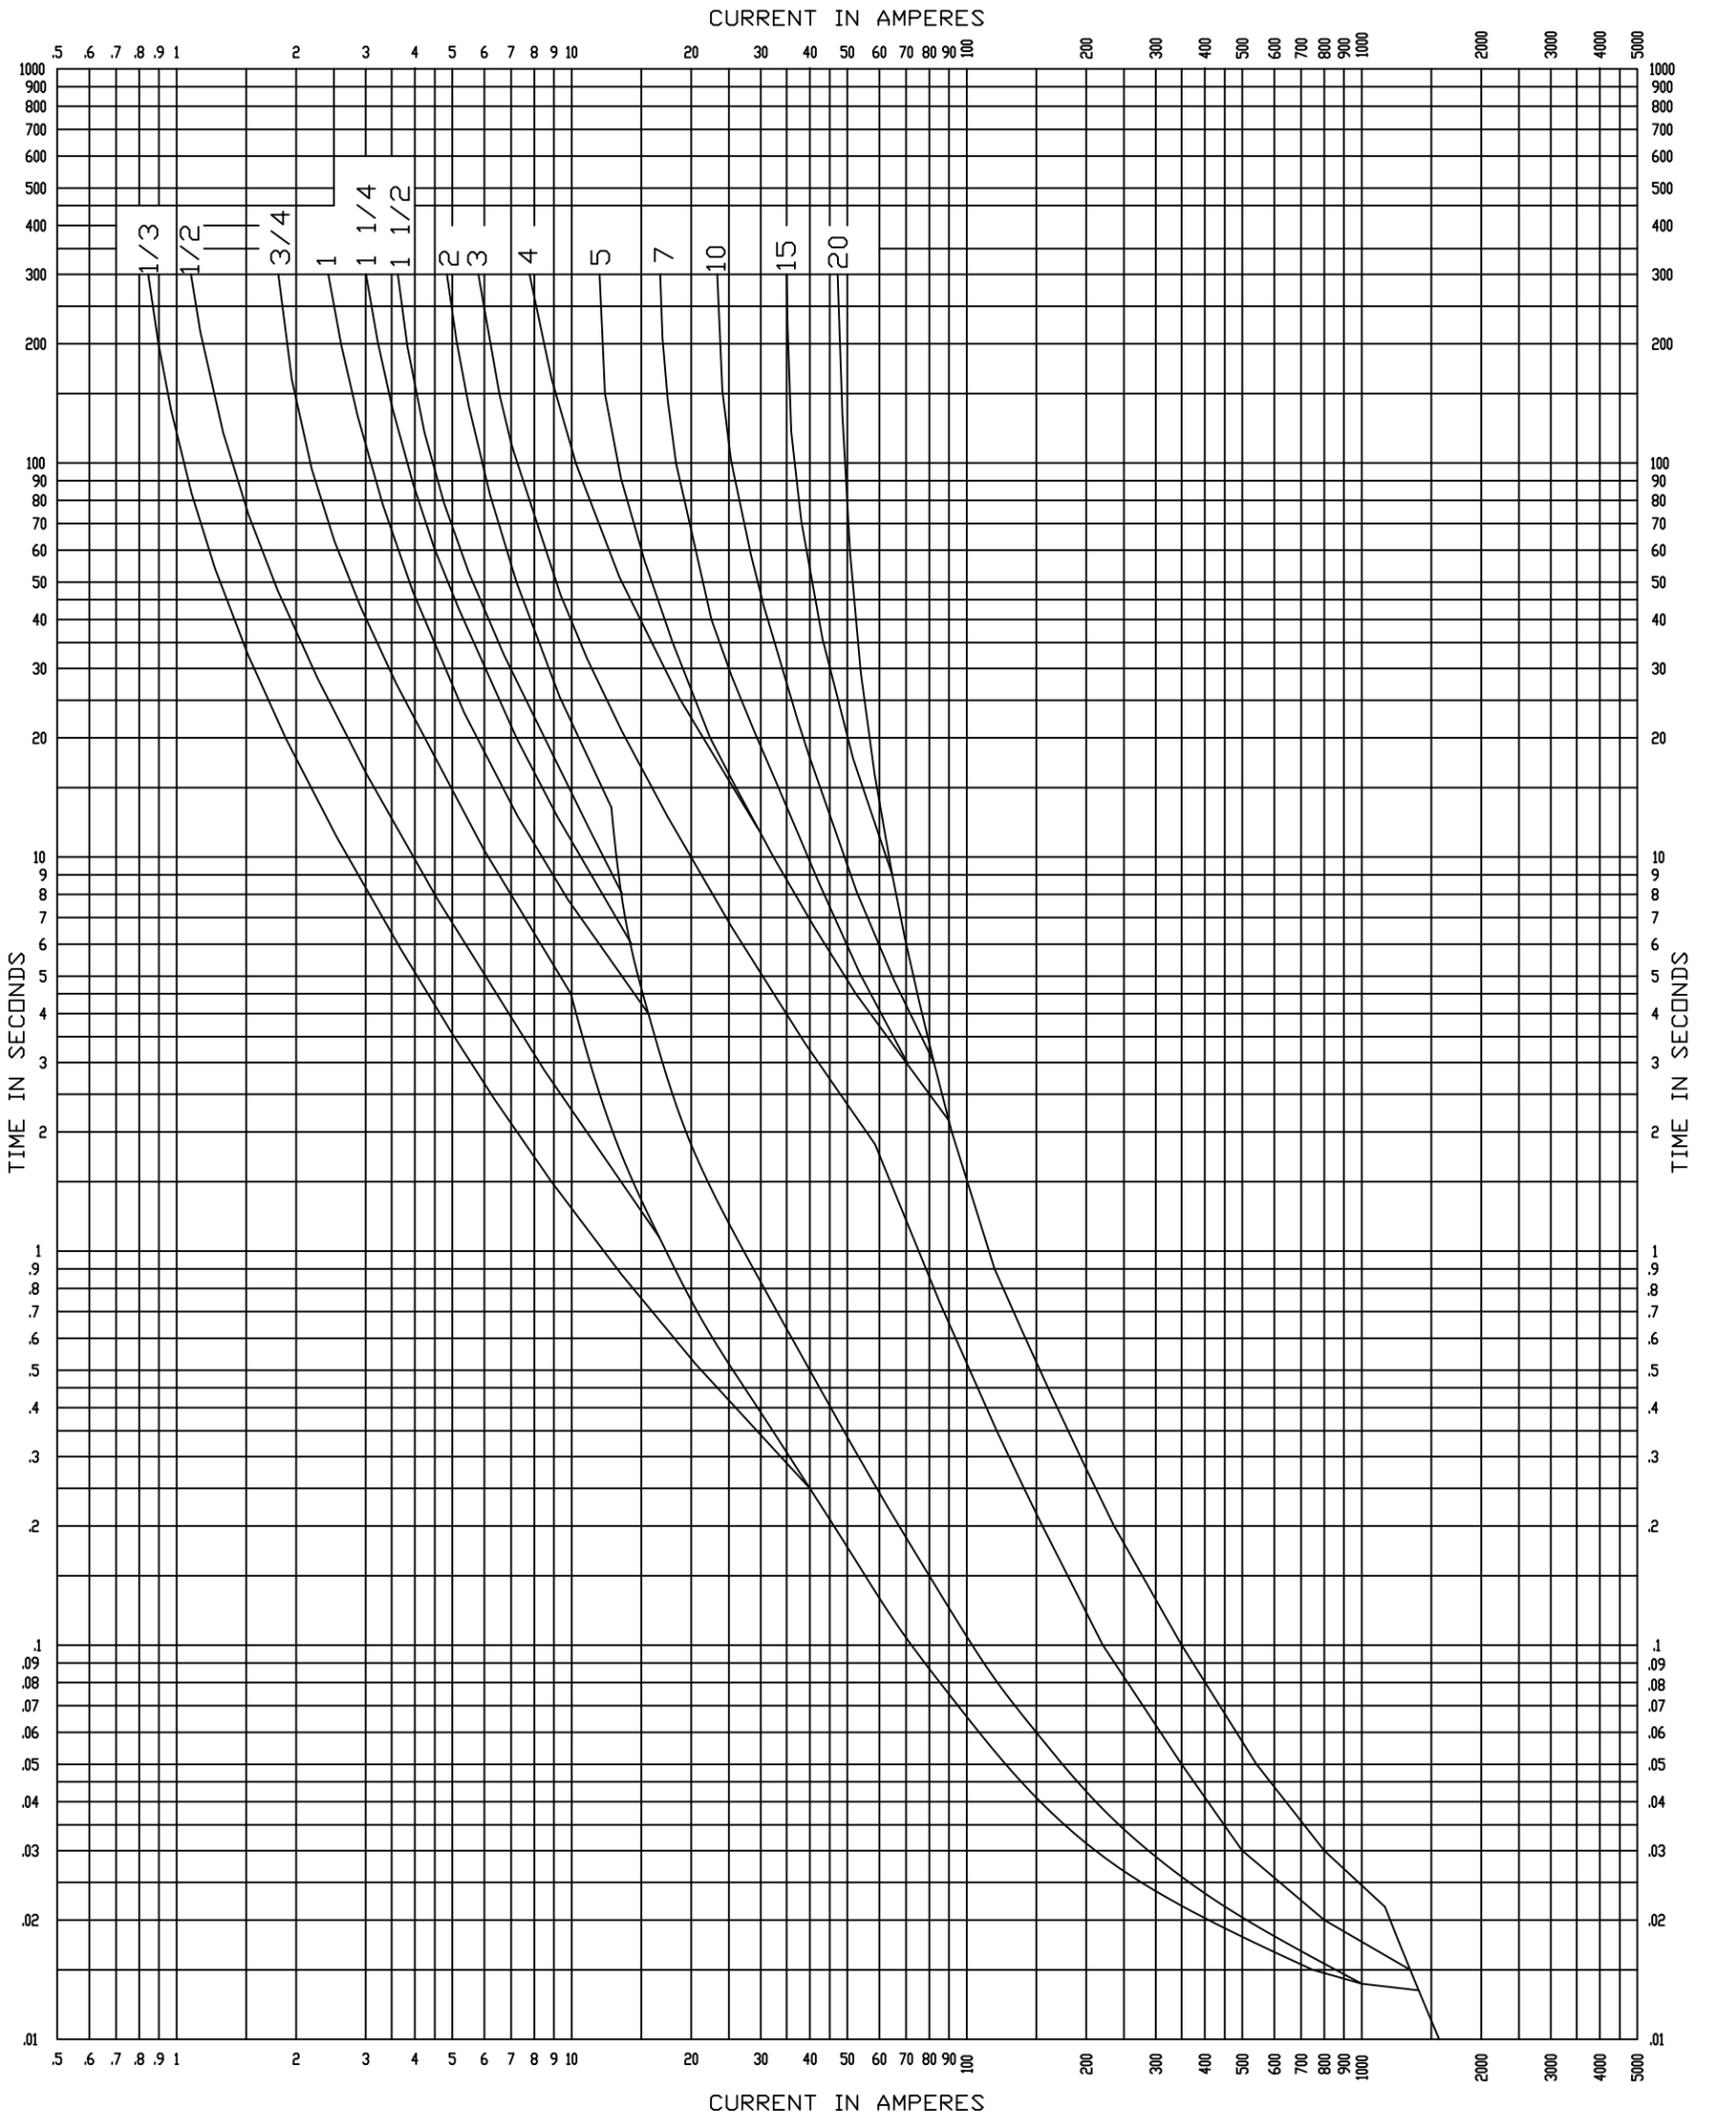

COOPER Power Systems
COMPONENTS AND PROTECTIVE EQUIPMENT

DRAWN BY ALJ CHK'D JAW
DATE 06/25/10 DATE 10/03/12
REPLACES 4239525B00 REV 00 REQ NO. 25987
DWG NO. R240-91-46

TIME-CURRENT CHARACTERISTIC CURVES

MAXIMUM CLEAR
15 AND 27KV TANDEM
ELF™ DROPOUT FUSES

Tests made at RATED Volts ac at LOW pf at 25°C with no initial load

Standards used as basis for data: ANSI C37.47-1981 (R1992)

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS

THIS DRAWING WAS PRODUCED ON A CAD SYSTEM, ANY MANUAL REVISION WILL VOID IT.

CATALOG NUMBERS:

- T4B25**
- T4C25**
- T9C25**