

MINIMUM MELT TIME CURRENT CHARACTERISTIC CURVES

38KV BAY-O-NET FUSE LINKS IN TRANSFORMER OIL

TESTS MADE AT LOW VOLTS AC AT HIGH PF AT 25°C WITH NO INITIAL LOAD

MINIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE PLUS




DRAWN BY	VDV	DWG DATE	02/18/15
REQ	28957	REV DATE	
APPROVAL	JRB 02/19/15		

© 2015 EATON

DOC NO. TC132001EN

REV 00

CAT NO. 4000380CXXCB

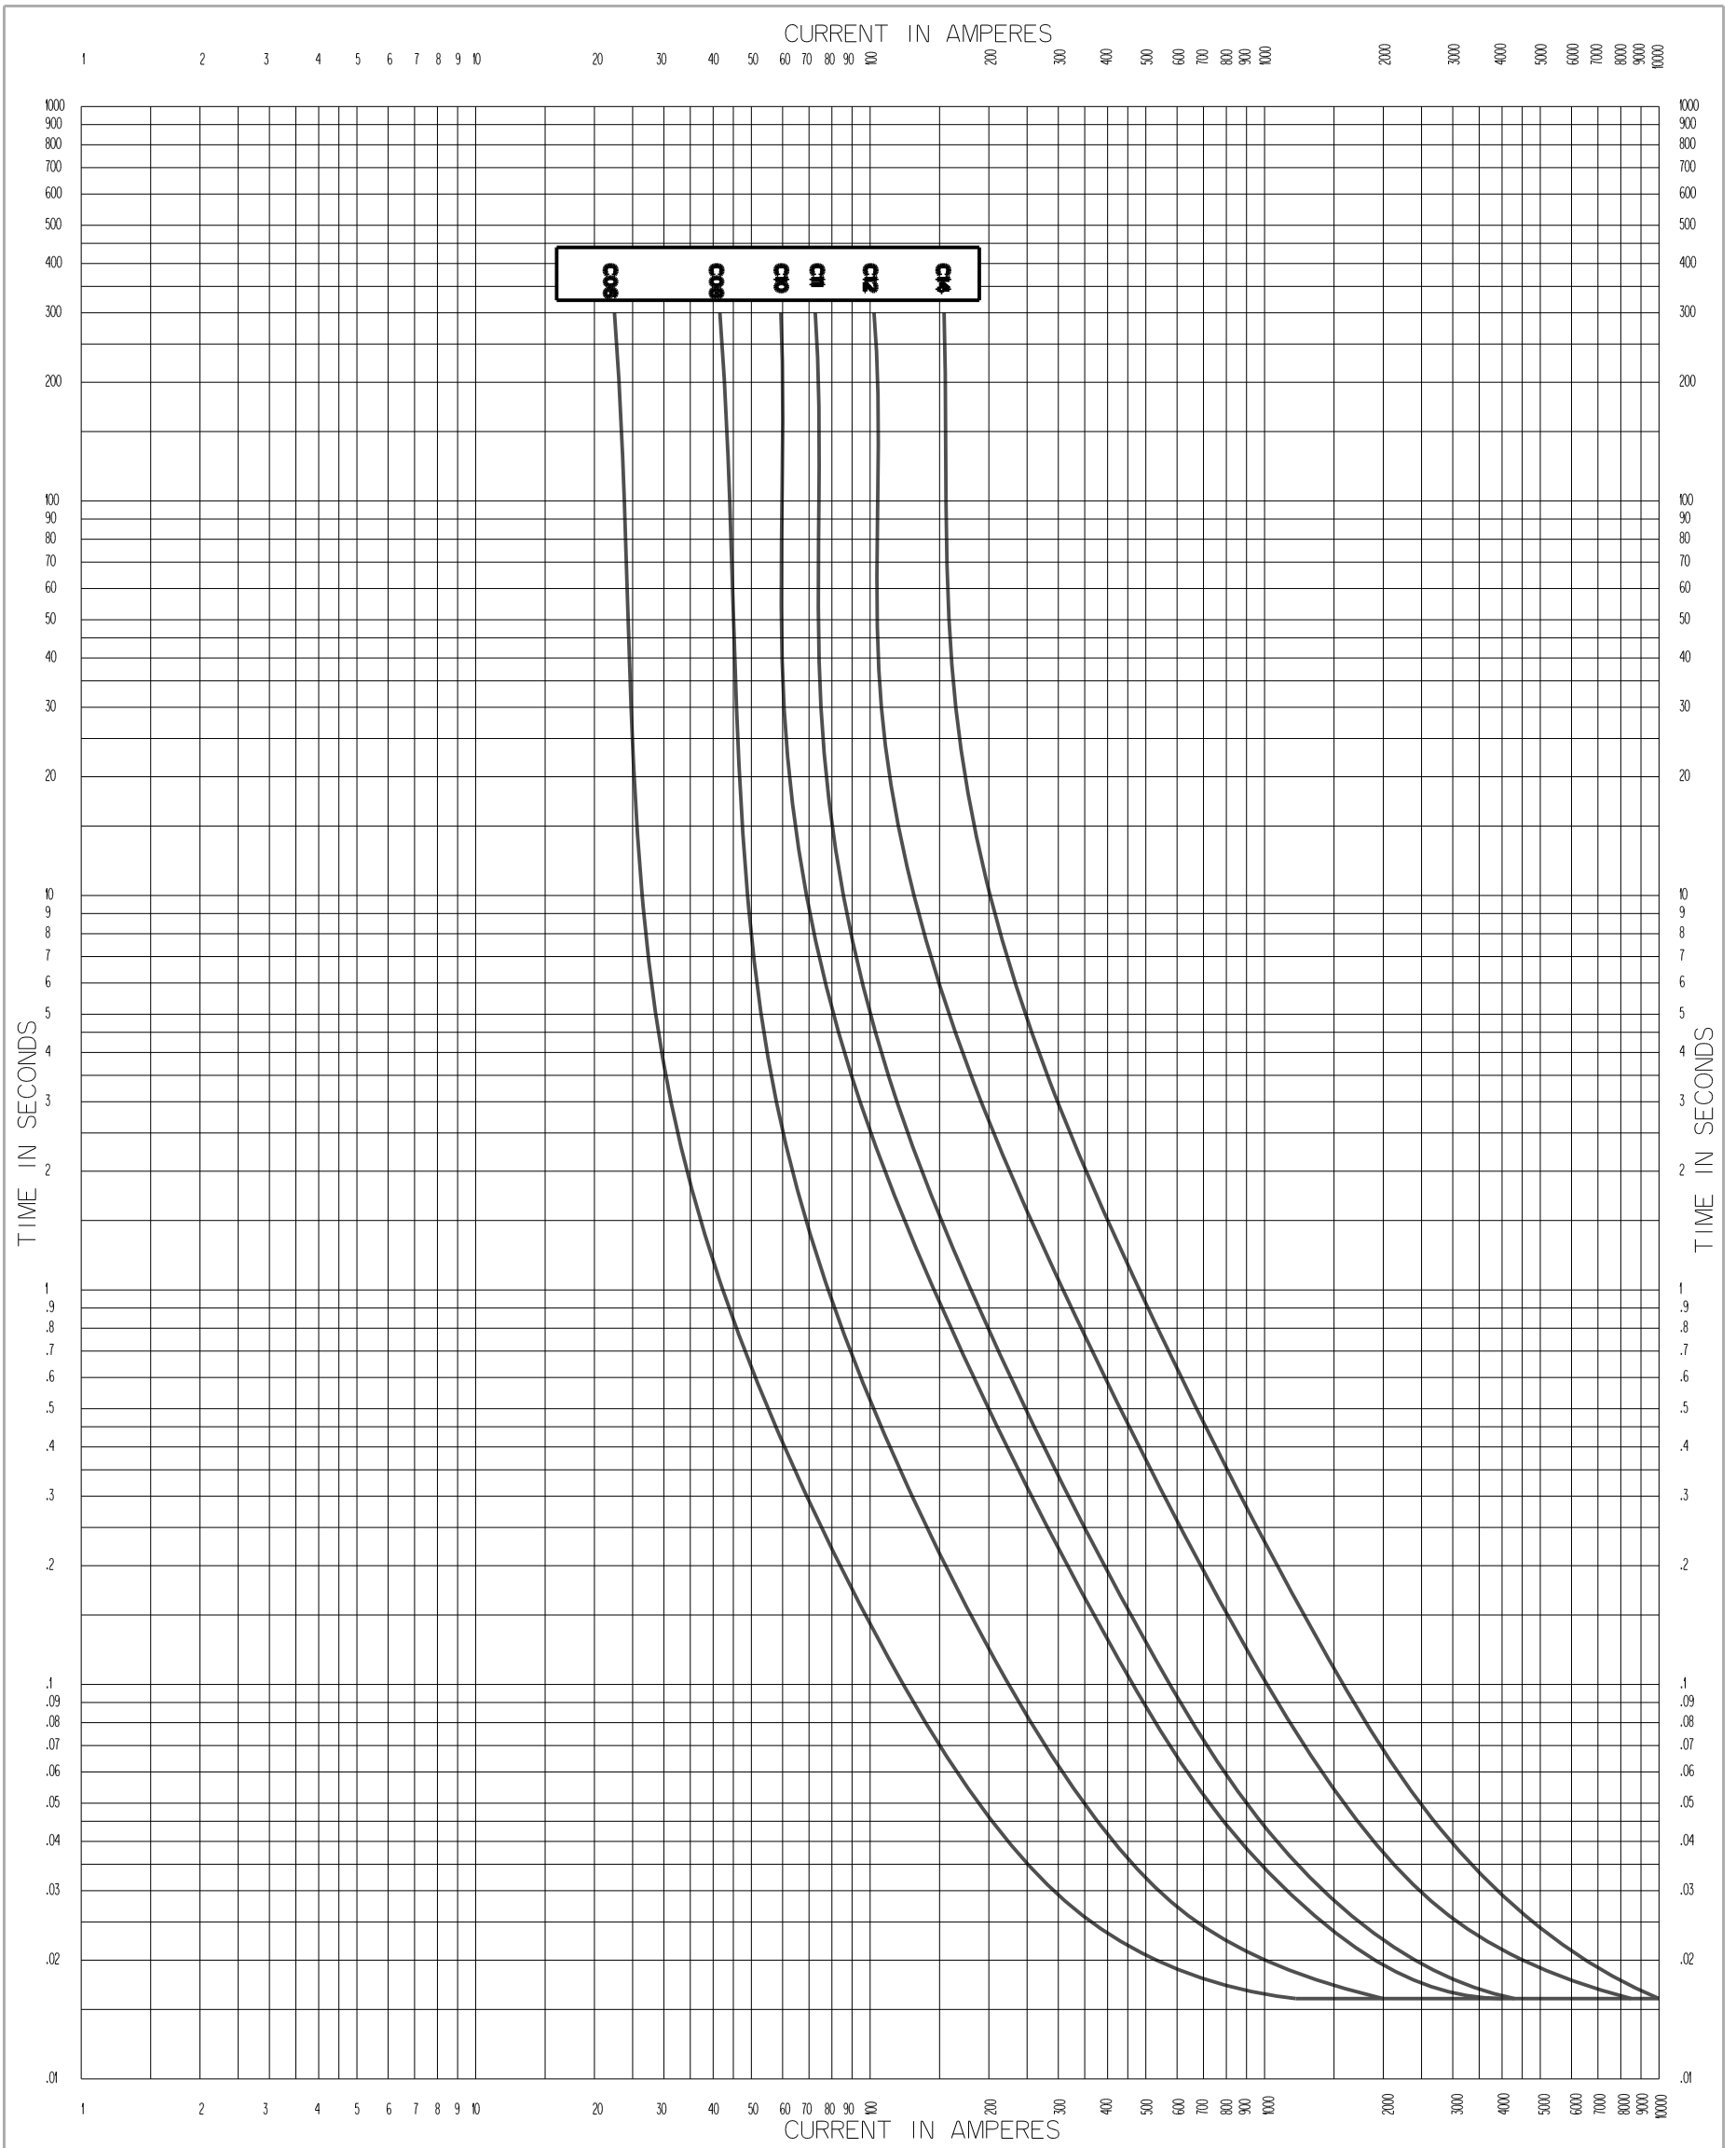

MAXIMUM CLEAR TIME CURRENT CHARACTERISTIC CURVES

38KV BAY-O-NET FUSE LINKS IN TRANSFORMER OIL

TESTS MADE AT RATED VOLTS AC AT LOW PF AT 25°C WITH NO INITIAL LOAD

MAXIMUM TEST POINTS PLOTTED SO VARIATIONS SHOULD BE MINUS



DRAWN BY	VDV	DWG DATE	02/18/15
REQ	28957	REV DATE	
APPROVAL	JRB 02/19/15		
DOC NO.	TC132001EN		REV 00

© 2015 EATON

CAT NO. 4000380CXXCB