


# Type E (serial 52000 and above) time-current curves


## Contents


Description	Page
5-AMP coil recloser clearing time . . . . .	2
10-AMP coil recloser clearing time . . . . .	3
15-AMP coil recloser clearing time . . . . .	4
25-AMP coil recloser clearing time . . . . .	5
35-AMP coil recloser clearing time . . . . .	6
50-AMP coil recloser clearing time . . . . .	7
70-AMP coil recloser clearing time . . . . .	8
100-AMP coil recloser clearing time . . . . .	9





*Powering Business Worldwide*

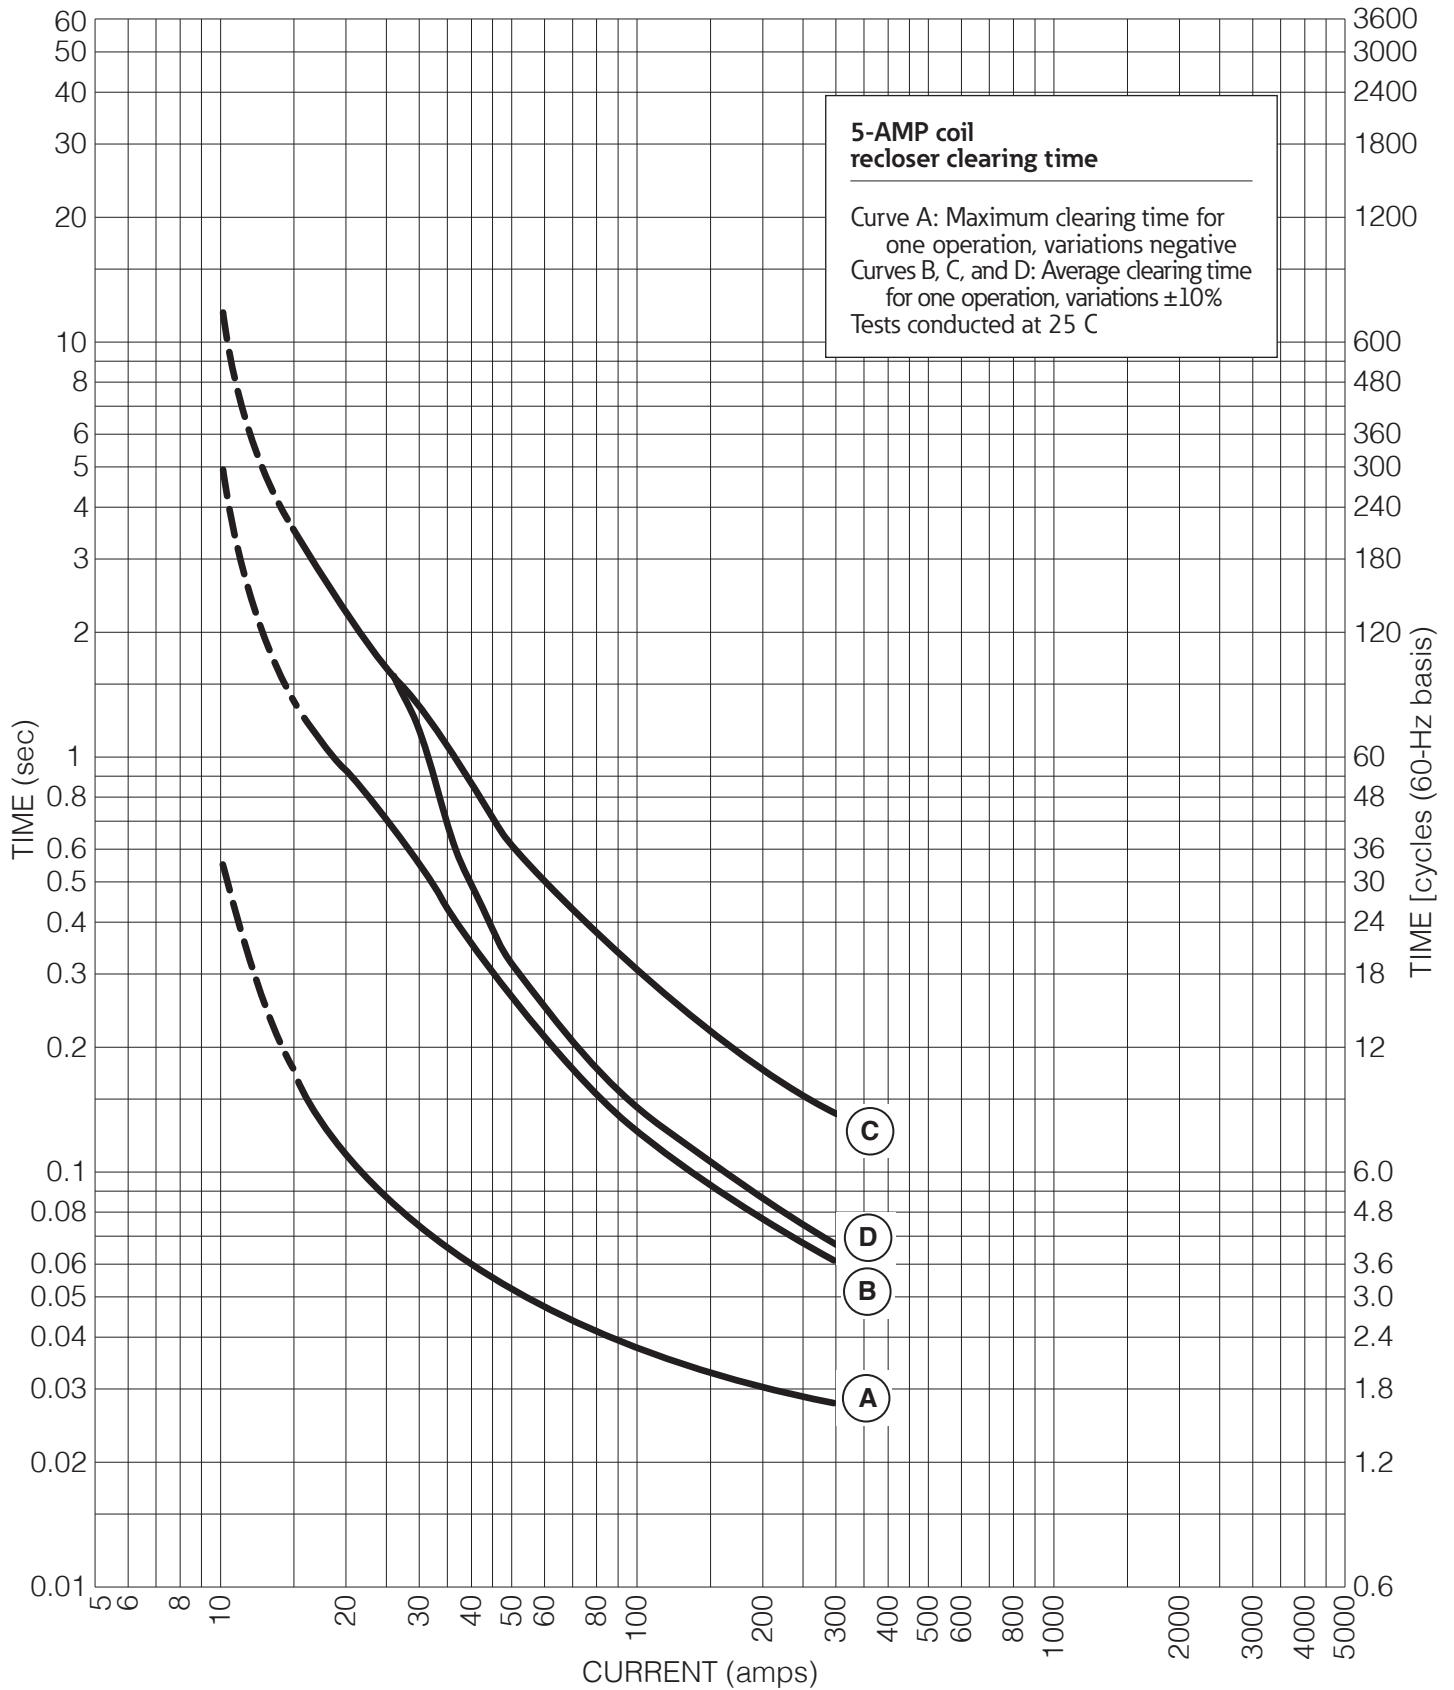


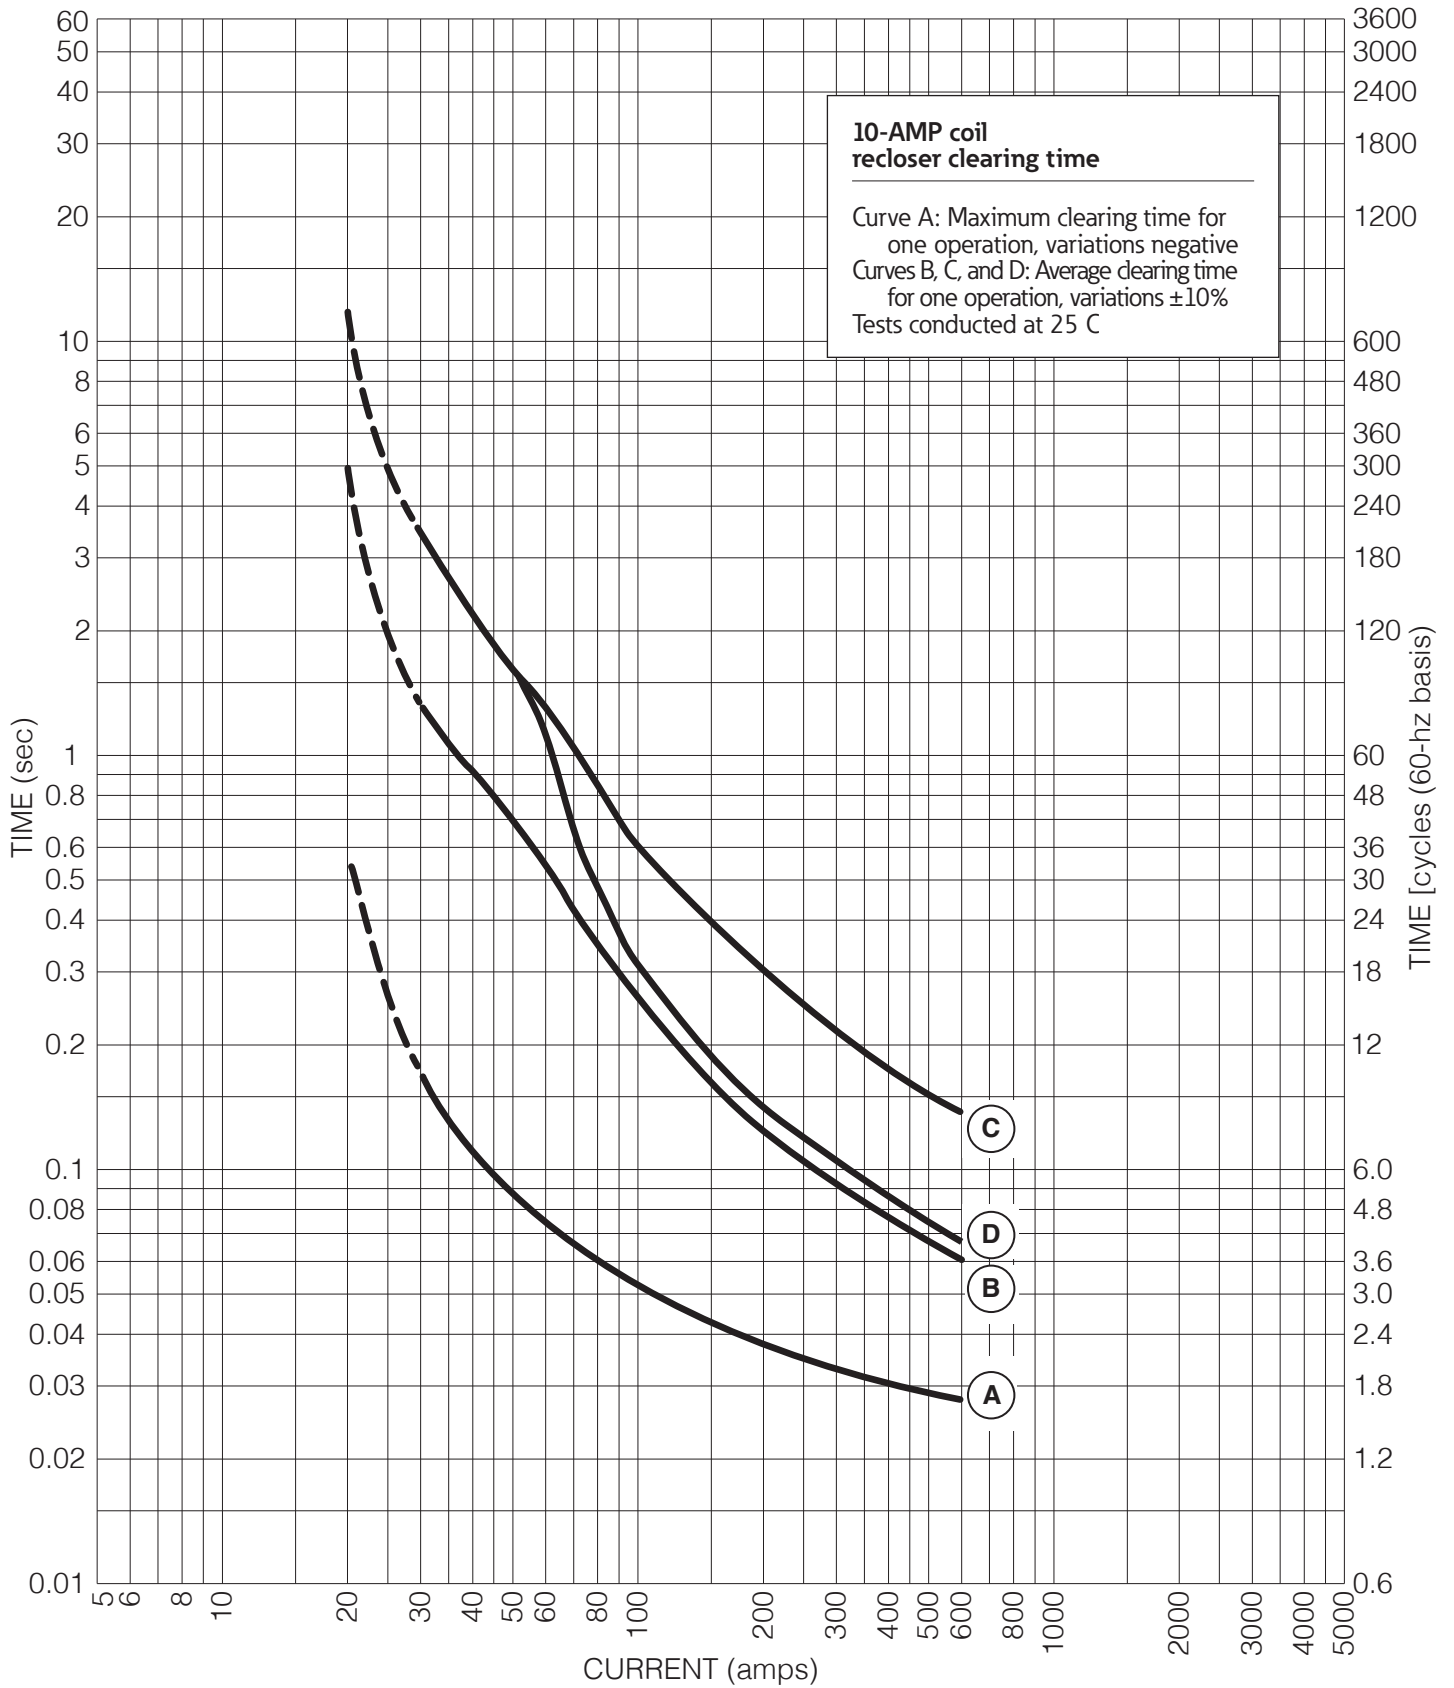


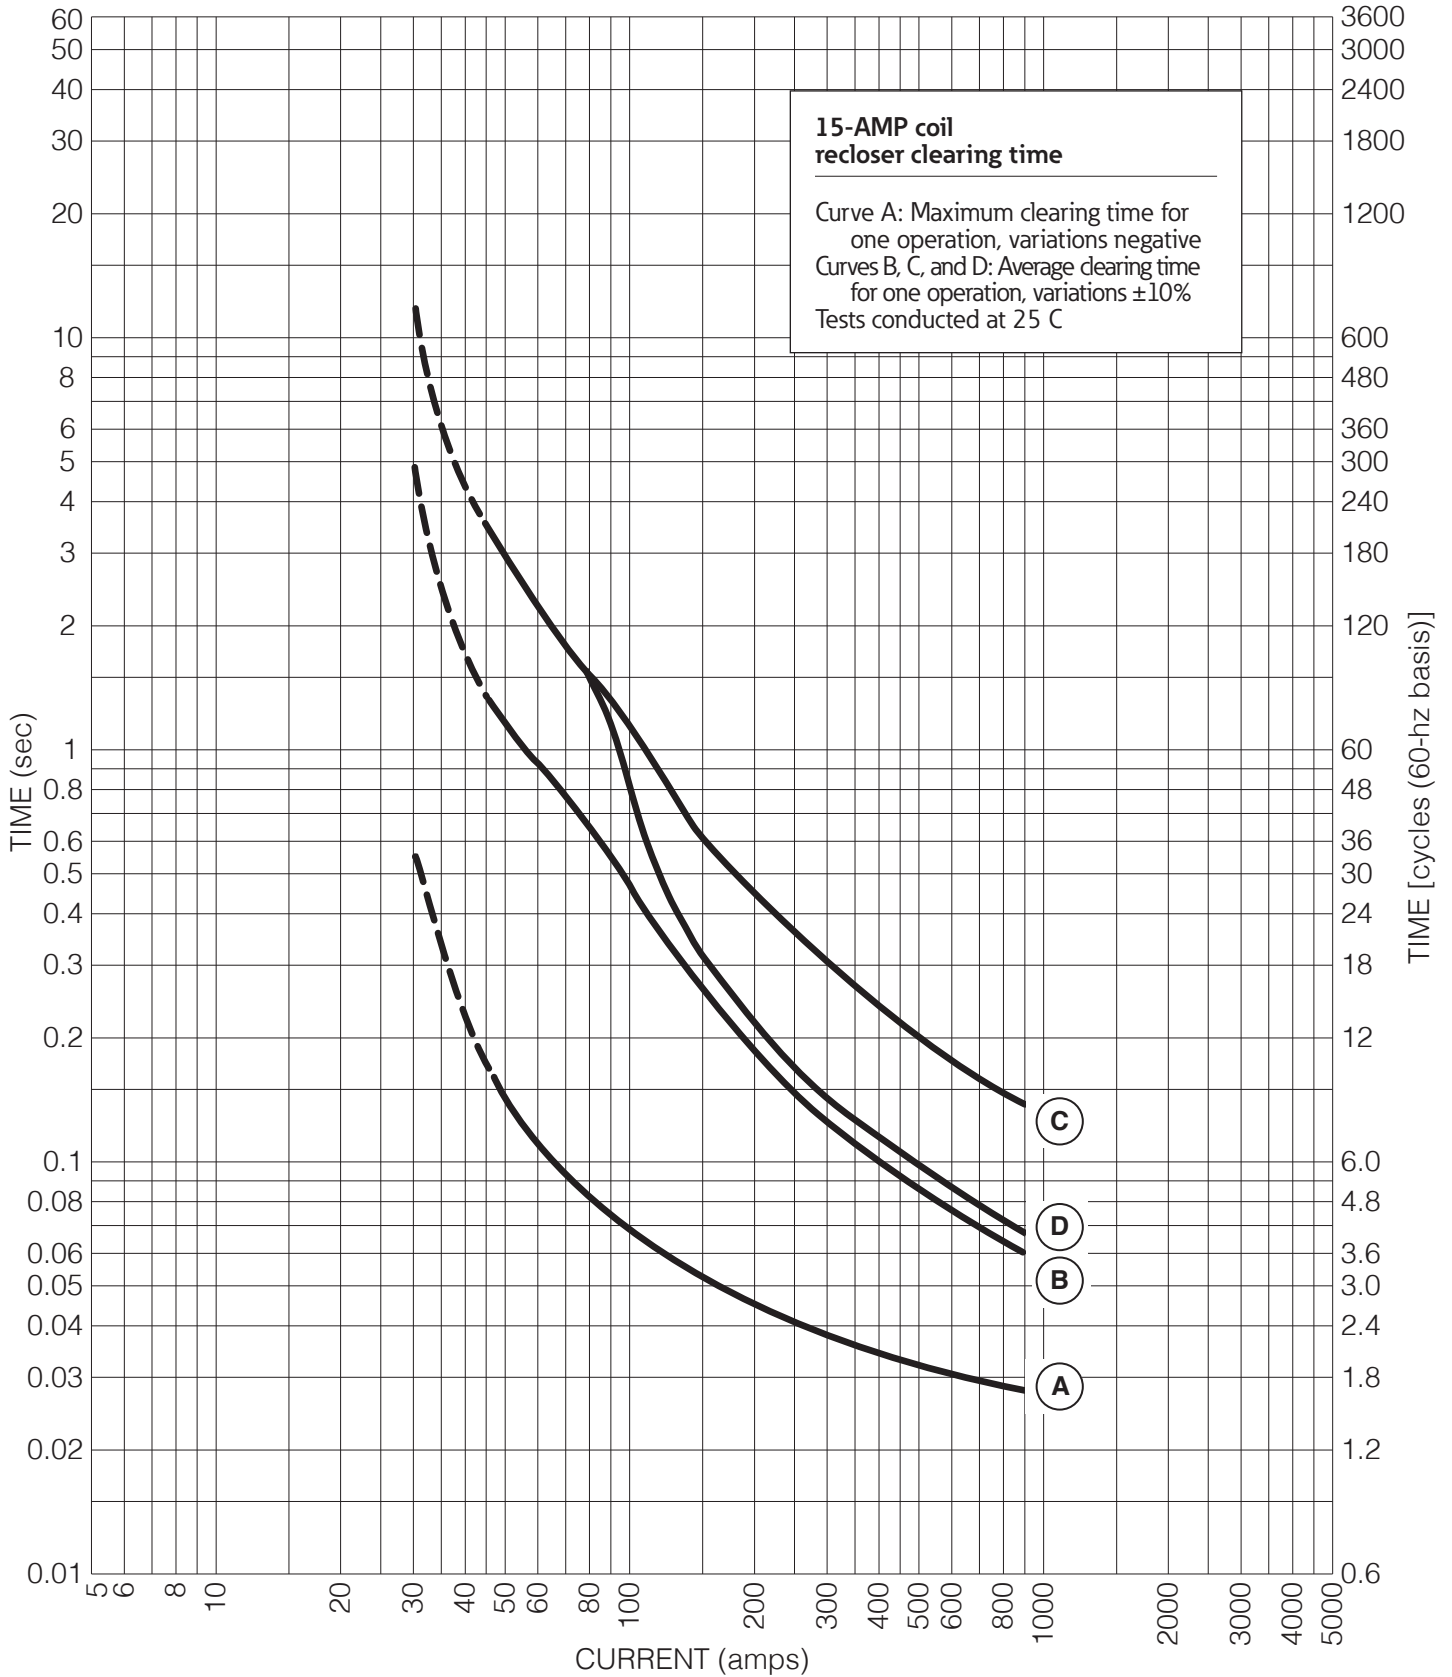

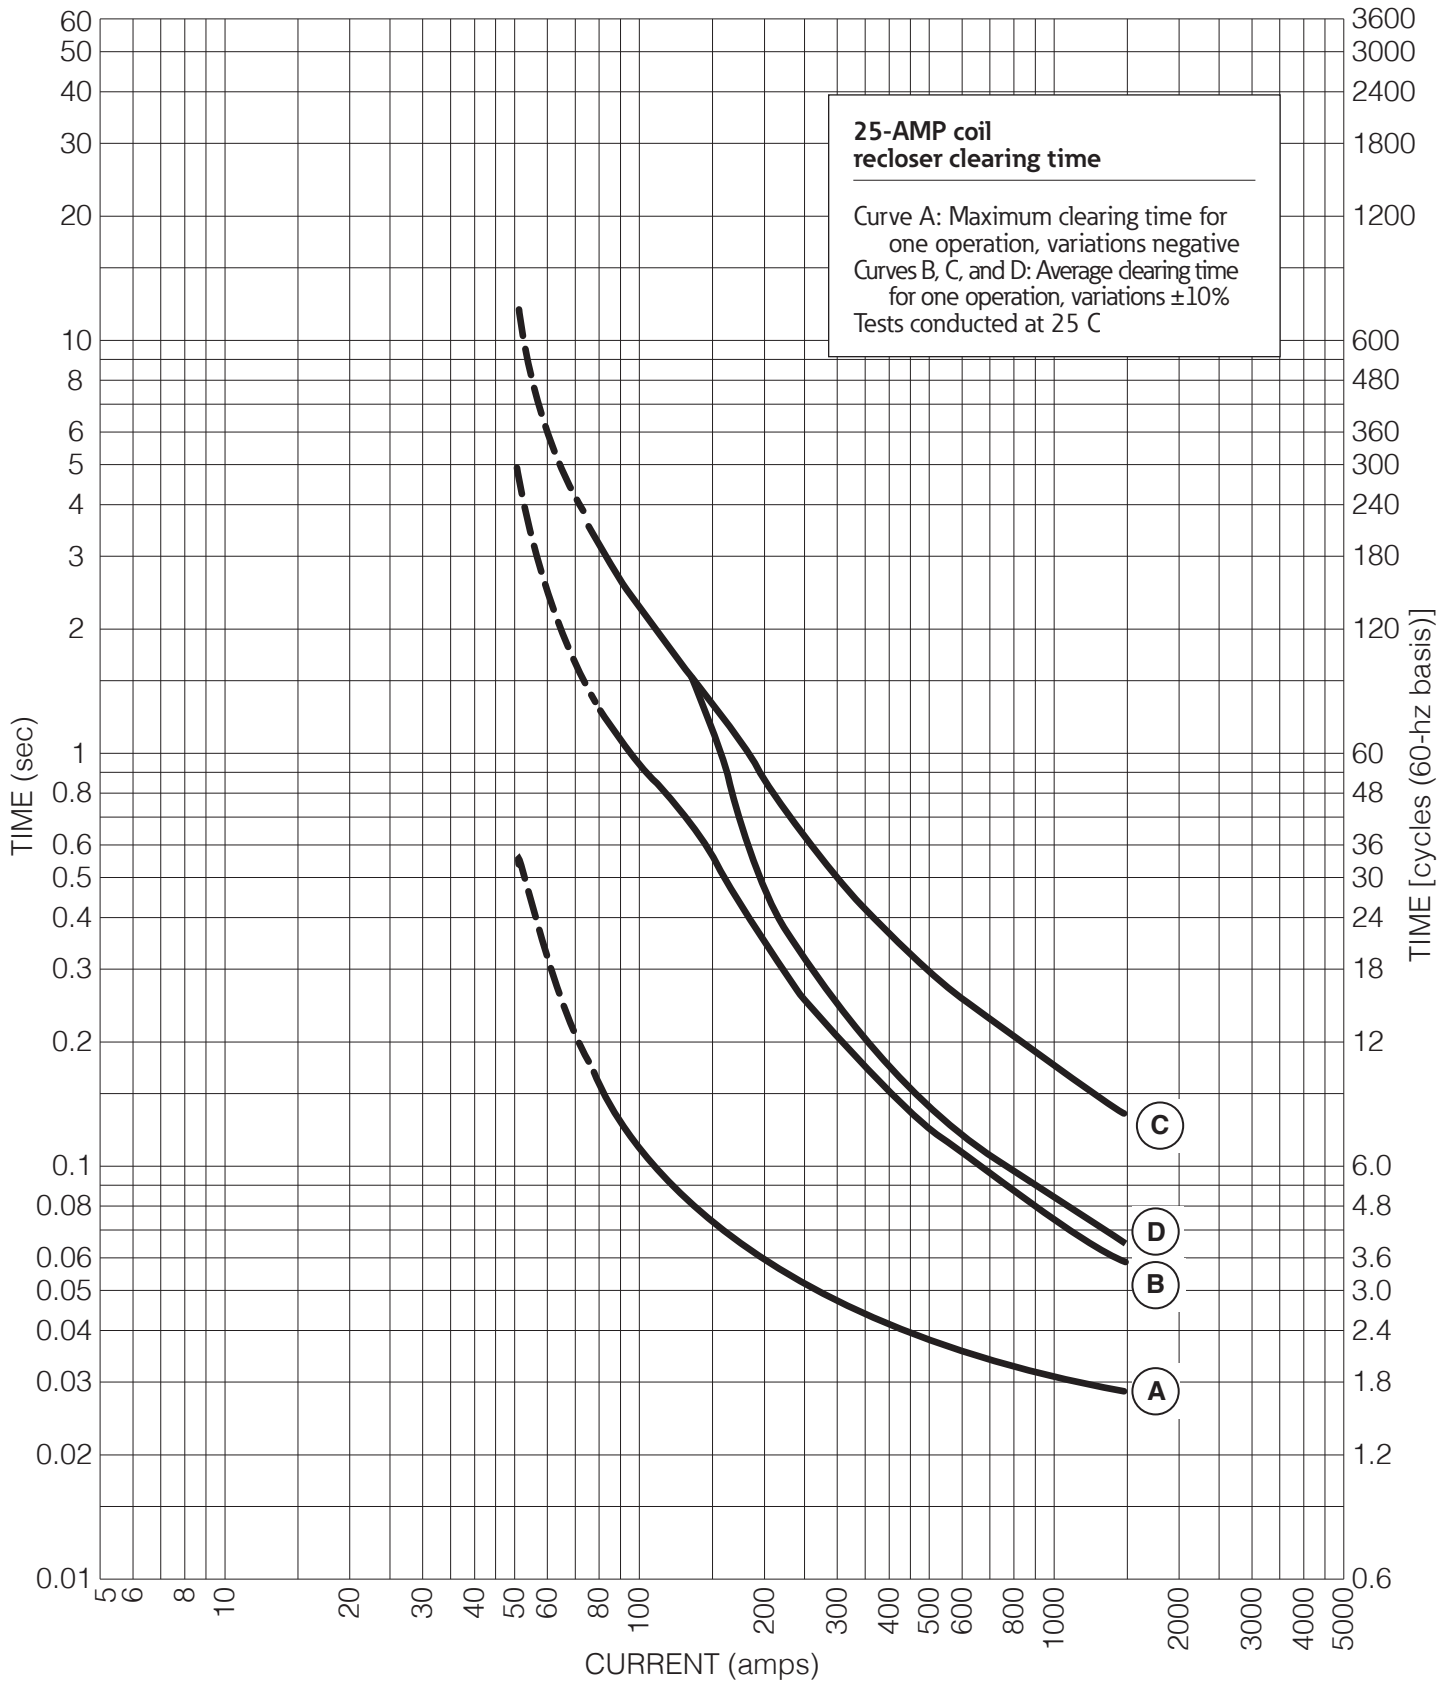


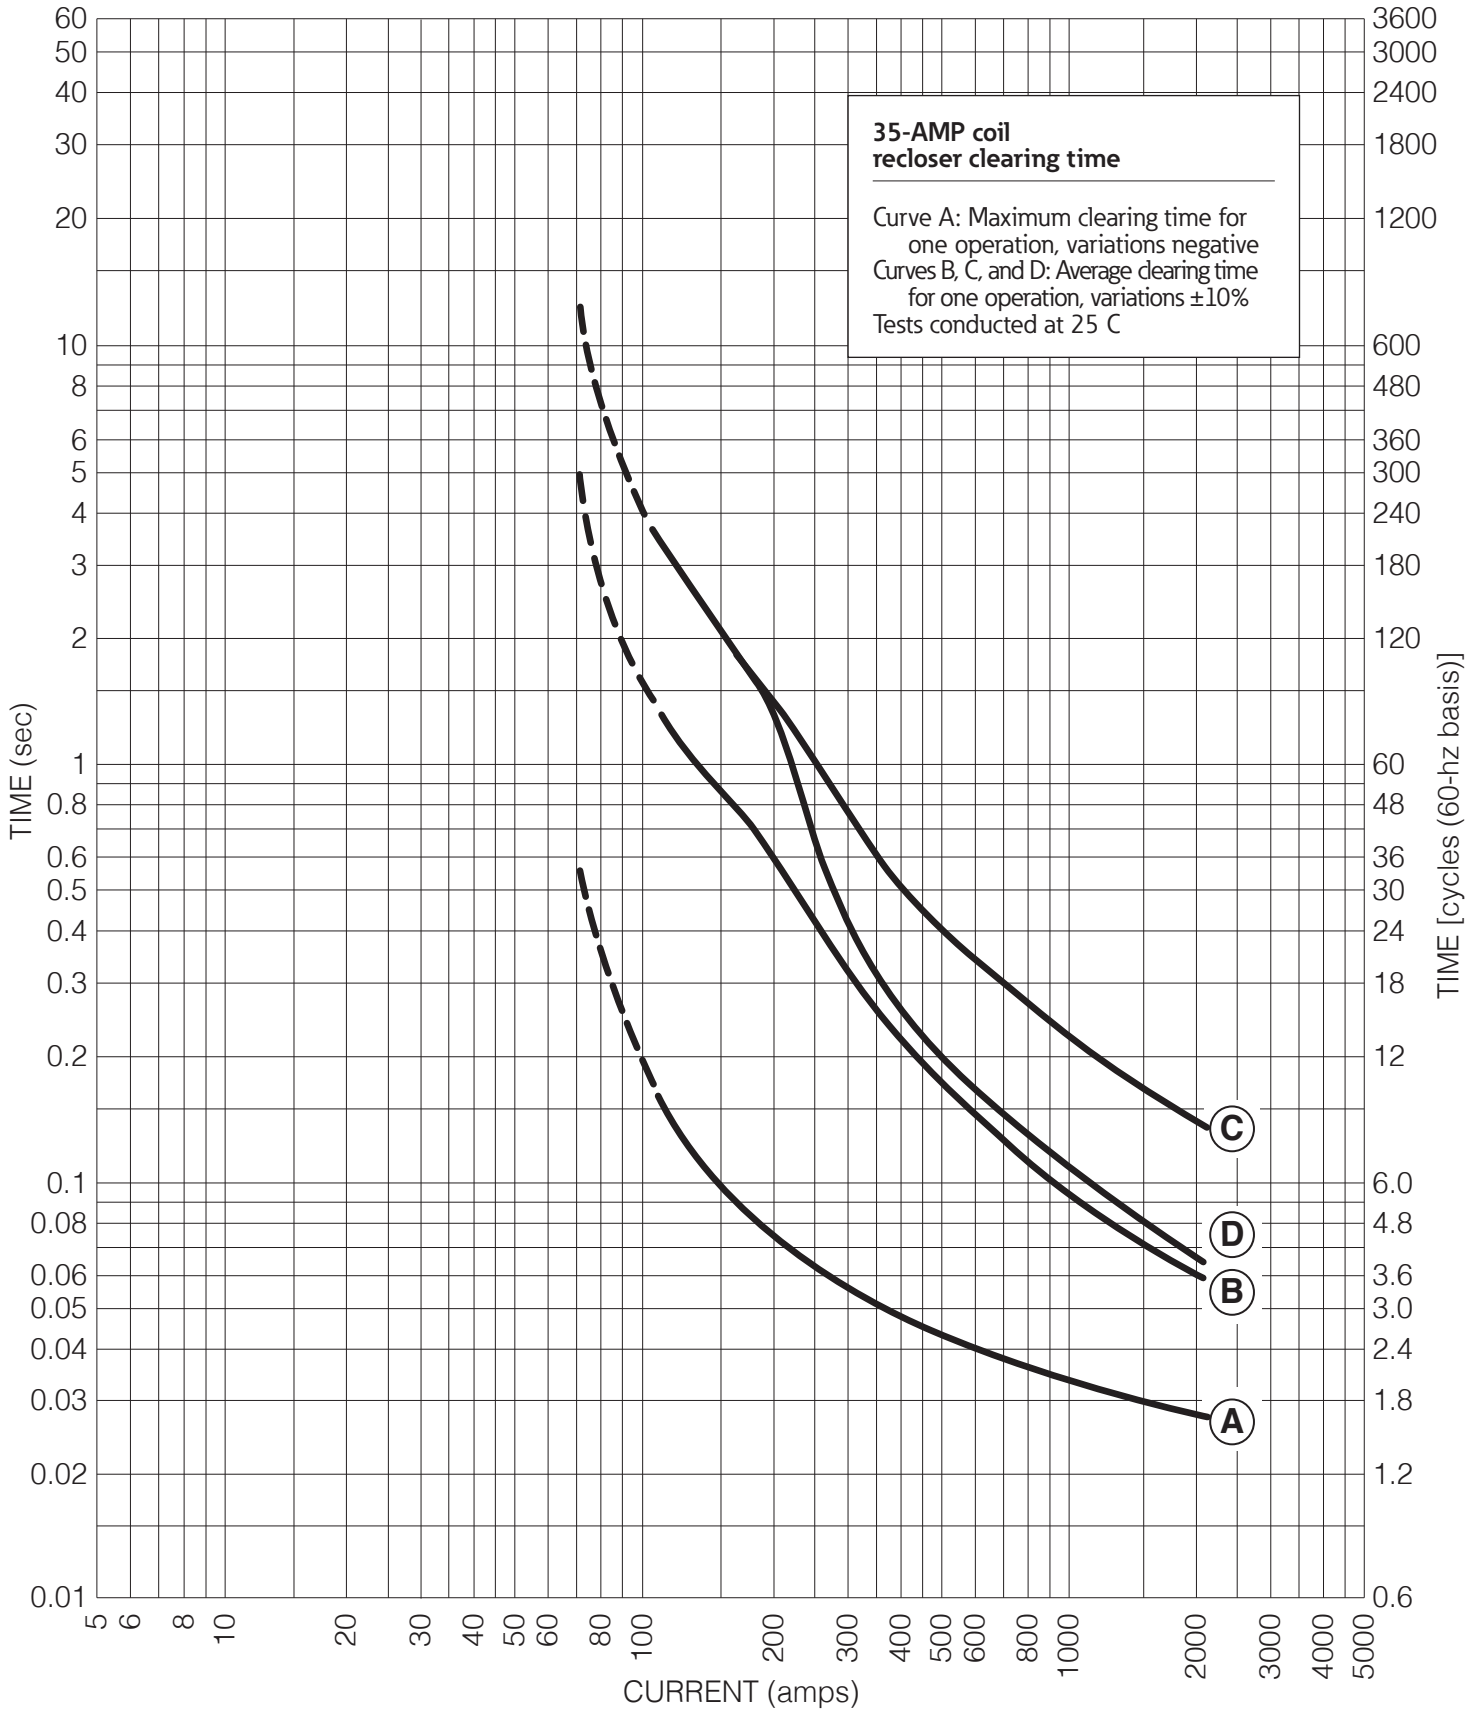

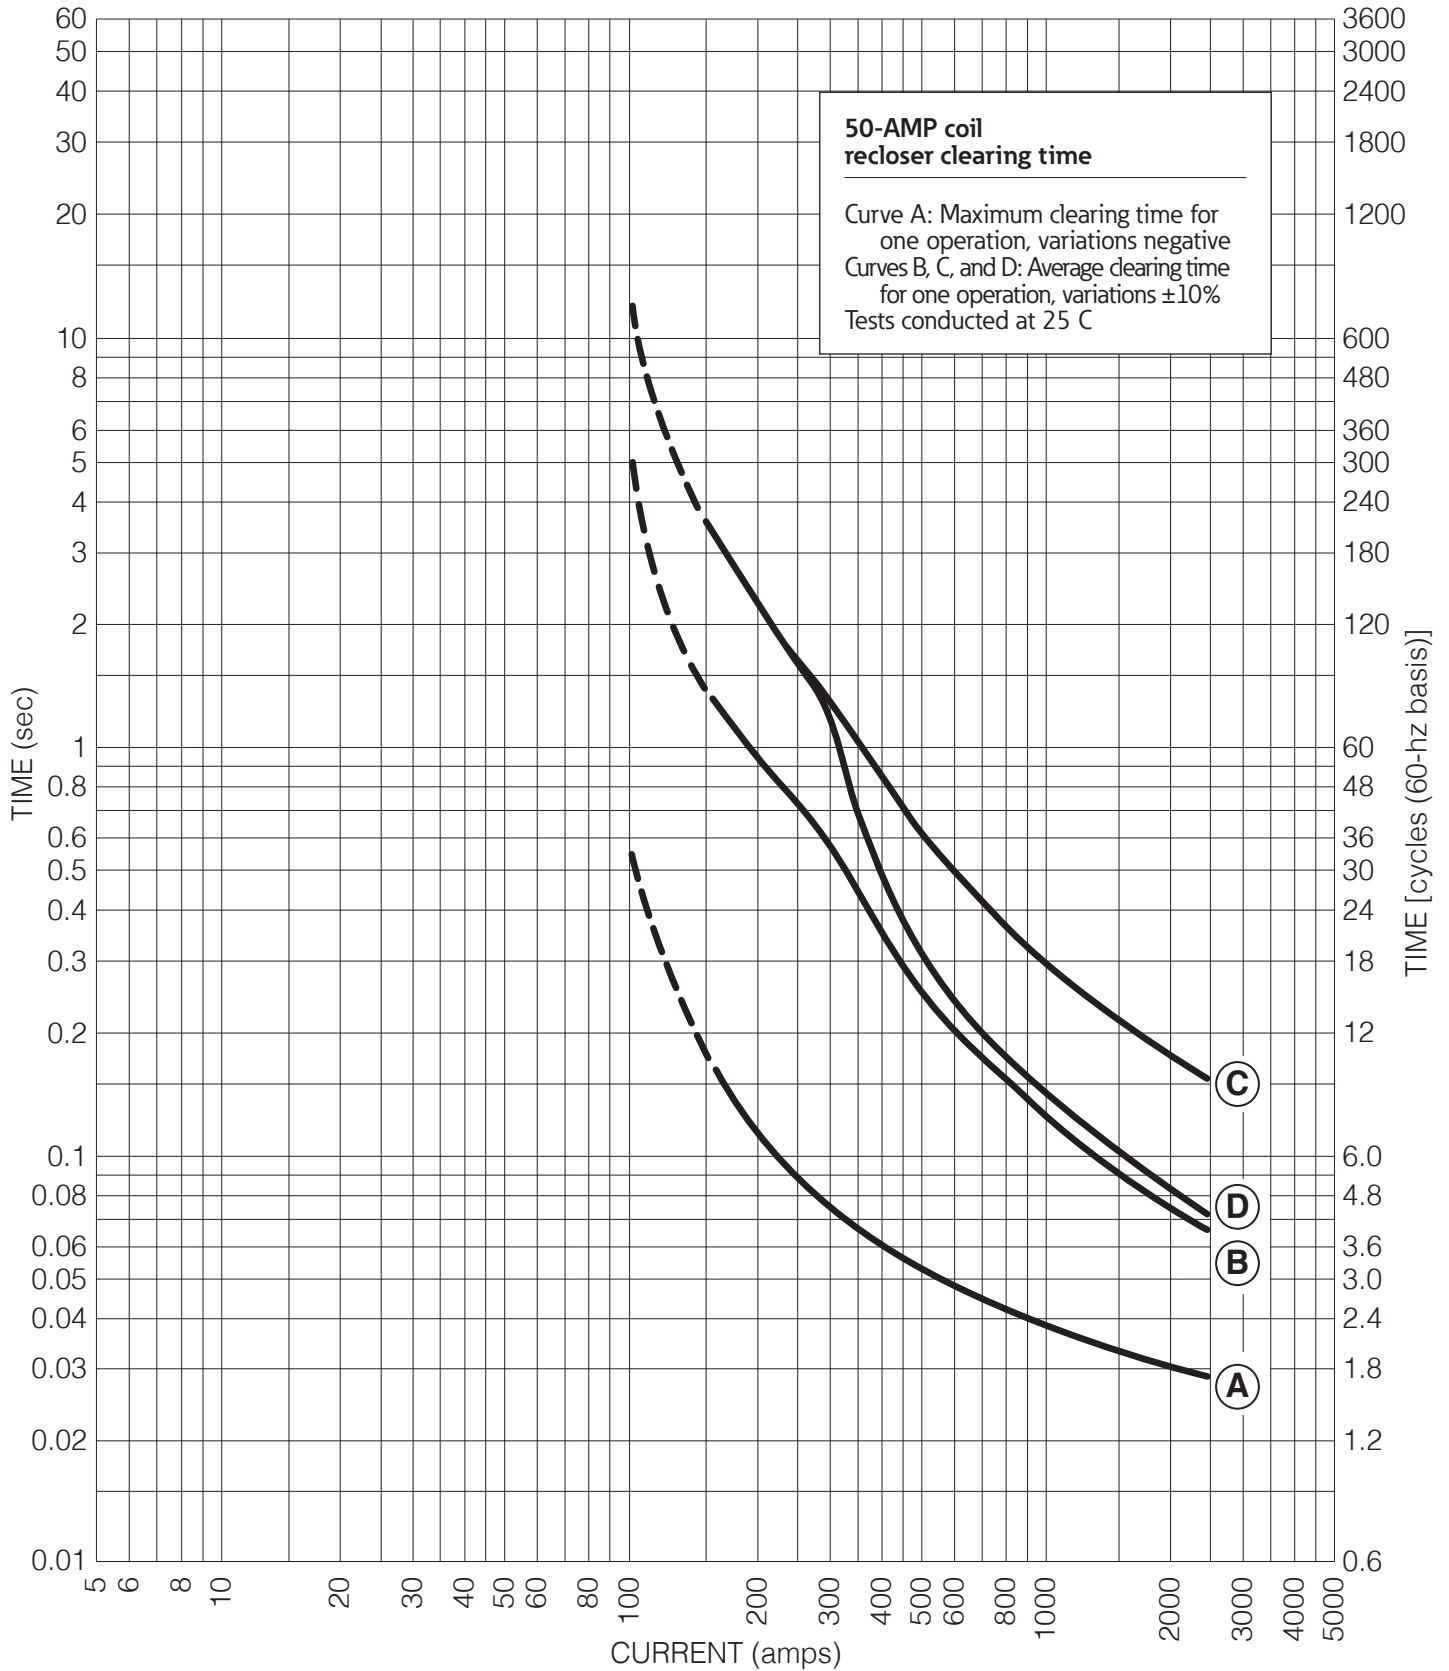

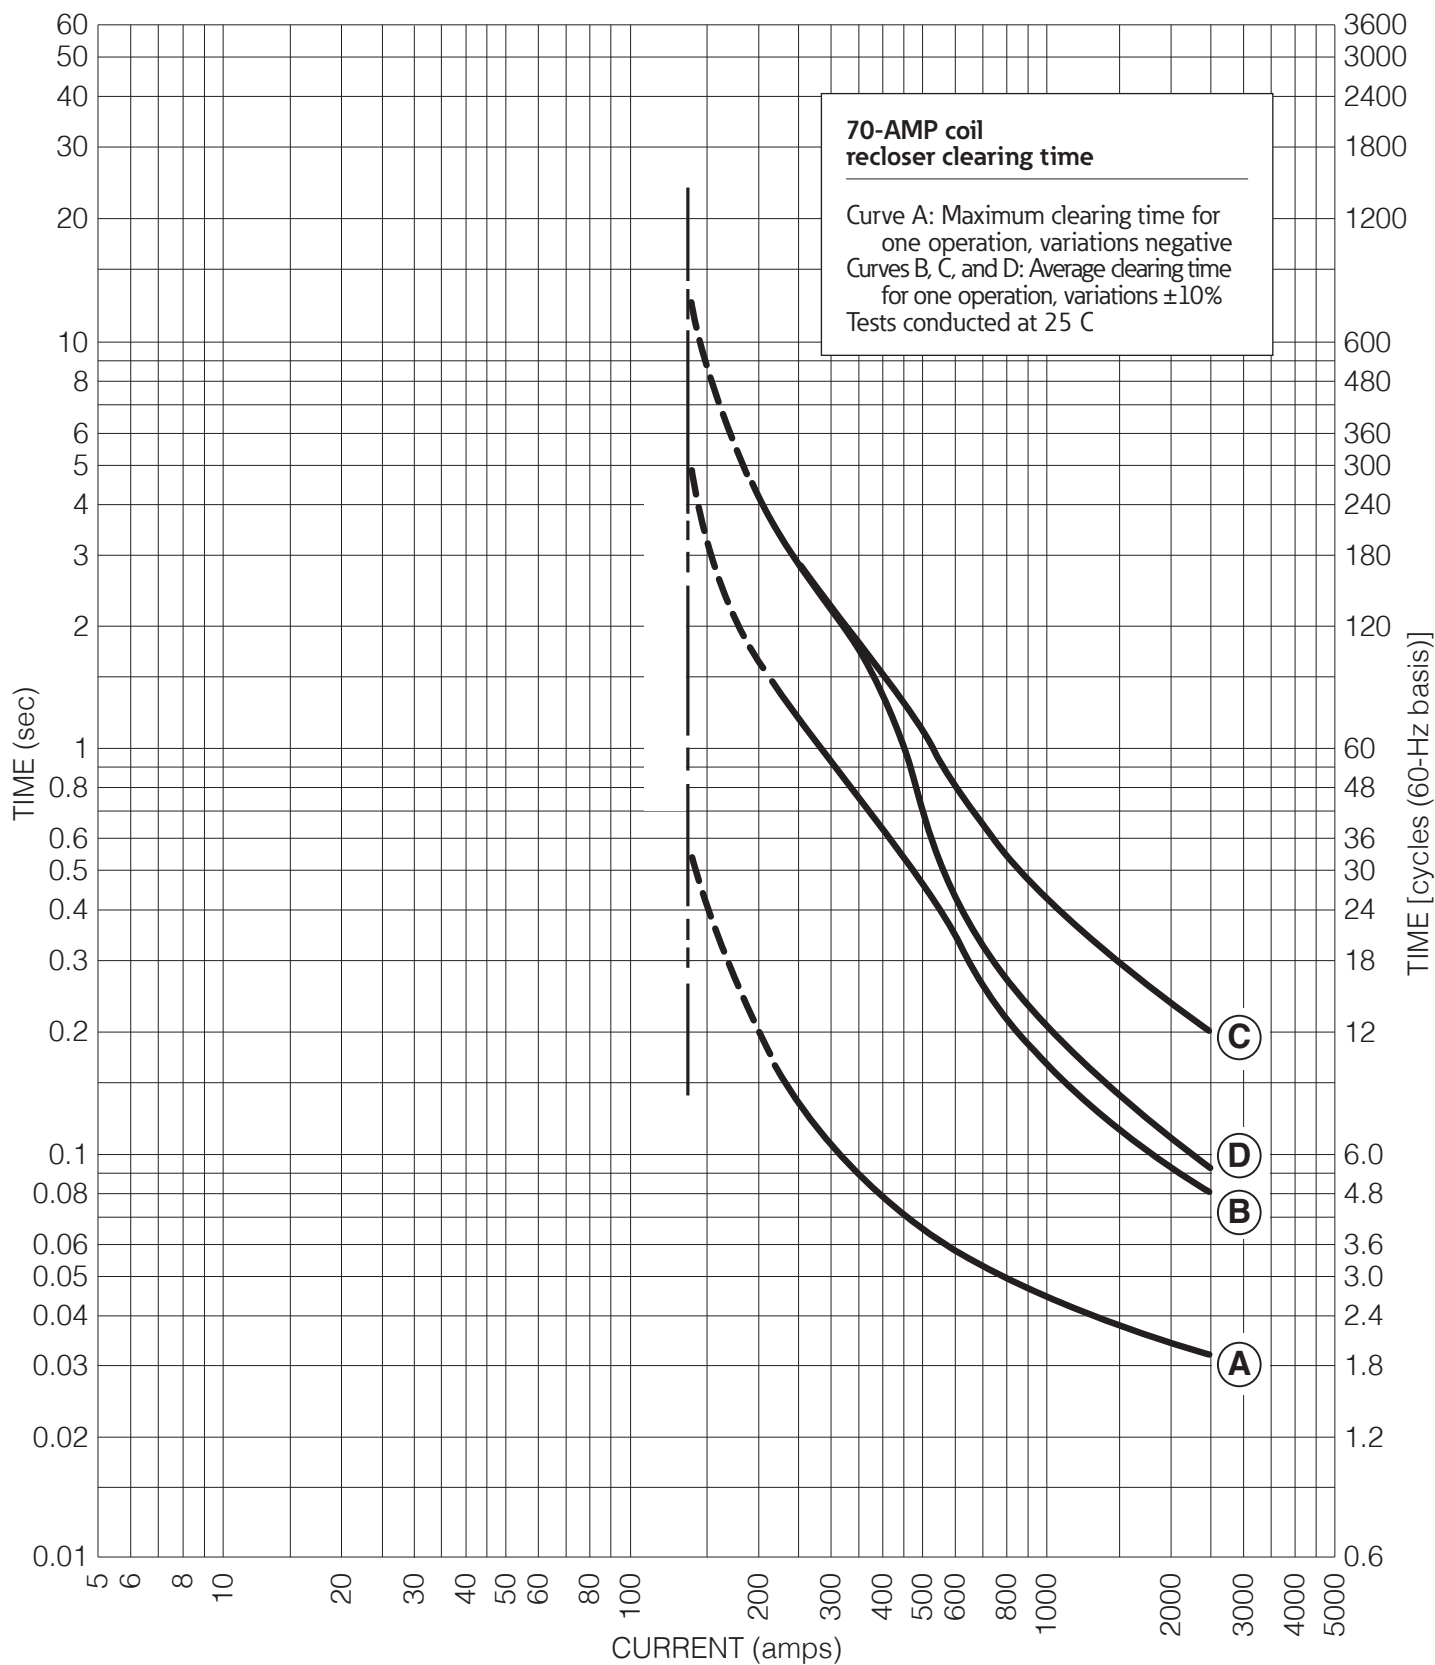



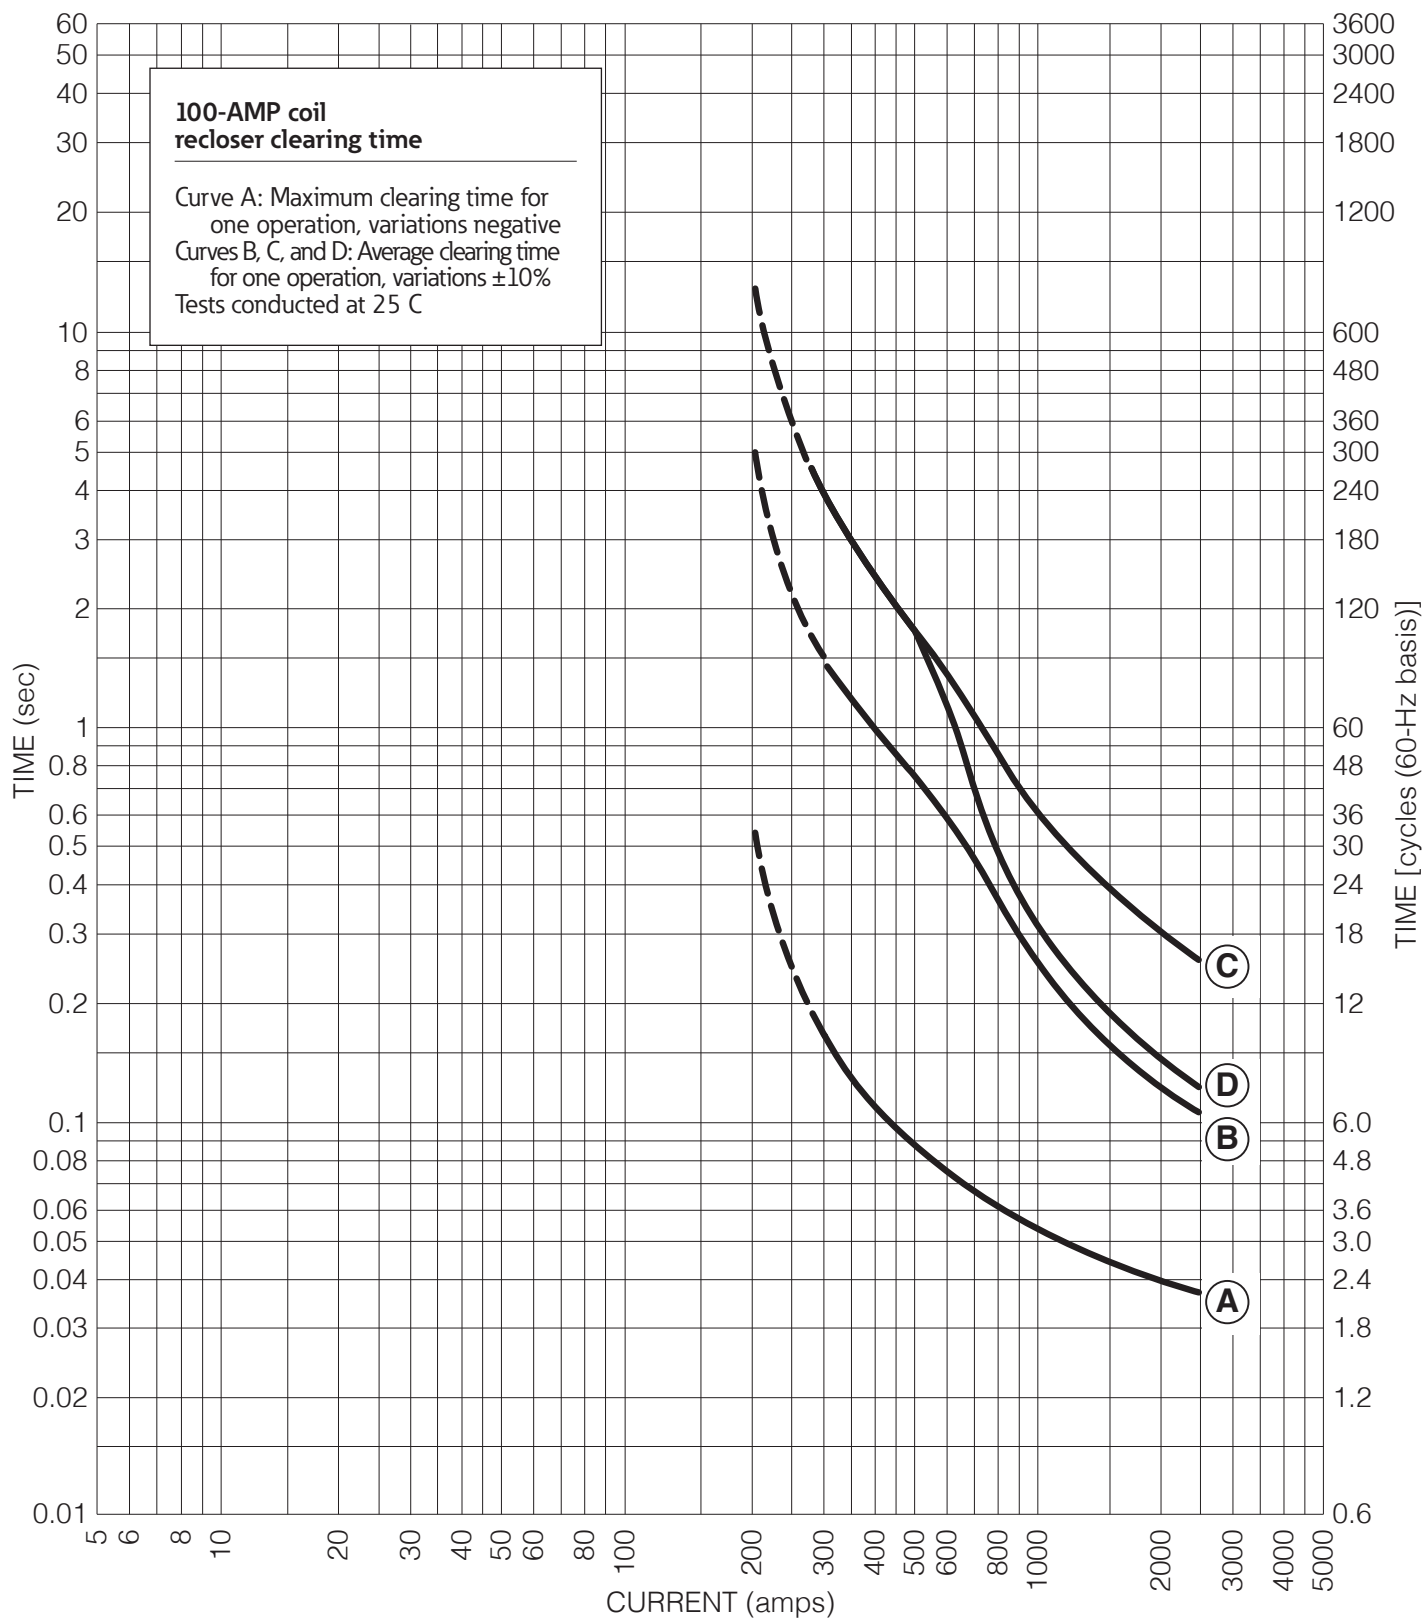

**Eaton**  
1000 Eaton Boulevard  
Cleveland, OH 44122  
United States  
Eaton.com

**Eaton's Power Systems Division**  
2300 Badger Drive  
Waukesha, WI 53188  
United States  
Eaton.com/cooperpowerseries

© 2017 Eaton  
All Rights Reserved  
Printed in USA  
Publication No. TC280009EN  
August 2017

Eaton is a registered trademark.  
All other trademarks are property  
of their respective owners.

For Eaton's Cooper Power series product  
information call 1-877-277-4636 or visit:  
[www.eaton.com/cooperpowerseries](http://www.eaton.com/cooperpowerseries).