


Type V4L and V4E time current curves


Contents


Description	Page
15 AMP coil – recloser clearing time	2
25 AMP coil – recloser clearing time	3
35 AMP coil – recloser clearing time	4
50 AMP coil – recloser clearing time	5
70 AMP coil – recloser clearing time	6
100 AMP coil – recloser clearing time	7
140 AMP coil – recloser clearing time	8
200 AMP coil – recloser clearing time	9
280 AMP coil – recloser clearing time	10





Powering Business Worldwide

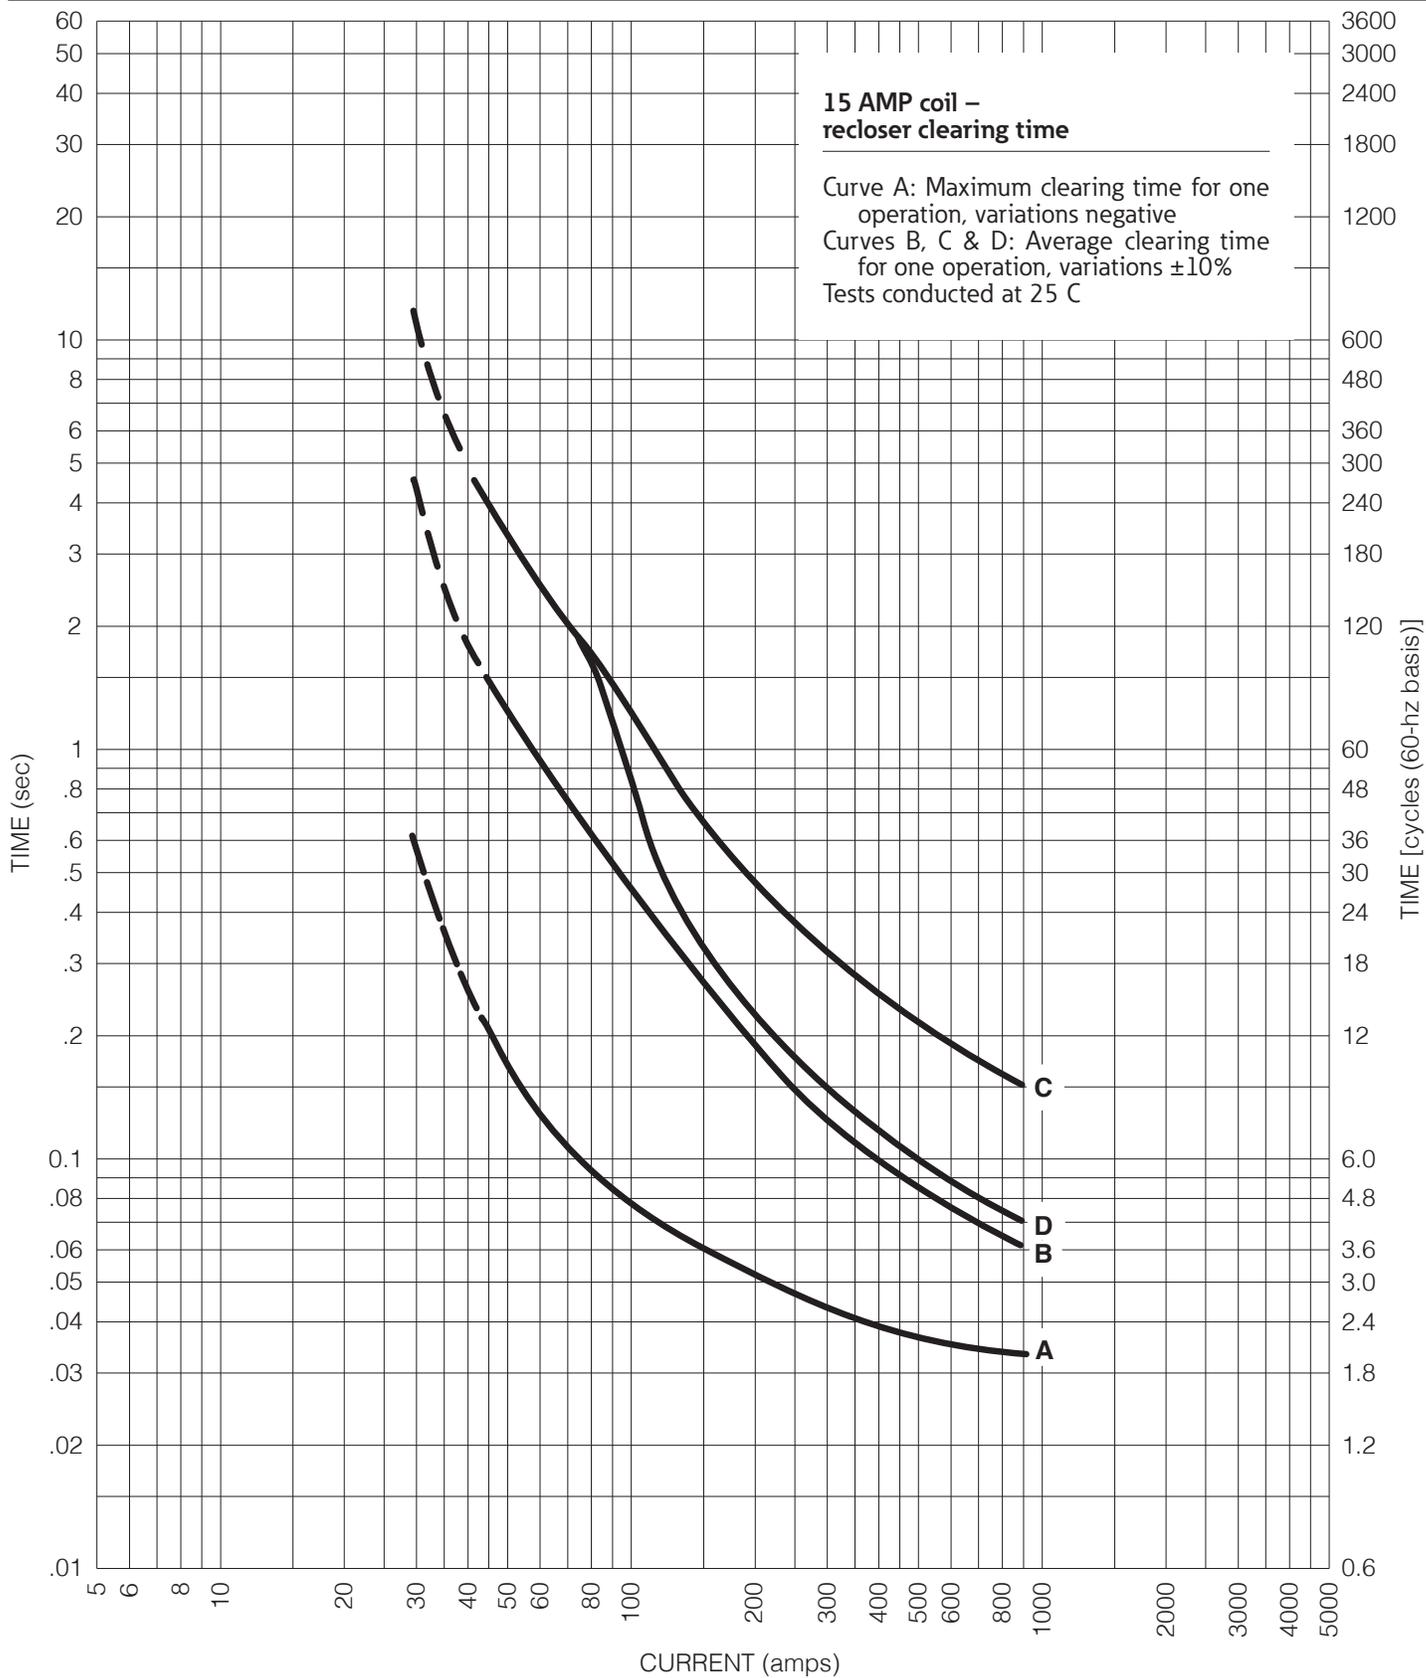


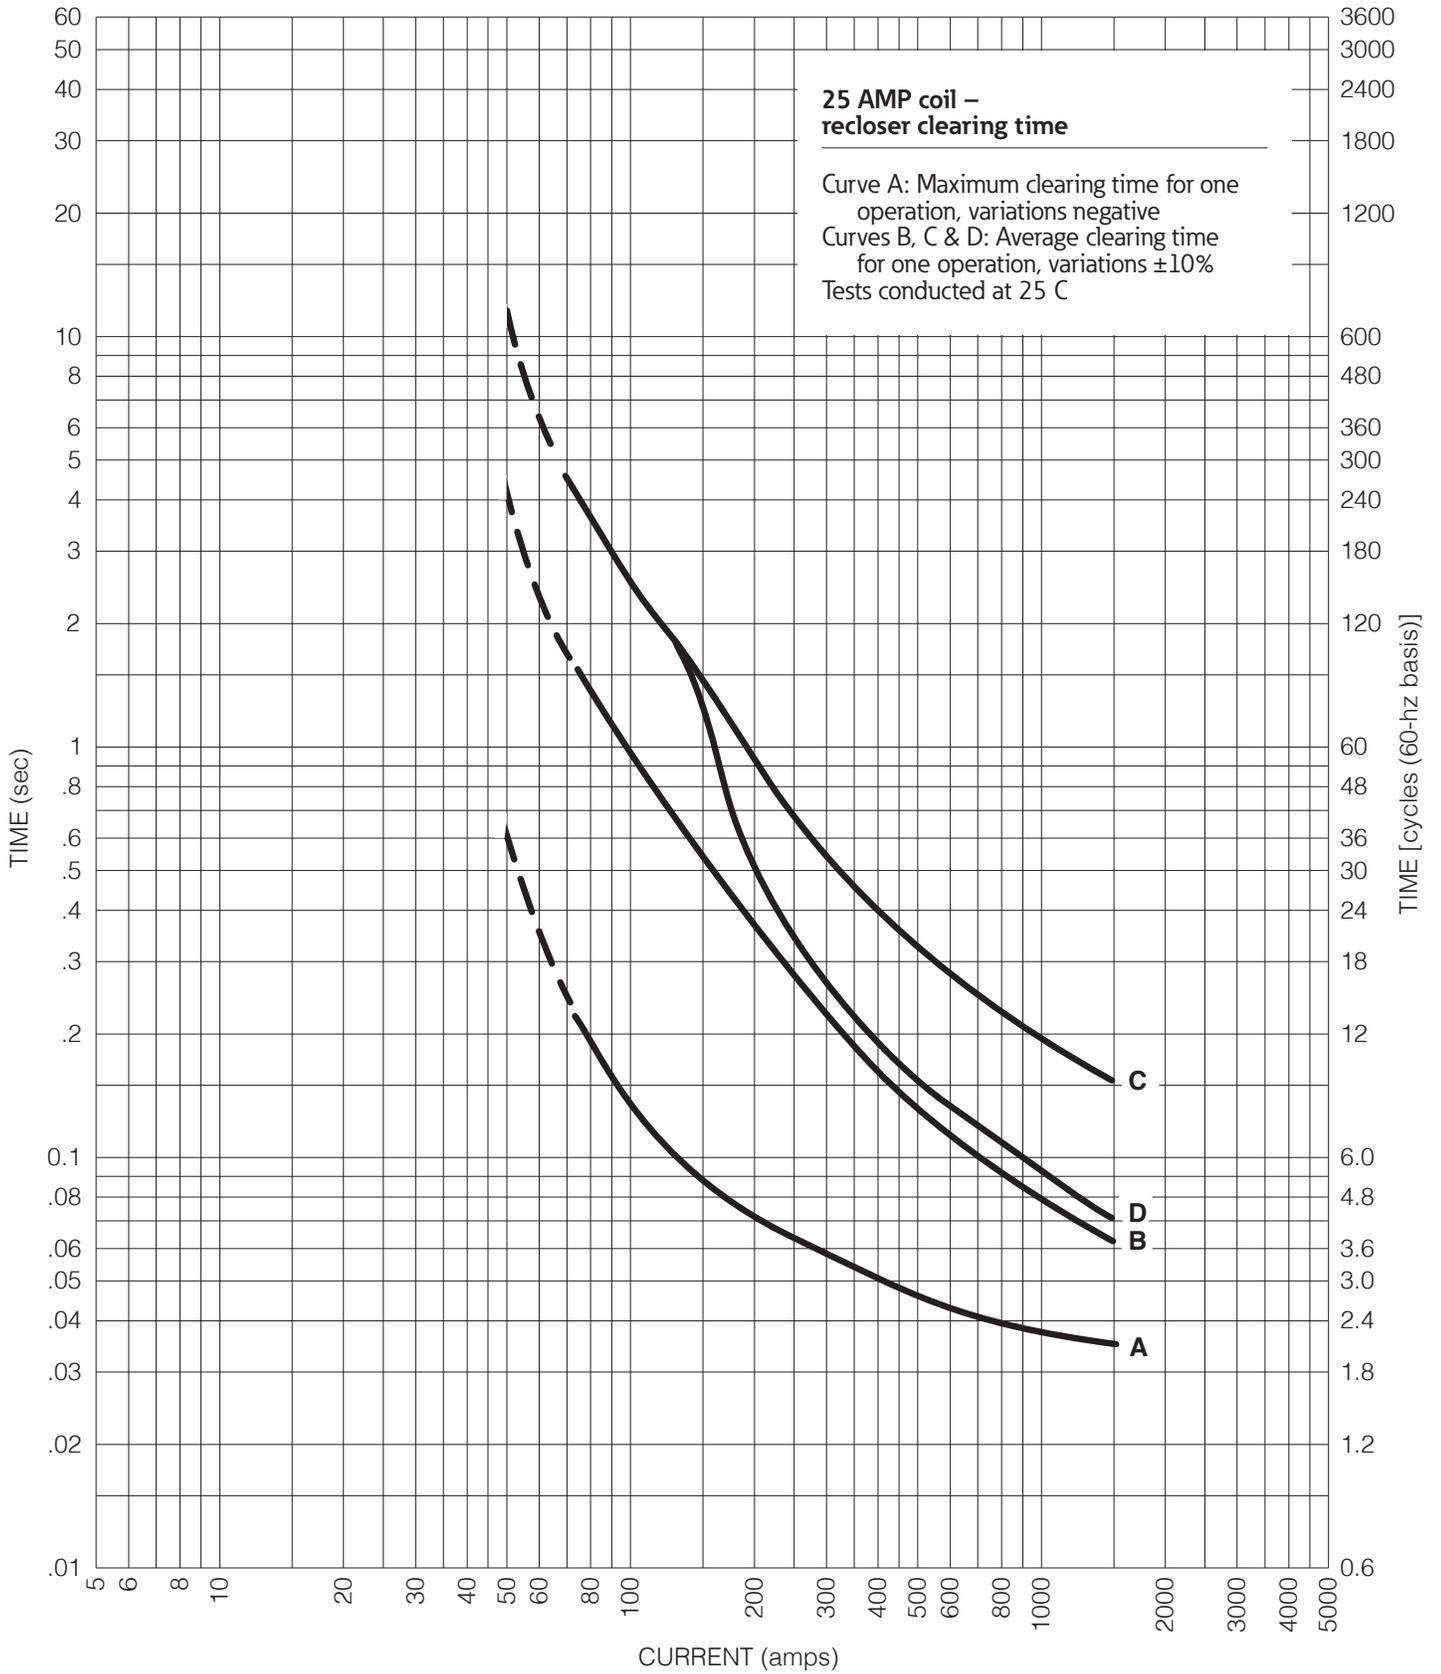


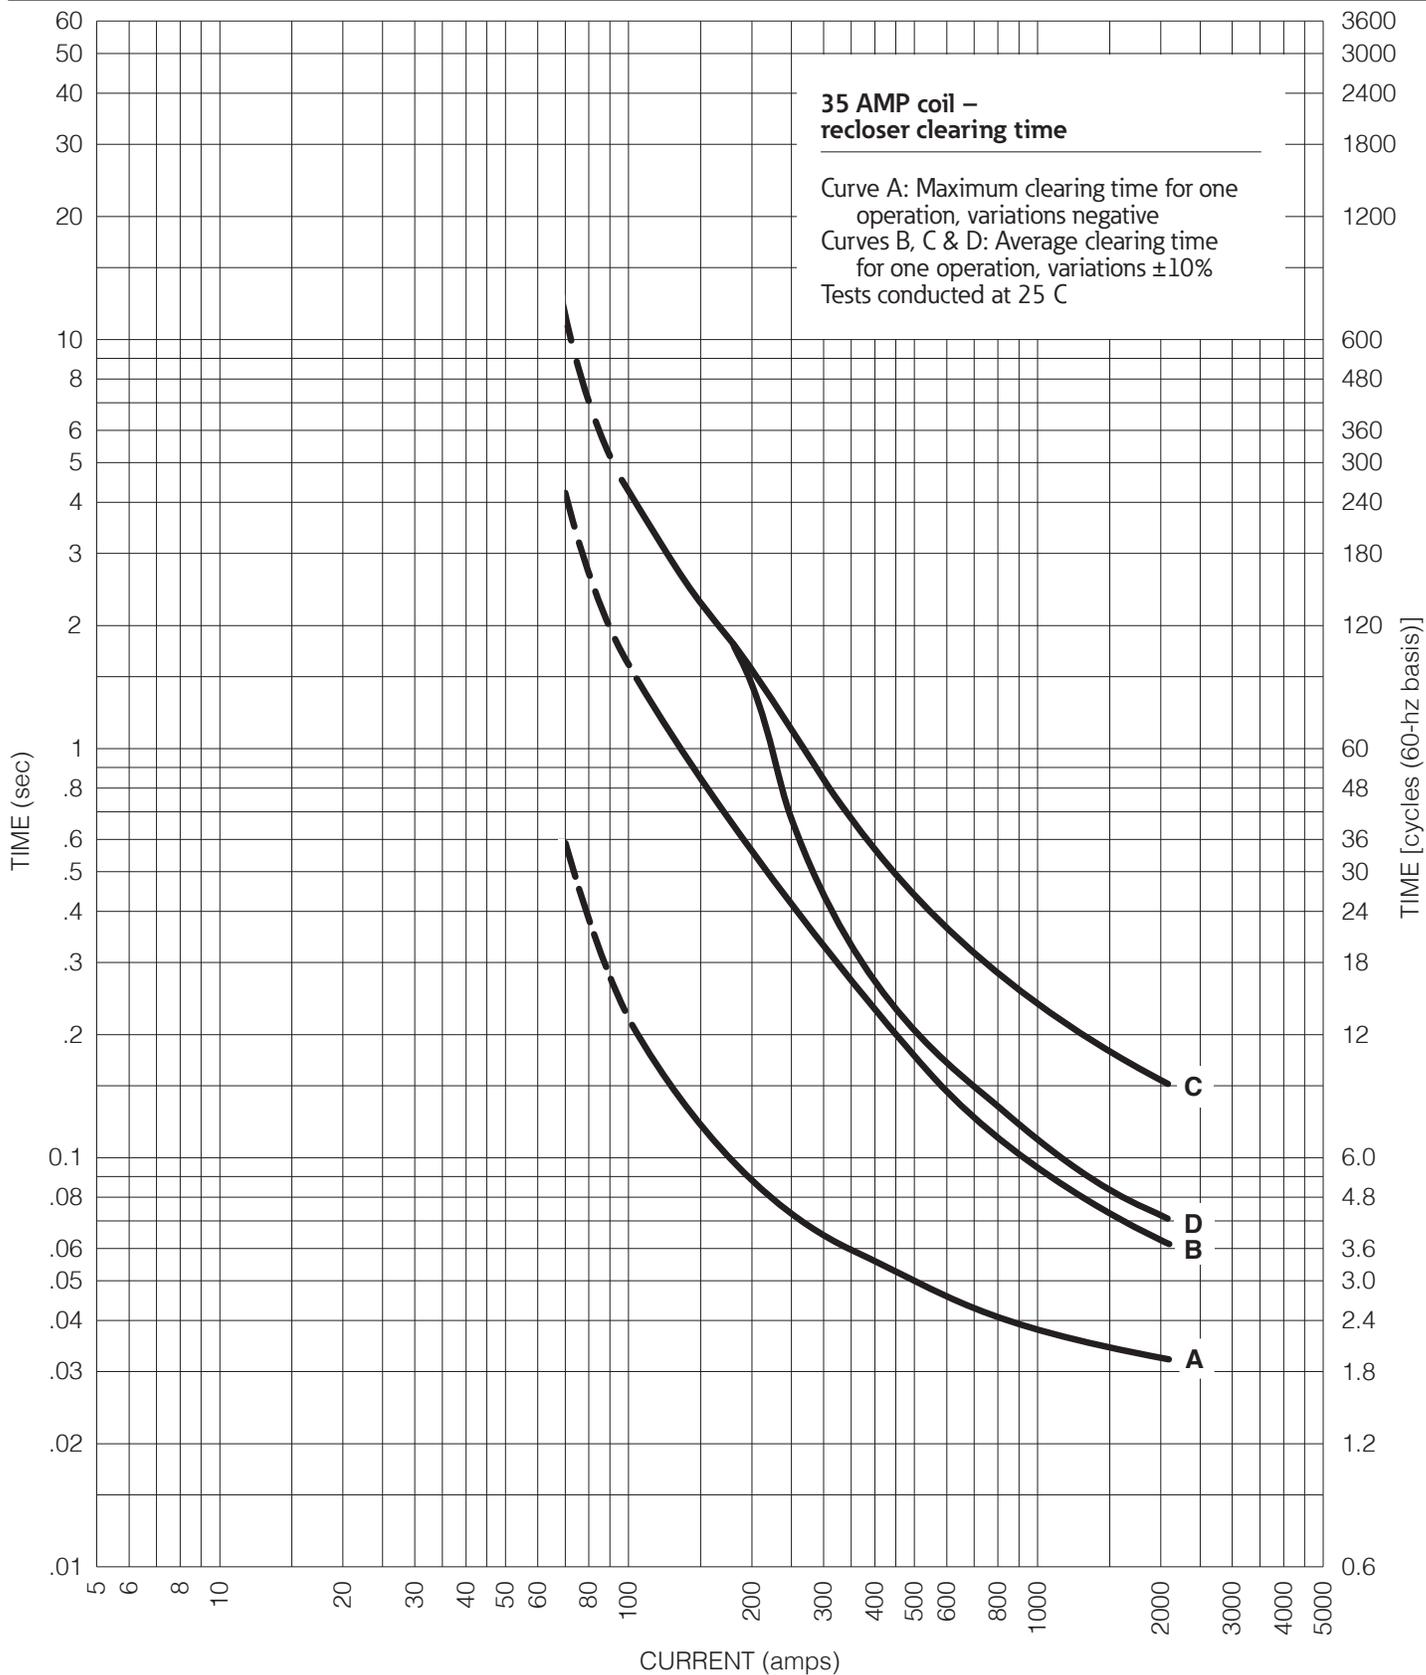


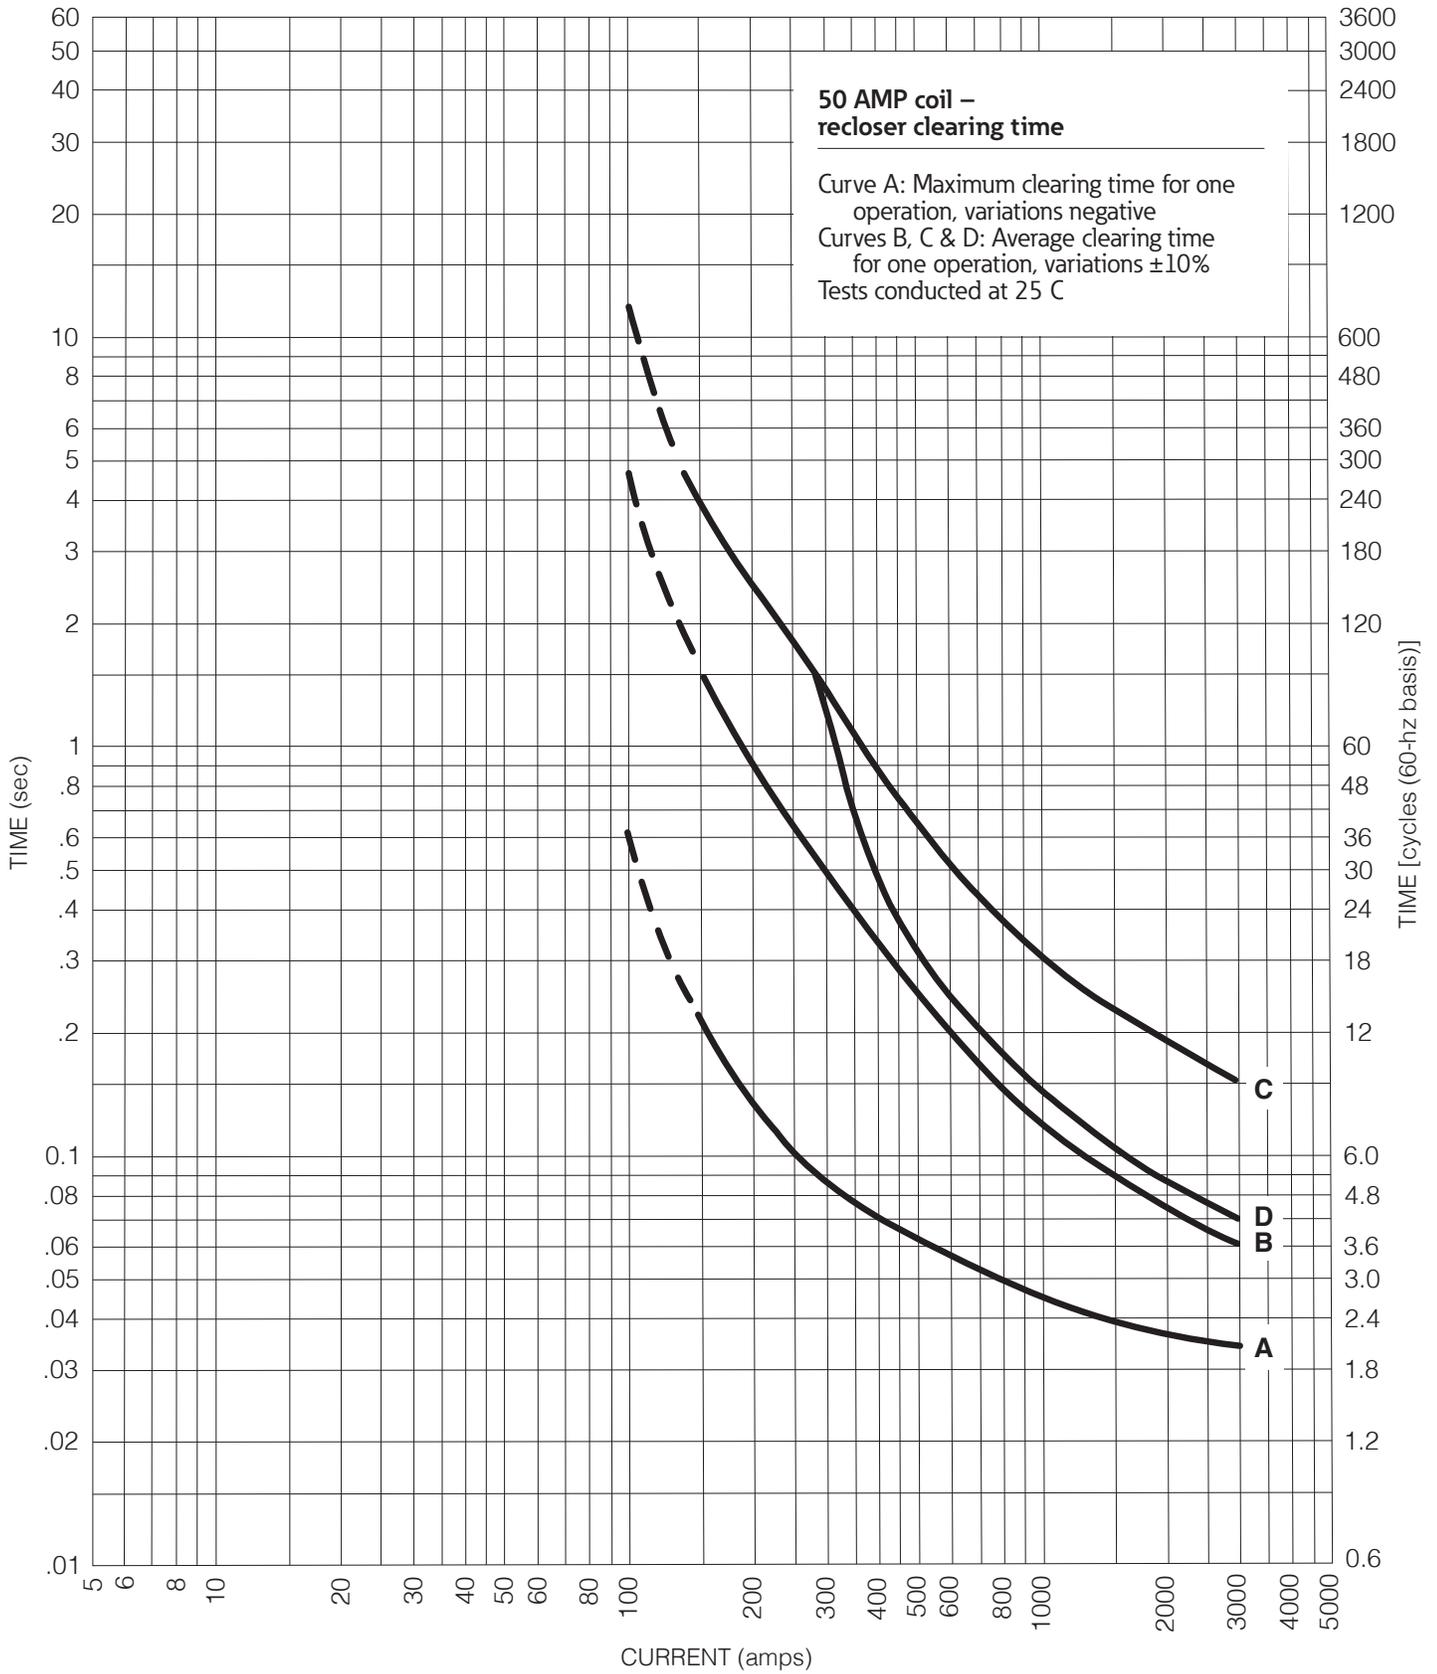


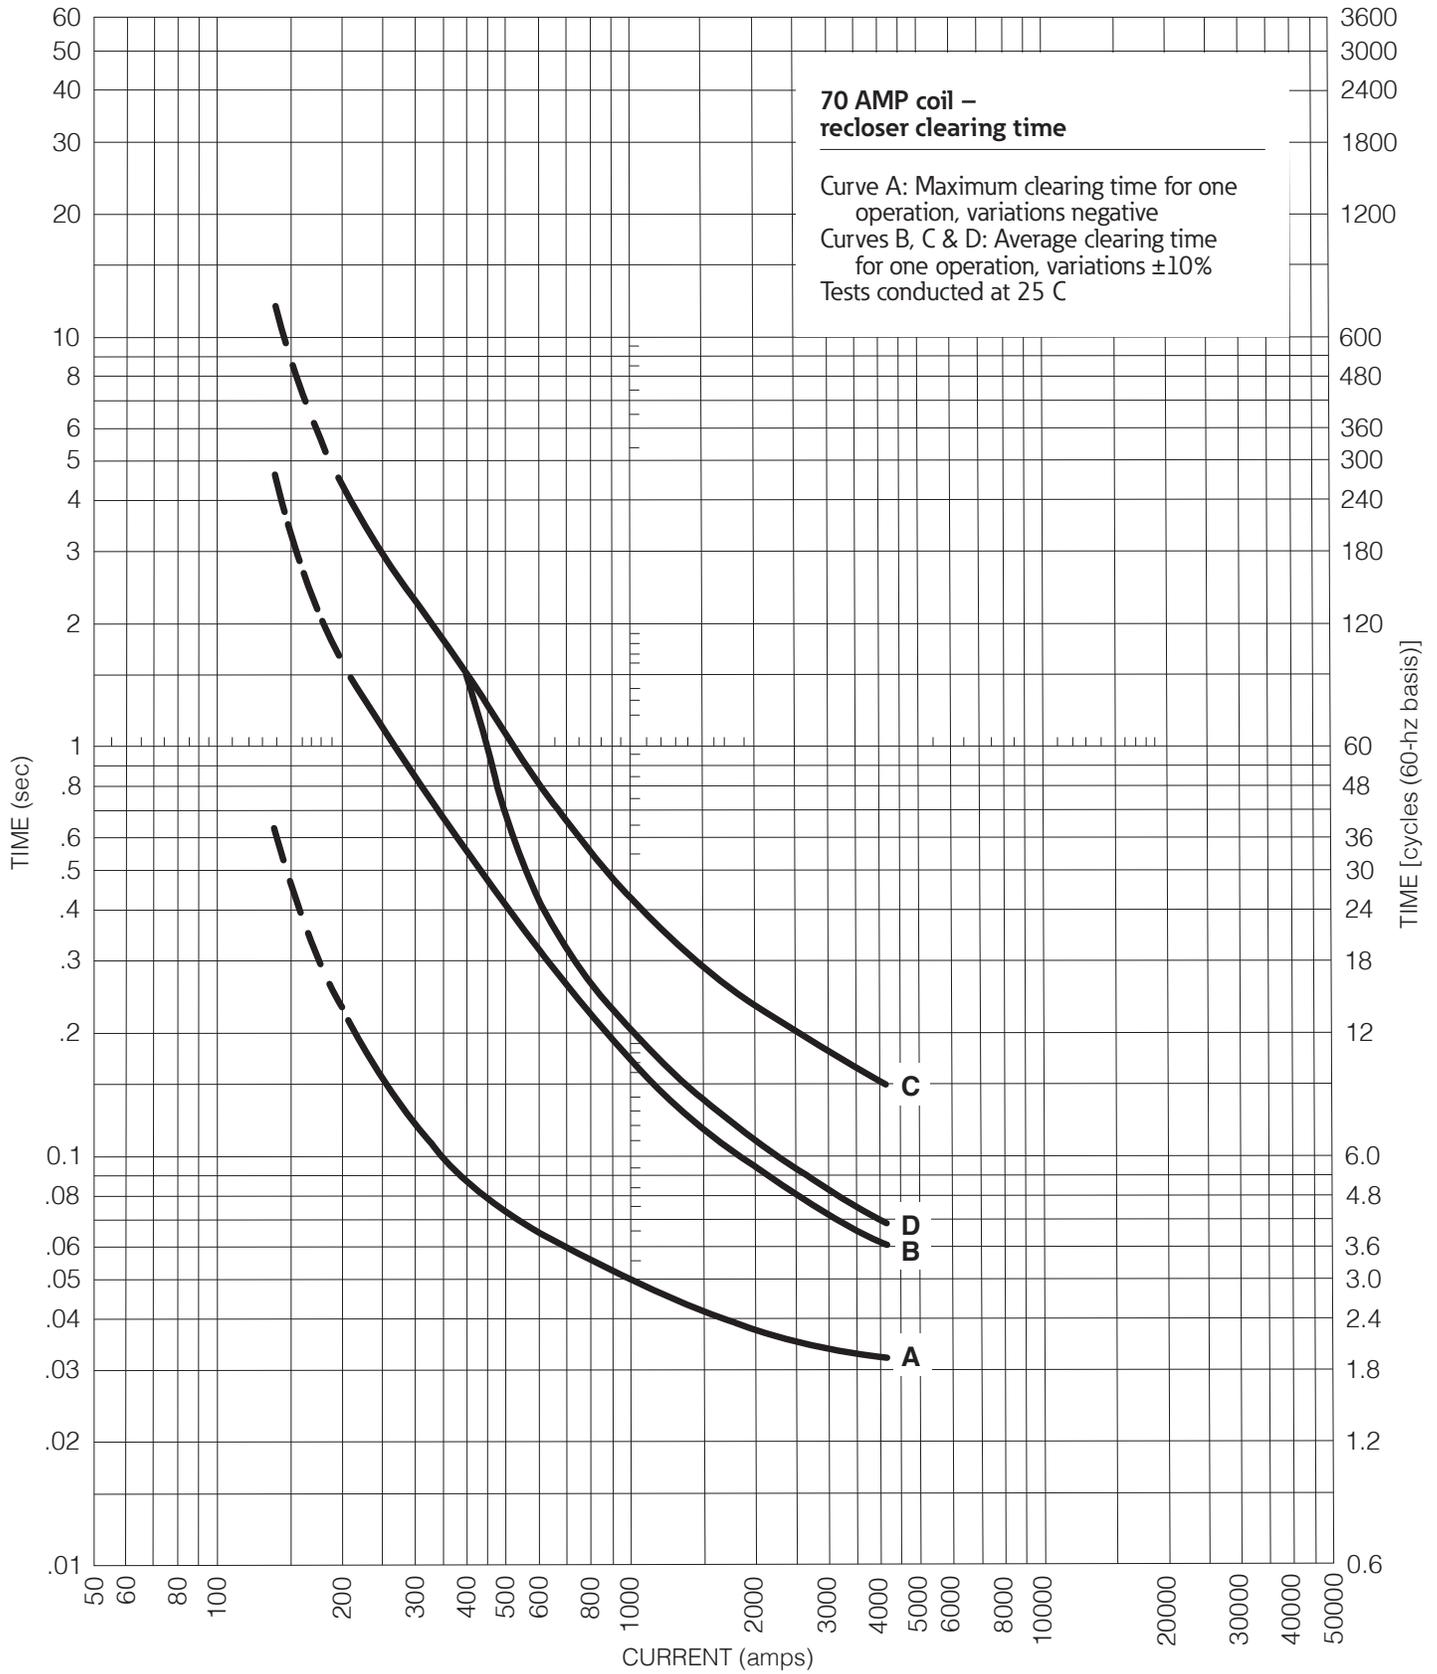

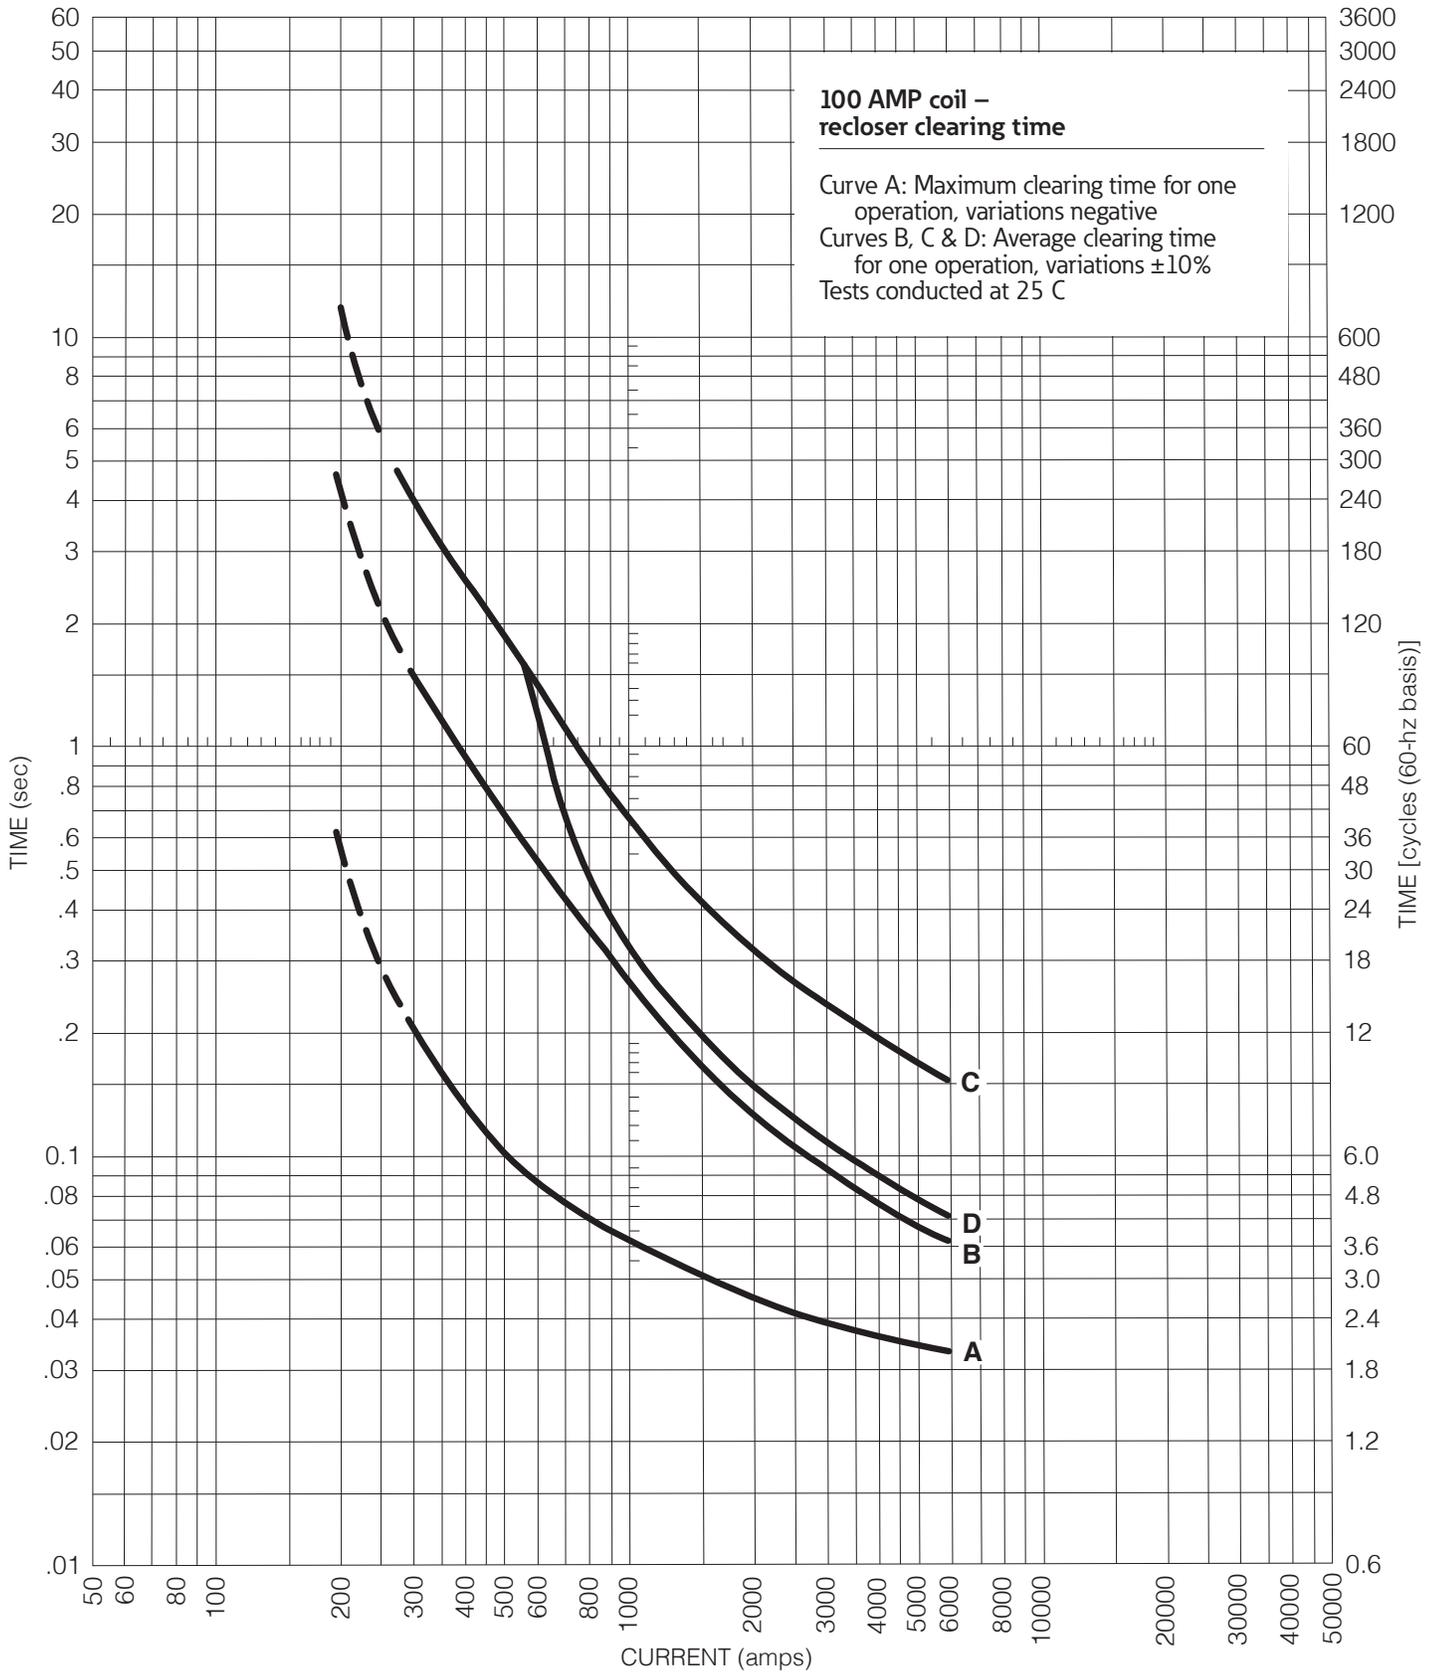

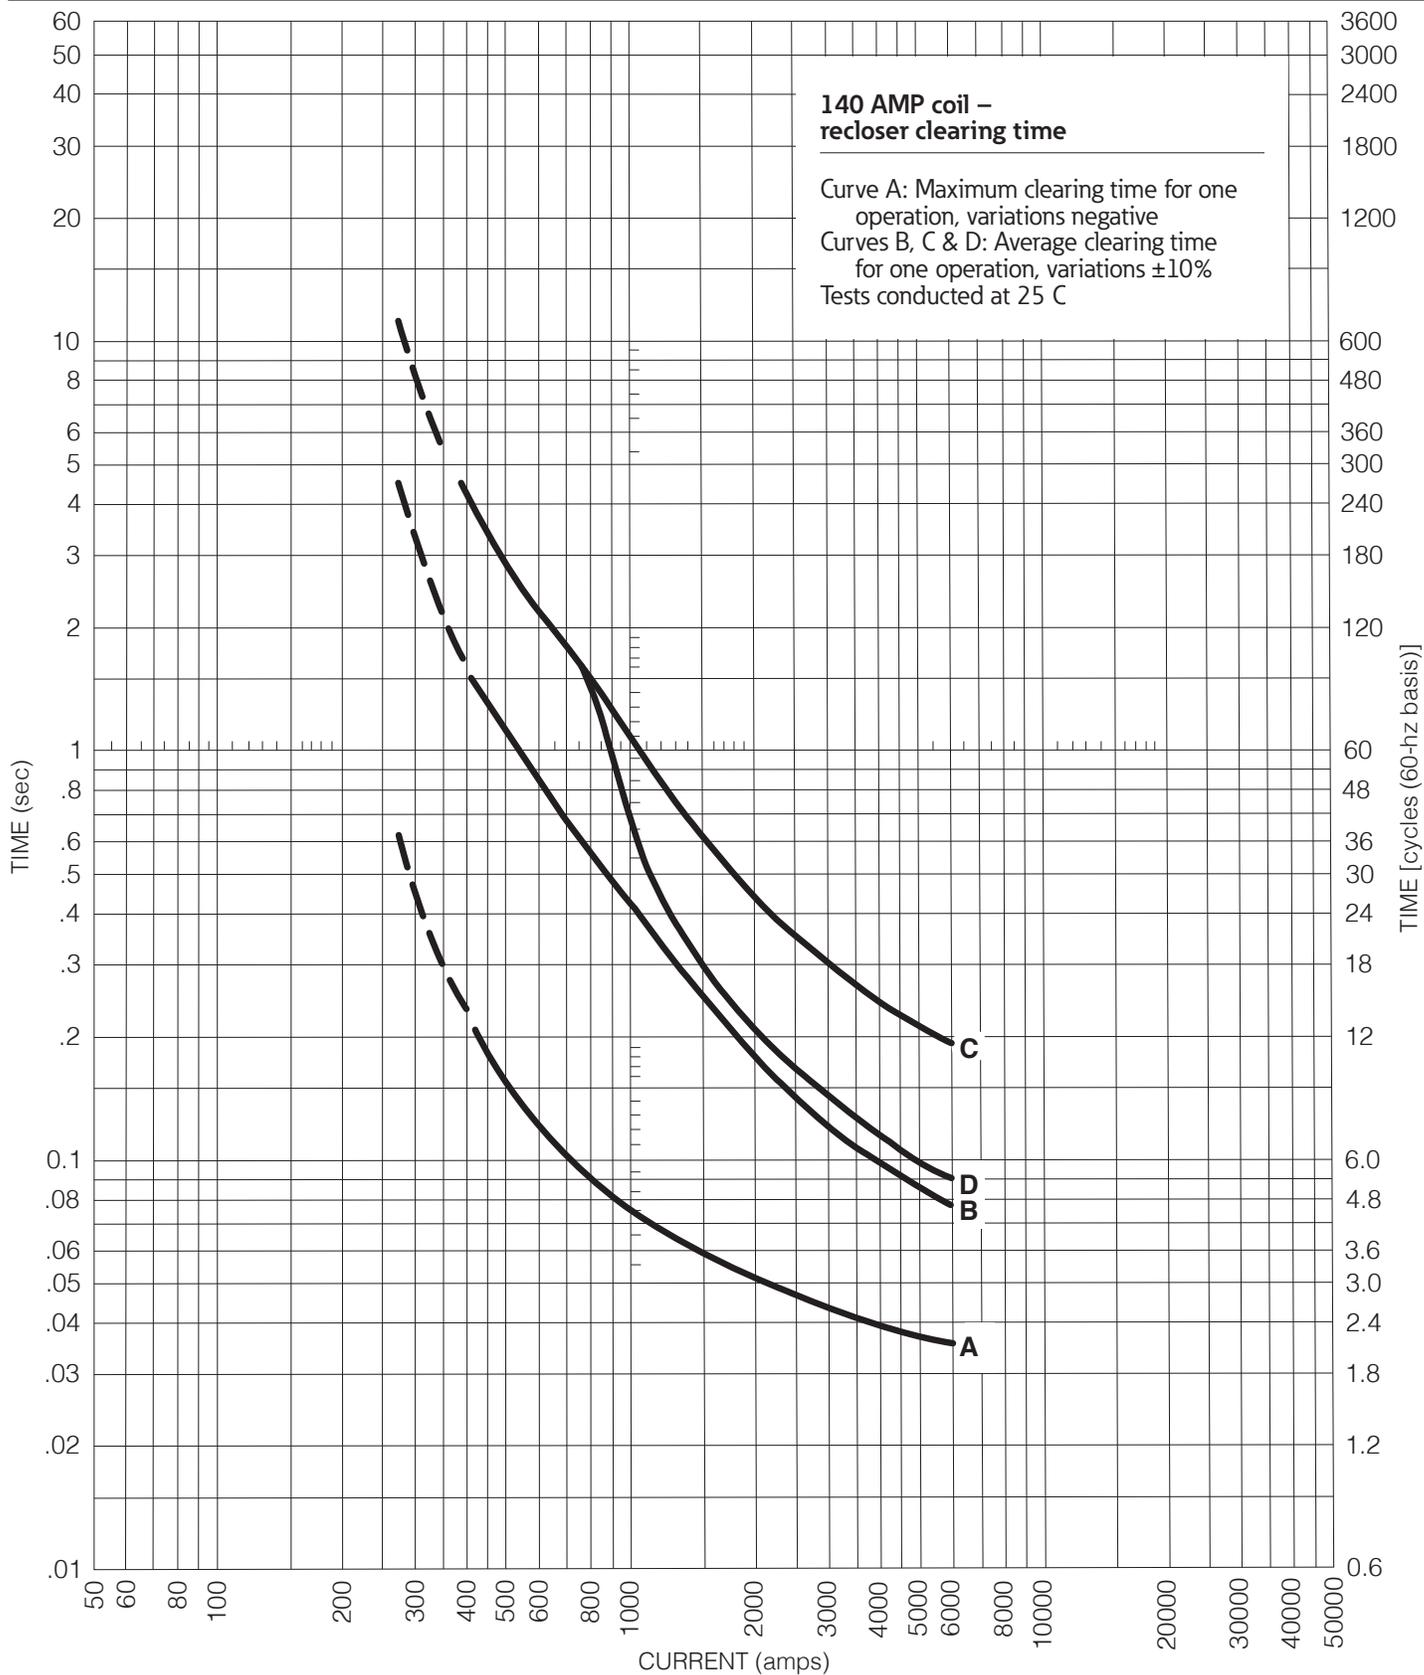

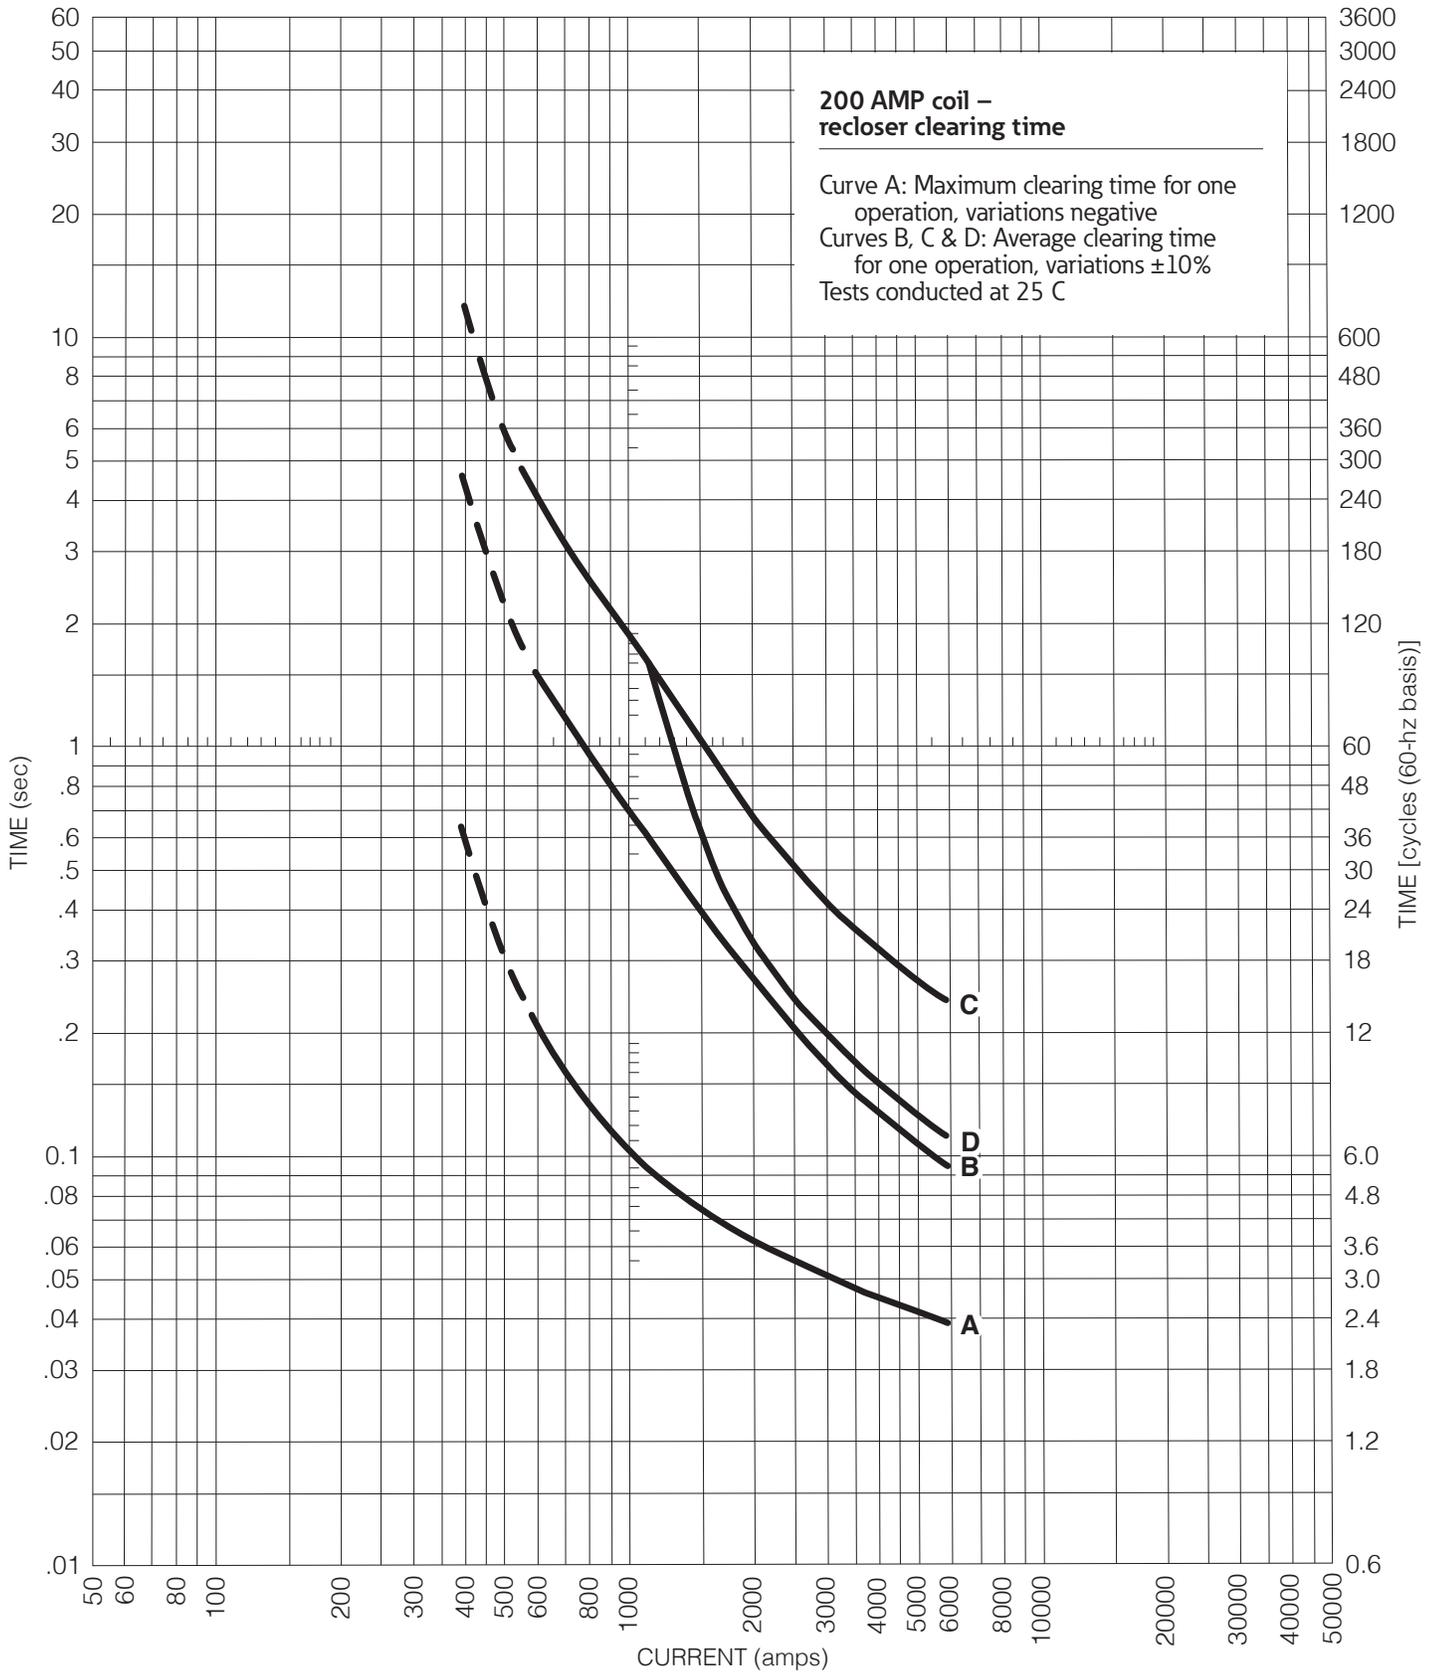

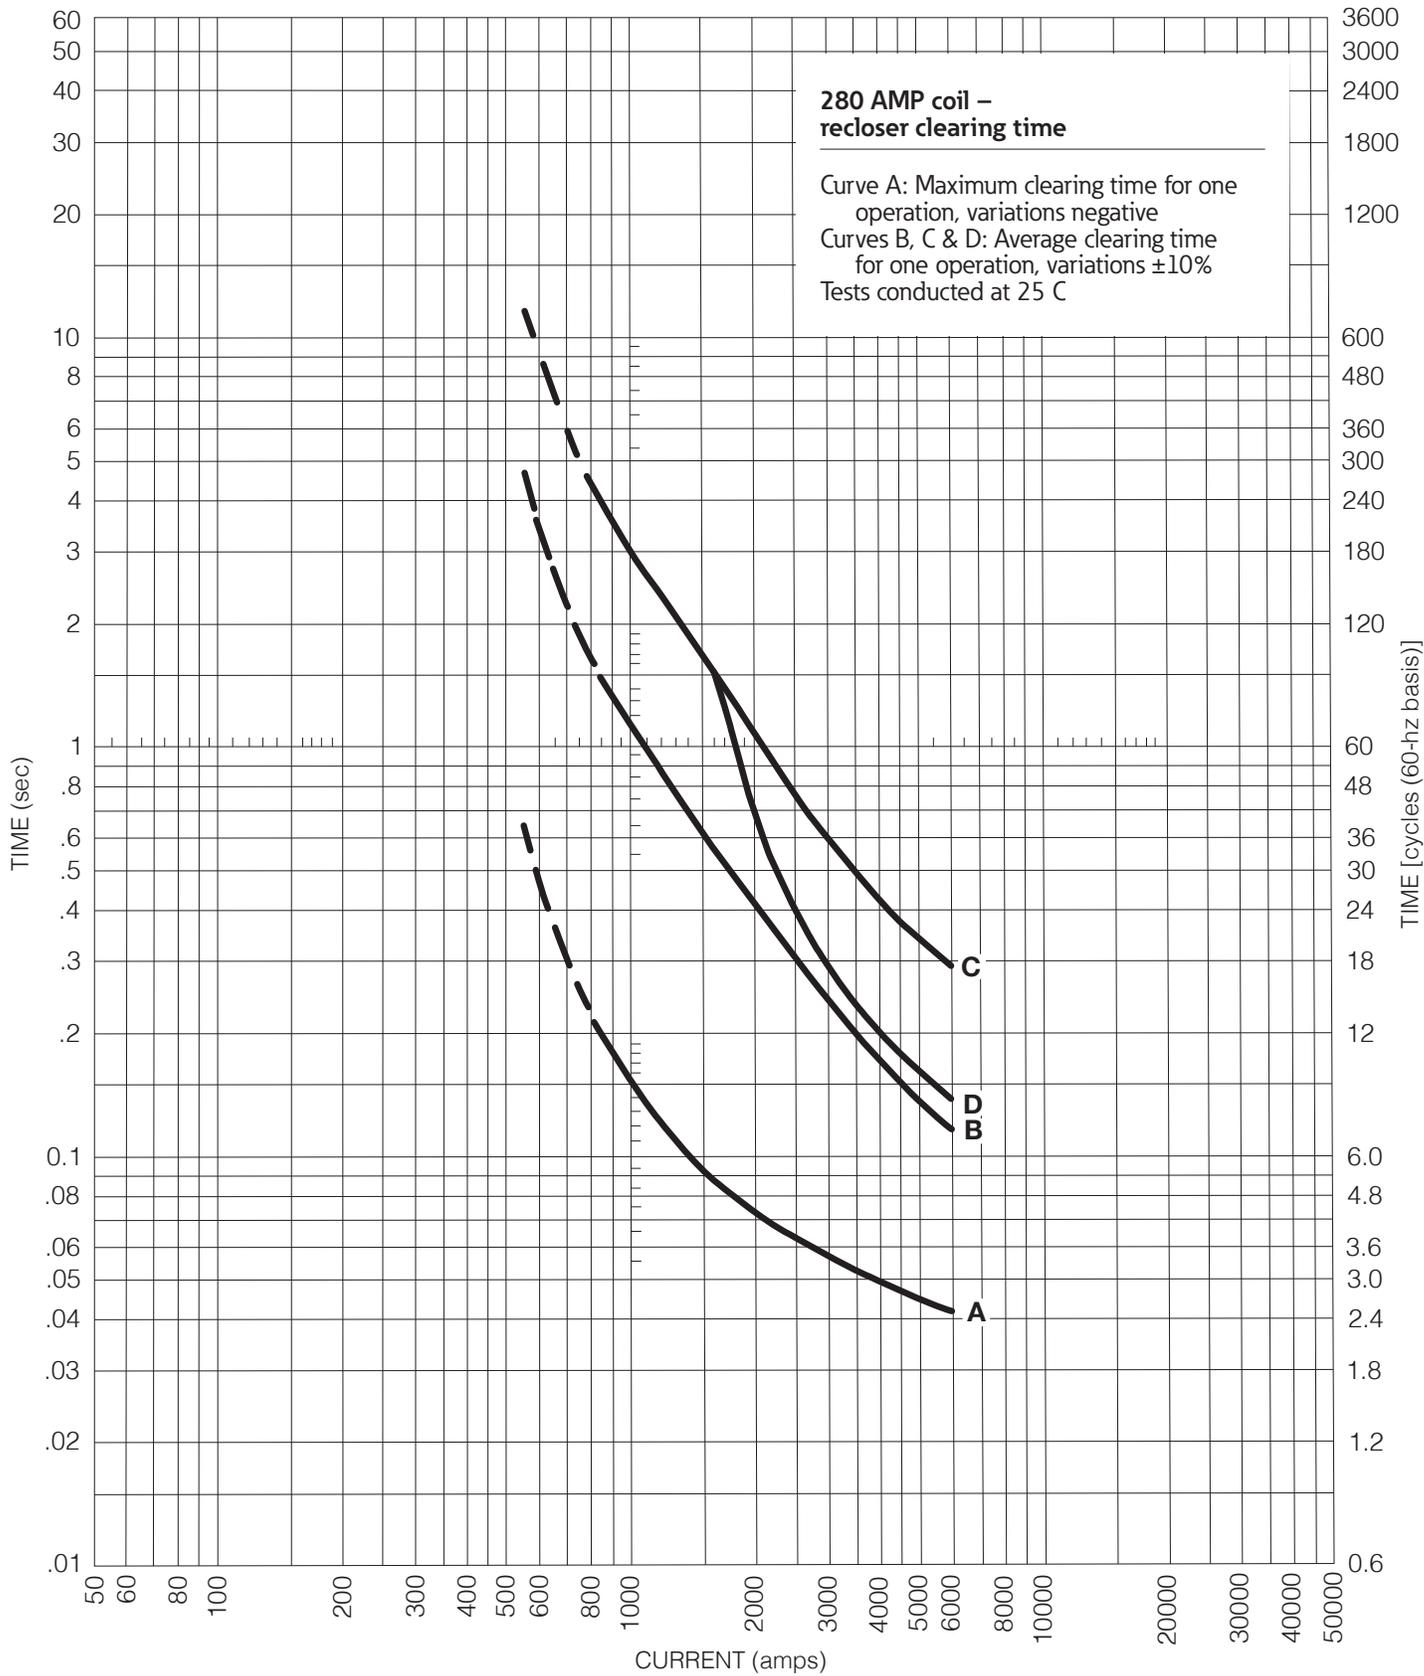

Intentionally left blank

Eaton
1000 Eaton Boulevard
Cleveland, OH 44122
United States
Eaton.com

Eaton's Power Systems Division
2300 Badger Drive
Waukesha, WI 53188
United States
Eaton.com/cooperpowerseries

© 2017 Eaton
All Rights Reserved
Printed in USA
Publication No. TC280011EN
August 2017

Eaton is a registered trademark.
All other trademarks are property
of their respective owners.

For Eaton's Cooper Power series product
information call 1-877-277-4636 or visit:
www.eaton.com/cooperpowerseries.